

Final

Functional Servicing Report 1107 Main Street West, Hamilton City of Hamilton



Prepared for 1107 Main Inc.
by IBI Group

June 14, 2021

Document Control Page

CLIENT:	1107 Main Inc.
PROJECT NAME:	1107 Main Street West, Hamilton
REPORT TITLE:	Functional Servicing Report 1107 Main Street West, Hamilton City of Hamilton
IBI REFERENCE:	122727
VERSION:	3
DIGITAL MASTER:	\\caneast.ibigroup.com\J\WT\122727_1107MainStW\7.0_Production\7.99_Submitted\FSR\2021-05-18 FSR-Third Submission\CTR_FSR_1107 Main St_2021-06-14.docx\2021-06-14\MS]
ORIGINATOR:	Tiffany Chan
REVIEWER:	John Perks
AUTHORIZATION:	IBI Group
CIRCULATION LIST:	
HISTORY:	Third Submission

Table of Contents

1	Introduction	1
2	Existing Conditions	2
2.1	Existing Roads and Pedestrian Access	3
2.2	Existing Topography and Drainage	3
2.3	Existing Sanitary	3
2.4	Existing Water System	3
2.5	Utilities	3
3	Proposed Development	4
3.1	Proposed Roads and Pedestrian Access	4
3.2	Proposed Grading	4
3.3	Proposed Sanitary Servicing	4
3.4	Proposed Water Supply and Distribution	5
3.5	Proposed Stormwater Servicing	6
3.5.1	Stormwater Quantity Control	6
3.5.2	Stormwater Quality Control	8
3.6	Proposed Utilities	8
4	Erosion and Sediment Control	9
5	Summary	9

Appendix A: Drawings

- ESC - Existing Conditions, Removals and Erosion and Sediment Control Plan
- GP - Grading Plan
- SP - Servicing Plan

Appendix B: Calculations

- B1 - Sanitary Design Flow Review
- B2 - Sanitary Sewer Capacity Analysis
- B3 - Fire Flow Review
- B4 - Domestic Water Demand
- B5 - Area 200 Roof Stage-Storage-Discharge Relationship
- B6 - Underground Tank Stage-Storage-Discharge Relationship
- B7- MIDUSS Output

1 Introduction

1107 Main Inc. retained IBI Group to prepare a Functional Servicing Report for the proposed development at 1107 Main Street West, Hamilton, Ontario.

The development is located on the south side of Main Street West between Dow Avenue and Cline Avenue South with a total land area of approximately 0.517 hectares. Refer to Plate 1 below for the location of the proposed development.

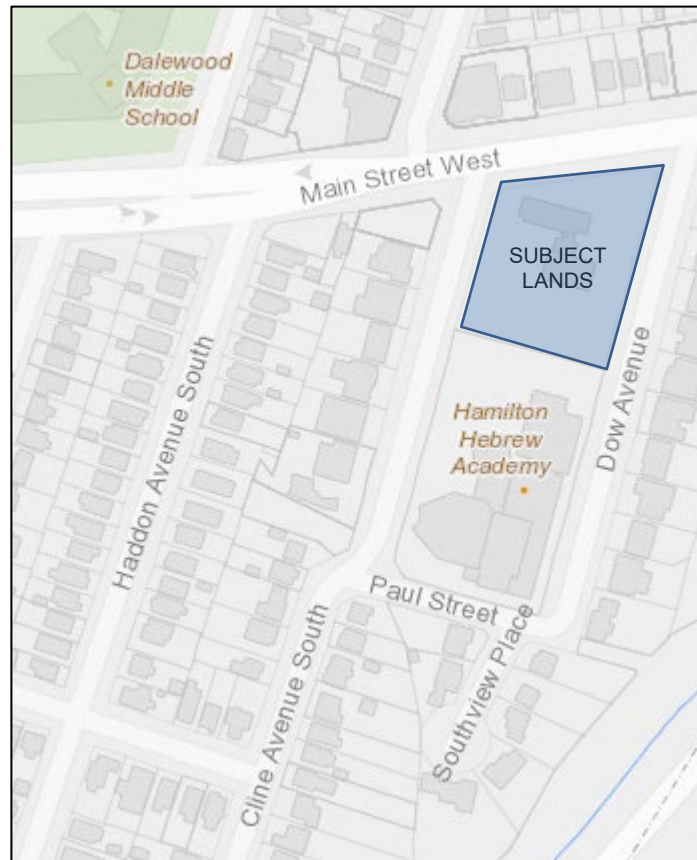


PLATE 1: Site Location (source: www.map.hamilton.ca)

The proposed redevelopment will demolish the existing buildings and infrastructure and construct a 15-storey mixed-use building with three levels of underground parking. Refer to **Appendix A** for the Site Plan and Engineering Drawings.

This report will describe the proposed functional grading, servicing and stormwater management (SWM) for the development in order to demonstrate the feasibility and approach for the design of the proposed development from a site municipal engineering perspective.

2 Existing Conditions

The existing subject property currently has the Grace Evangelical Lutheran Church with a stone building, landscaped areas, concrete pavements and a gravel parking lot. The Adas Israel Synagogue and Hamilton Hebrew Academy borders the south property boundary of the subject development. Plate 2 below show the aerial photography of the site.



PLATE 2: Site Aerial Photo (source: <https://www.conservationhalton.ca/mapping-and-data>)

2.1 Existing Roads and Pedestrian Access

The subject site is fronted by Main Street West to the north, Cline Avenue South to the west, Dow Avenue to the east and existing development to the south. Current vehicular access to the subject lands is from Cline Avenue South. On all three roadways flanking the subject property there exist municipal 1.5m wide sidewalk.

2.2 Existing Topography and Drainage

The subject site is generally flat with a gentle slope away from the existing church building towards the property boundaries.

There is no known existing stormwater infrastructure on the property and stormwater sheet flows from the property to the storm infrastructure on Cline Avenue South and Dow Avenue.

2.3 Existing Sanitary

The subject site has combined sewers on the three adjacent streets as follows:

- Main Street West has a 450mm diameter combined sewer draining westward at a slope of 0.42% with a calculated full pipe capacity of 184.8L/s. Main Street West also has a 300mm diameter combined sewer draining eastward at a slope of 0.48% with a calculated full pipe capacity of 67.0L/s.
- Dow Avenue has a 375mm diameter combined sewer draining northward at a slope of 0.56% with a calculated full pipe capacity of 131.2L/s. The Dow Avenue sewer outlets to the 450mm diameter combined sewer on Main Street West.
- Cline Avenue South has a 375mm diameter combined sewer draining northward at a slope of 0.75% with a calculated full pipe capacity of 151.8L/s. The Cline Avenue South sewer outlets to the 450mm diameter combined sewer on Main Street West.

2.4 Existing Water System

The subject lands are flanked with existing municipal watermain:

- An existing 300mm diameter watermain on Main Street West;
- An existing 150mm diameter watermain on Cline Avenue South; and,
- An existing 150mm diameter watermain on Dow Avenue.

An existing 150mm diameter water service connection exists to the subject property from Dow Avenue.

A municipal hydrant is located to the east of the subject lands on Cline Avenue South and to the west of the subject site on Dow Avenue.

2.5 Utilities

Electric, natural gas, and telecommunication services exist within close proximity to the subject development on Main Street West, Cline Avenue South and Dow Avenue.

3 Proposed Development

The proposed development will demolish the existing Grace Evangelical Lutheran Church, including hardscaped areas and infrastructure on the property. A 15-storey mixed-use building with 295 residential units and 558.3m² of commercial space will be constructed. The building will have three levels of underground parking and limited street parking totalling 208 parking stalls.

The following sections describe the functional design of the area grading and municipal servicing for the proposed development. The purpose of the functional design is to demonstrate the feasibility of the development, outlining the general strategy for the grading, and municipal servicing. The final design (to be completed during the Site Plan Approval stage) will establish the details of the development's design.

3.1 Proposed Roads and Pedestrian Access

The proposed development will have vehicular access to the underground parking from Cline Avenue South with surface level parallel parking provided along Cline Avenue South and Dow Avenue. The subject development will extend the asphalt surface of the existing roadway to provide the parallel parking spots.

A separate Traffic Impact Study reviews the impacts and requirements of the proposed development in terms of improvements needed on the existing adjacent roads and entrances. Any required improvements would be incorporated into the Final Design of the site.

3.2 Proposed Grading

The proposed development will construct a building with its face near to the property line. The building's footprint will be over 70% of the subject land area.

The grading of the site will direct drainage from the narrow strip of land surrounding the building to the adjacent roadways by sheet flow, with the grading matching property line elevations.

A minimum of 0.5% and a maximum of 5% slope will be used on all hard surfaces for vehicular and pedestrian access routes to ensure accessibility, with the exception of the parking garage ramp that will have a maximum slope of 15%. A minimum of 2% and a maximum of 33% slope will be used for landscaped areas.

Refer to **Appendix A** for the functional grading of the site.

3.3 Proposed Sanitary Servicing

The development is proposed to have 295 residential units and 558.3m² of commercial space. Using the Ontario Building Code Section 8, and the City's engineering guidelines, the total design sanitary flow based on population is estimated to be 18.4 L/s. The theoretical capacity of the receiving 375mm diameter combined sanitary sewer, at its existing 0.56% slope, is 131.2 L/s.

Runoff collected in the building's underground parking will be discharged to the sanitary system via sump pumps.

Refer to **Appendix A** for the functional servicing plans of the proposed development, and to **Appendix B** for the sanitary flow and sewer capacity calculations.

3.4 Proposed Water Supply and Distribution

The proposed water supply for the subject development will be a service connection to the existing 300mm diameter watermain on Main Street West. All watermain and appurtenances will be designed and constructed in accordance with the current municipal and American Water Works Association standards and specifications.

The maximum domestic water demand for the proposed development was determined using the fixture value procedure detailed in the American Water Works Association Manual M22 "Sizing Water Service Lines and Meters". Hydraulic loading for the fixtures was derived from the Ontario Building Code, Section 7. The estimated maximum domestic water demand for the proposed 295 residential units and 615.2m² commercial space development is 80 gpm or 5.1 L/s.

As per the Fire Underwriter Survey, a minimum flow of 4,000 L/min plus a maximum day demand of 37 L/min will be required at 20 PSI (140 kPa) to service this development under fire suppression. Using the preliminary architecture drawings and based on the Fire Underwriters Survey methodology the required fire flow is 216.7 L/s for the proposed development.

The City of Hamilton in Memorandum "Formal Consultation Meeting - Application by SRM Architects Inc. for lands located at 1107 Main Street West, Hamilton (Ward 1)" dated June 3, 2019 provided hydrant flow tests of the hydrants in close proximity to the development. The results of the hydrant flow test performed on Main Street West, Cline Avenue South and Dow Avenue are shown in Table 1.

TABLE 1: Hydrant test data (source: [City of Hamilton](#))

Hydrant ID	Address	Pressure Zone	Date of Most Recent HFI2	Static Pressure (psi)	Residual Pressure (psi)	Test Flow (Imp Gal/min)	DSR	DSR2	FAR20 (Imp Gal/min)
HA51H001	1070 MAIN ST W HAMILTON	2	9/27/18 5:24:34 AM	64	60	950	4	44	3468
HA50H025	DOW AVE HAMILTON	2	8/25/18 10:43:38 AM	68	40	470	28	48	629
HA50H024	CLINE AVE S HAMILTON	2	8/19/18 11:58:10 PM	68	32	304	36	48	355

Hydrant HA51H001 located close to 1070 Main Street West has a theoretical flow of 3,468 Imperial gpm or 262.8 L/s at 20 psi. Accordingly, it is concluded that the existing municipal water infrastructure is adequate to service the proposed development.

The existing fire hydrants on Dow Avenue and Cline Avenue South will be maintained with the proposed development.

Refer to **Appendix A** for a plan of the site's servicing, and **Appendix B** for calculation details of the domestic water demand and fire flow.

3.5 Proposed Stormwater Servicing

The SWM criteria addressing the stormwater quality and quantity for this development are based on the requirements of the City of Hamilton and are summarized as follows:

- Proposed conditions peak flows for the 2 year to 100 year storm events are to be controlled to the lesser of the 2 year pre-development flows or the available capacity in the Dow Avenue storm sewer system; and,
- Stormwater quality controls are to be provided for the site to an Enhanced Protection Level as per Ministry of Environment “Stormwater Management Planning and Design Manual”, March 2003 guidelines.

The site’s proposed stormwater system will collect runoff from the building’s roof and larger landscaped areas via area drains. Some small areas at the boundary of the site will sheet drain to the adjacent lands as it would be difficult to capture this runoff (this is similar to existing conditions).

On-site stormwater storage utilizing rooftop areas and an underground stormwater storage tank are proposed to provide quantity control. The collected runoff will outlet via an orifice to the municipal 300mm diameter storm sewer located on Dow Avenue. Minor pedestrian areas and landscape buffers will sheet flow to the adjacent roadways.

Given that the site runoff is primarily from clean sources, an enhanced level of water quality for the proposed development will be achieved without the use of any stormwater quality measures.

The following sections provide more detailed description of the stormwater management controls. Calculations and modelling are provided in Appendix B.

3.5.1 Stormwater Quantity Control

The 3-hour duration Chicago style storms and 6-Hour SCS storms derived from City of Hamilton rainfall data were used for the stormwater management modelling. The total depths of rainfall for the modelled storms are as indicated in Table 2.

TABLE 2: Rainfall Depths

RETURN EVENT	STORM DURATION (hours)	RAINFALL DEPTH (mm)
3-Hour Chicago Storm		
2 Year	3	32.7
5 Year	3	46.9
10 Year	3	56.5
25 Year	3	68.7
50 Year	3	76.9
100 Year	3	86.1
6-Hour SCS Storm		
2 Year	6	39.6
5 Year	6	56.5
10 Year	6	67.6
25 Year	6	81.6
50 Year	6	91.9
100 Year	6	102.3

The existing and proposed conditions were modelled using MIDUSS, and the modelling parameters are summarized in Table 3. Figure 1 and Figure 2 depicts the existing and proposed stormwater drainage condition. The total impervious area under existing conditions is approximately 2,575 m².

TABLE 3: MIDUSS Modelling Variables

CATCHMENT ID	DESCRIPTION	AREA (ha)	FLOW LENGTH (m)	GRADIENT (%)	IMPERV. (%)	MANNING 'n'	PERVIOUS CN
Existing Conditions							
101	Subject Lands	0.516	40	2	50	0.250	74
Proposed Conditions							
200	SWM Rooftop	0.140	20	1	100	0.250	74
201	Non-SWM Rooftop	0.161	20	1	100	0.250	74
202	Courtyard	0.062	10	2	65	0.250	74
203	Uncontrolled Land	0.153	10	2	35	0.250	74

The 300mm diameter storm sewer on Dow Avenue is sloped at 0.50% with a calculated full pipe capacity of 68 L/s. Table 4 below shows the existing condition peak flows as determined from the MIDUSS model. Comparing the 2 year pre-development flow and the pipe capacity, the lesser 2-year pre-development flow will govern the stormwater quantity control design and represent the maximum peak flow target from the subject lands.

TABLE 4: Existing Peak Flows

RETURN EVENT	EXISTING CONDITIONS PEAK FLOW (m ³ /s)
3-Hour Chicago Storm – Developing Lands	
2 Year	0.048
5 Year	0.072
10 Year	0.089
25 Year	0.109
50 Year	0.125
100 Year	0.141
6-Hour SCS Storm – Developing Lands	
2 Year	0.040
5 Year	0.062
10 Year	0.078
25 Year	0.100
50 Year	0.114
100 Year	0.132

Under proposed conditions, the total impervious area will be approximately 4,700 m². Based on the MIDUSS model, the 6-Hour SCS storm requires a greater stormwater storage volume as compared to the 3-Hour Chicago storm. Therefore, the 6-Hour SCS storm was used to design the proposed stormwater servicing system.

Rooftop attenuation has been included in the MIDUSS model for Catchment 200. Attenuating the proposed condition's peak flow to the 2 year pre-development flow also requires a stormwater storage tank of 272 m³ with a 50mm diameter orifice control. The existing and proposed conditions peak flows for the 6-Hour SCS storm are summarized in Table 5.

TABLE 5: Proposed Development Peak Flows

RETURN EVENT	EXISTING CONDITIONS PEAK FLOW (m ³ /s)	PROPOSED CONDITIONS PEAK FLOW (m ³ /s)
6-Hour SCS Storm		
2 Year	0.040	0.011
5 Year	0.062	0.019
10 Year	0.078	0.024
25 Year	0.100	0.032
50 Year	0.114	0.038
100 Year	0.132	0.044

Note that under the 6-Hour SCS storm the peak flows from the 100 year storm is greater than the existing 2 year storm peak flow. The smallest diameter orifice of 50mm is unable to reduce the stormwater outflow within the limits of the 2-year storm. However, the 100 year storm outflow is less than the capacity of the 300mm diameter storm sewer on Dow Avenue.

The functional layout of the proposed storm system is shown in Appendix A. The preliminary SWM calculations and MIDUSS modelling are included in Appendix B. Refer to the Functional Site Grading and Servicing Plan in Appendix A for further details on stormwater servicing.

3.5.2 Stormwater Quality Control

The runoff from the proposed development is from rooftop and small pedestrian areas, with no runoff from surface vehicular parking areas. Accordingly, stormwater quality is not impacted by vehicles and thus stormwater quality measures are not needed for the site.

3.6 Proposed Utilities

Considering the adjacent developed areas, it is reasonable to assume there are existing hydro, gas, and telecommunication services in the vicinity of the site which can be extended to the development to provide service. Servicing of the development by the various utilities will be provided by the extension of these facilities. It is anticipated that each of these utilities will, as required, identify their specific requirements through the standard application circulation, review and design process.

4 Erosion and Sediment Control

During construction, erosion and sediment control measures will be required, and will include:

- Silt fence erected around site perimeter before any work begins on the site to protect adjacent areas from migration of sediment in overland flow.
- A “mud mat” installed at the construction entrance(s) to the site to minimize the amount of sediment transported off site via construction vehicles; and,
- Stabilization of all disturbed areas as quickly as possible to minimize erosion.

5 Summary

This Functional Servicing Report outlines the proposed site grading and municipal servicing design for the proposed development at 1107 Main Street West, Hamilton, Ontario. It demonstrates that the development is feasible and can be designed and constructed in accordance with municipal standards.

The following summarizes the components of the design:

- The site grading will achieve gentle gradients between 0.5% to 5% for all vehicular and pedestrian areas, with the exception of the parking garage ramp which will have a maximum slope of 15%. Landscaped areas will have gradients between 2% and 33%;
- Stormwater quantity control will utilize rooftop storage and a stormwater storage tank of 272 m³ with an orifice of 50mm diameter to attenuate the 100 year peak flow to as close as possible to the 2 year peak flow.
- Stormwater quality control is not required as all surface stormwater from the site is from rooftop or pedestrian areas, and not vehicular areas;
- The existing 375mm diameter municipal combined sewer infrastructure on Dow Avenue will provide sanitary service to the site;
- The existing 300mm diameter watermain on Main Street West will provide potable water and fire protection for the site; and,
- The existing fire hydrants on Dow Avenue and Cline Avenue South will be maintained with the proposed development.

We trust the foregoing is satisfactory to support the development application. Should there be any questions or if further information is required, please do not hesitate to contact the undersigned.

All of which is respectfully submitted.

Yours truly


IBI GROUP



John Perks, MBA, P.Eng.
Associate Director




Tiffany Chan, P.Eng.
Project Engineer

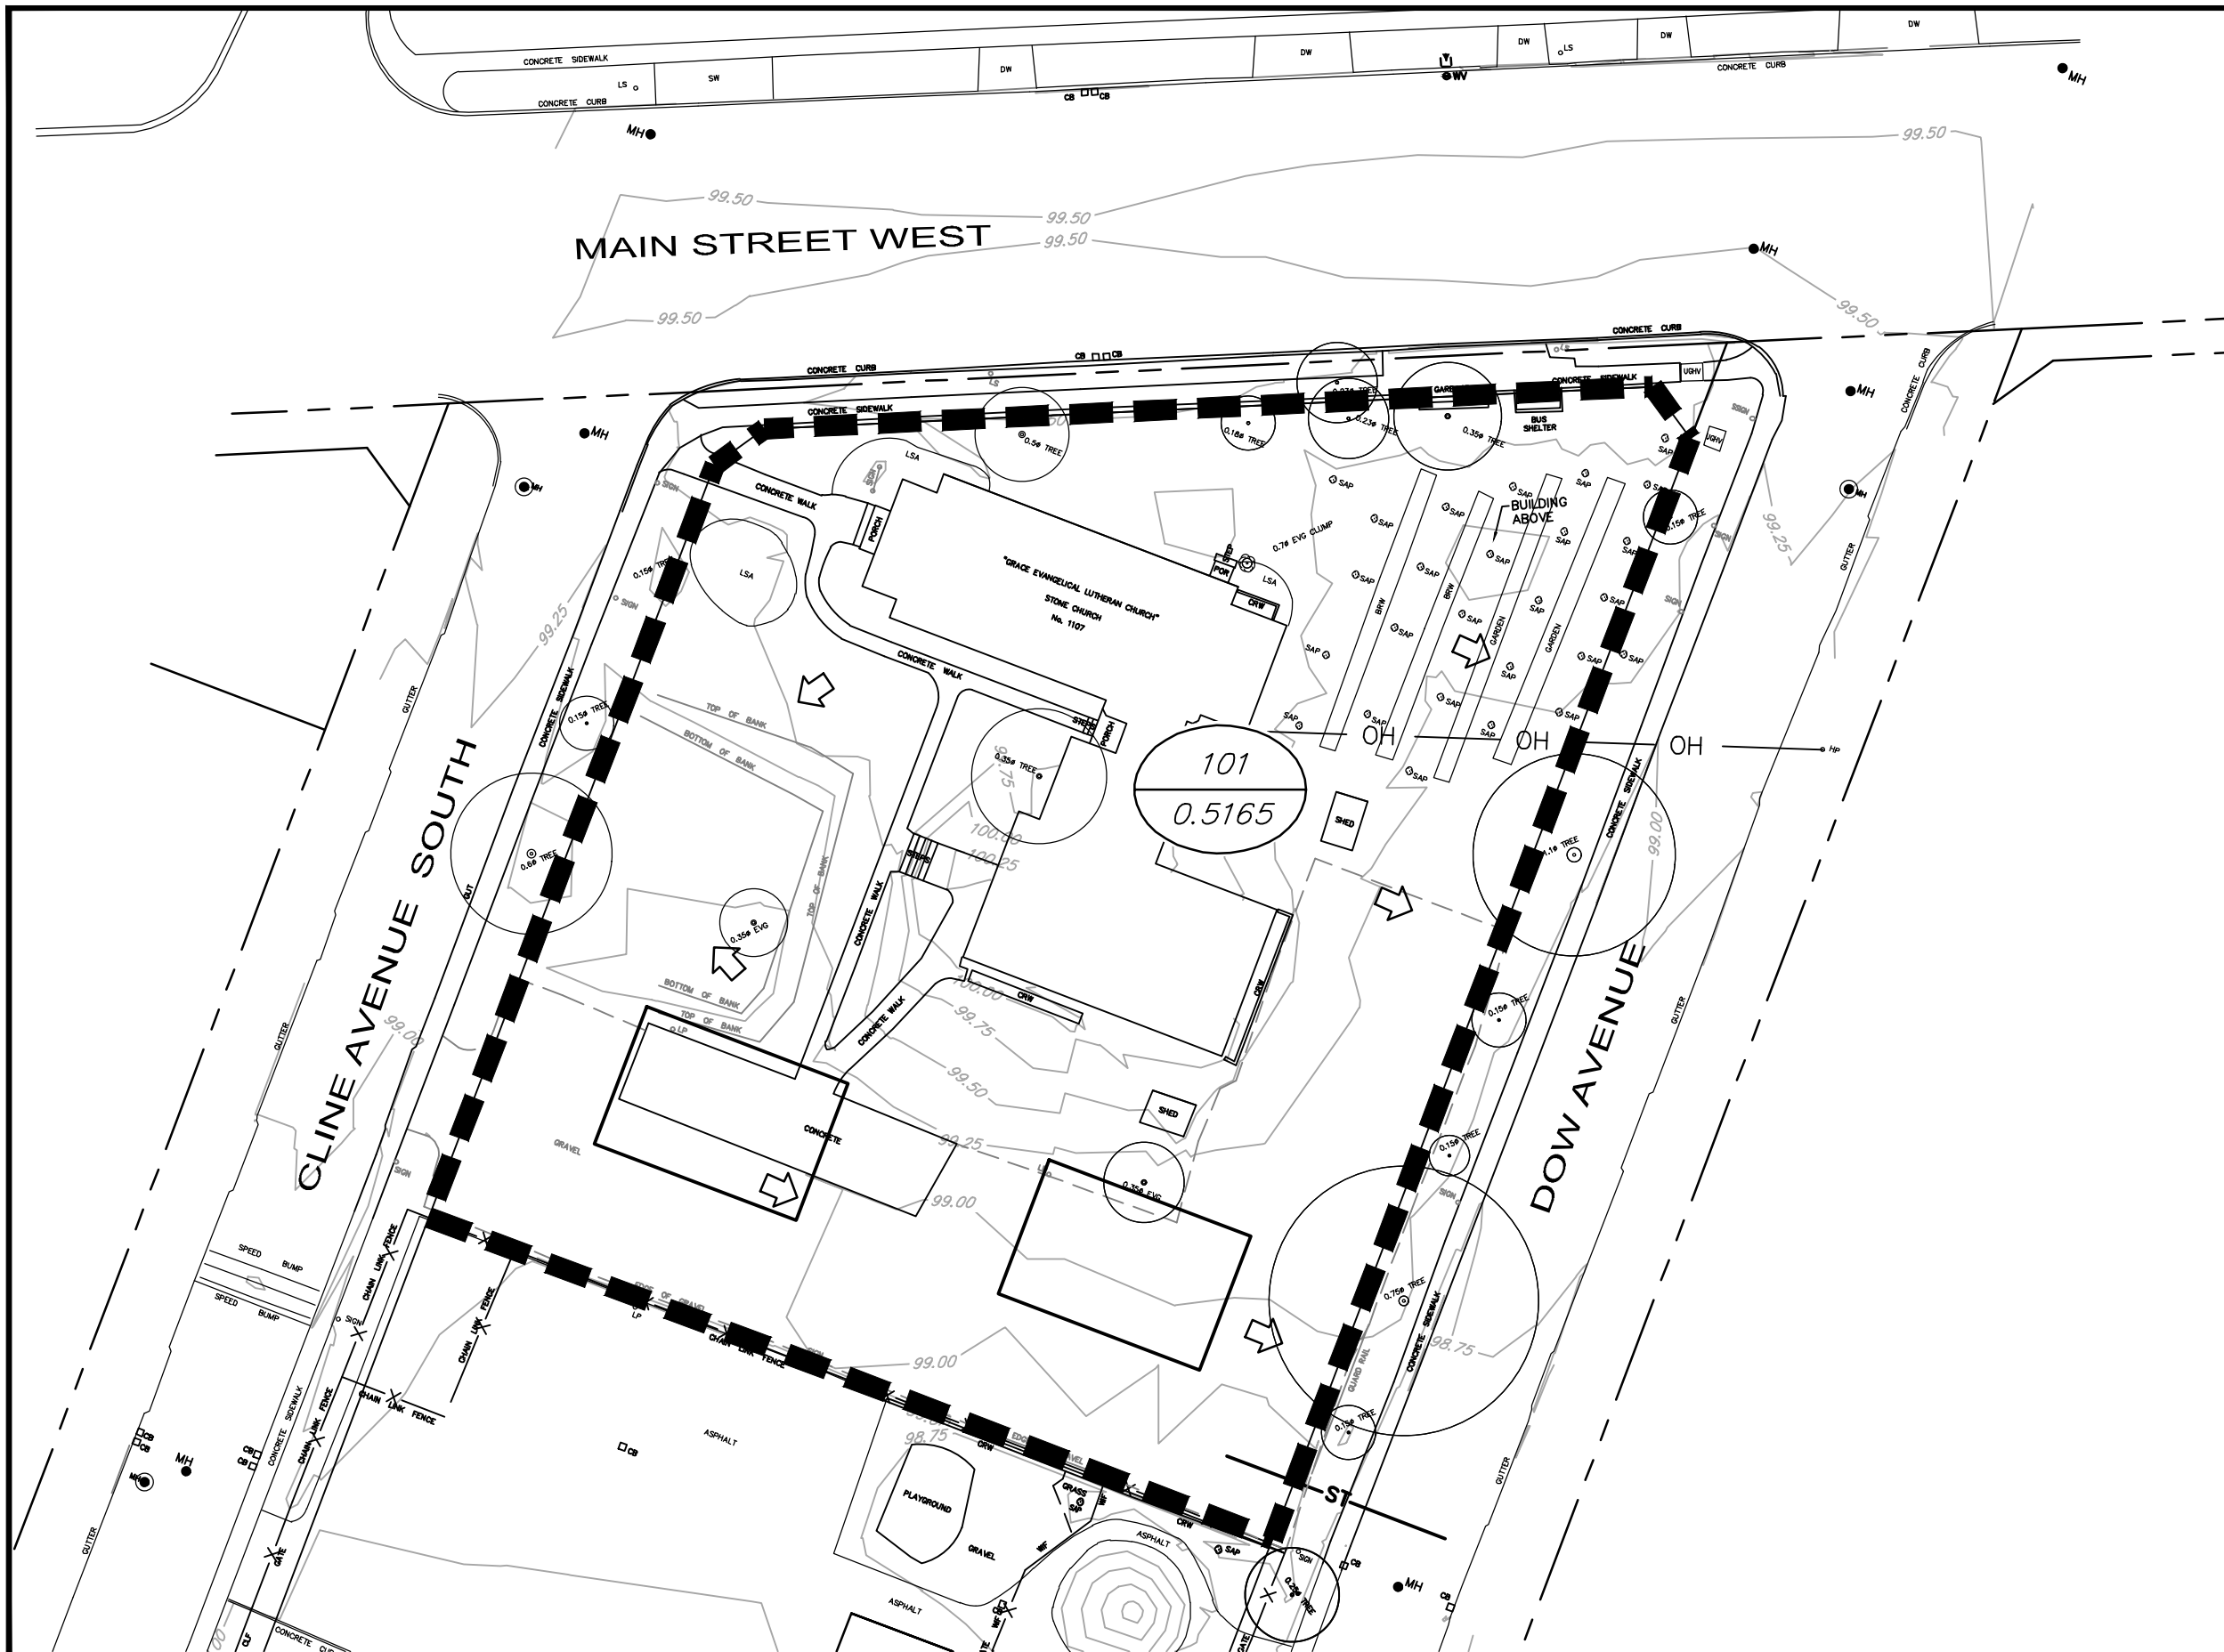

LEGEND

- EXISTING CATCHMENT BOUNDARIES
- EX. CATCHMENT SYMBOL
CATCHMENT AREA NUMBER
AREA (ha)
- EXISTING OVERLAND FLOW ROUTE

SITE AREA = 5165 sq.m.
EX. IMPERVIOUS = 2575 sq.m.

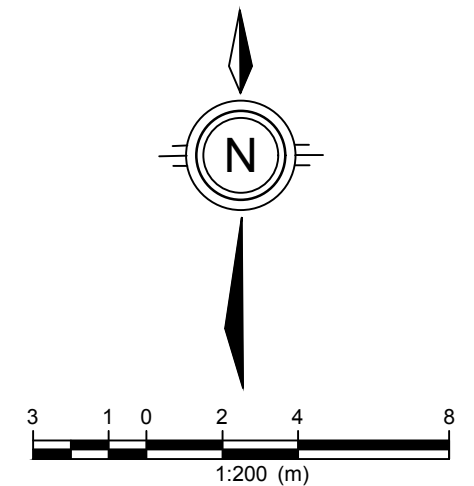


IBI GROUP
101 - 410 Albert Street
Waterloo ON N2L 3V3 Canada
tel 519 585 2255 fax 519 585 2269
ibigroup.com

SCALE 1:200
DATE NOVEMBER 2020
PROJECT No. 122727

1107 MAIN STREET WEST
HAMILTON, ONTARIO

EXISTING CONDITIONS
SWM PLAN

FIGURE 1

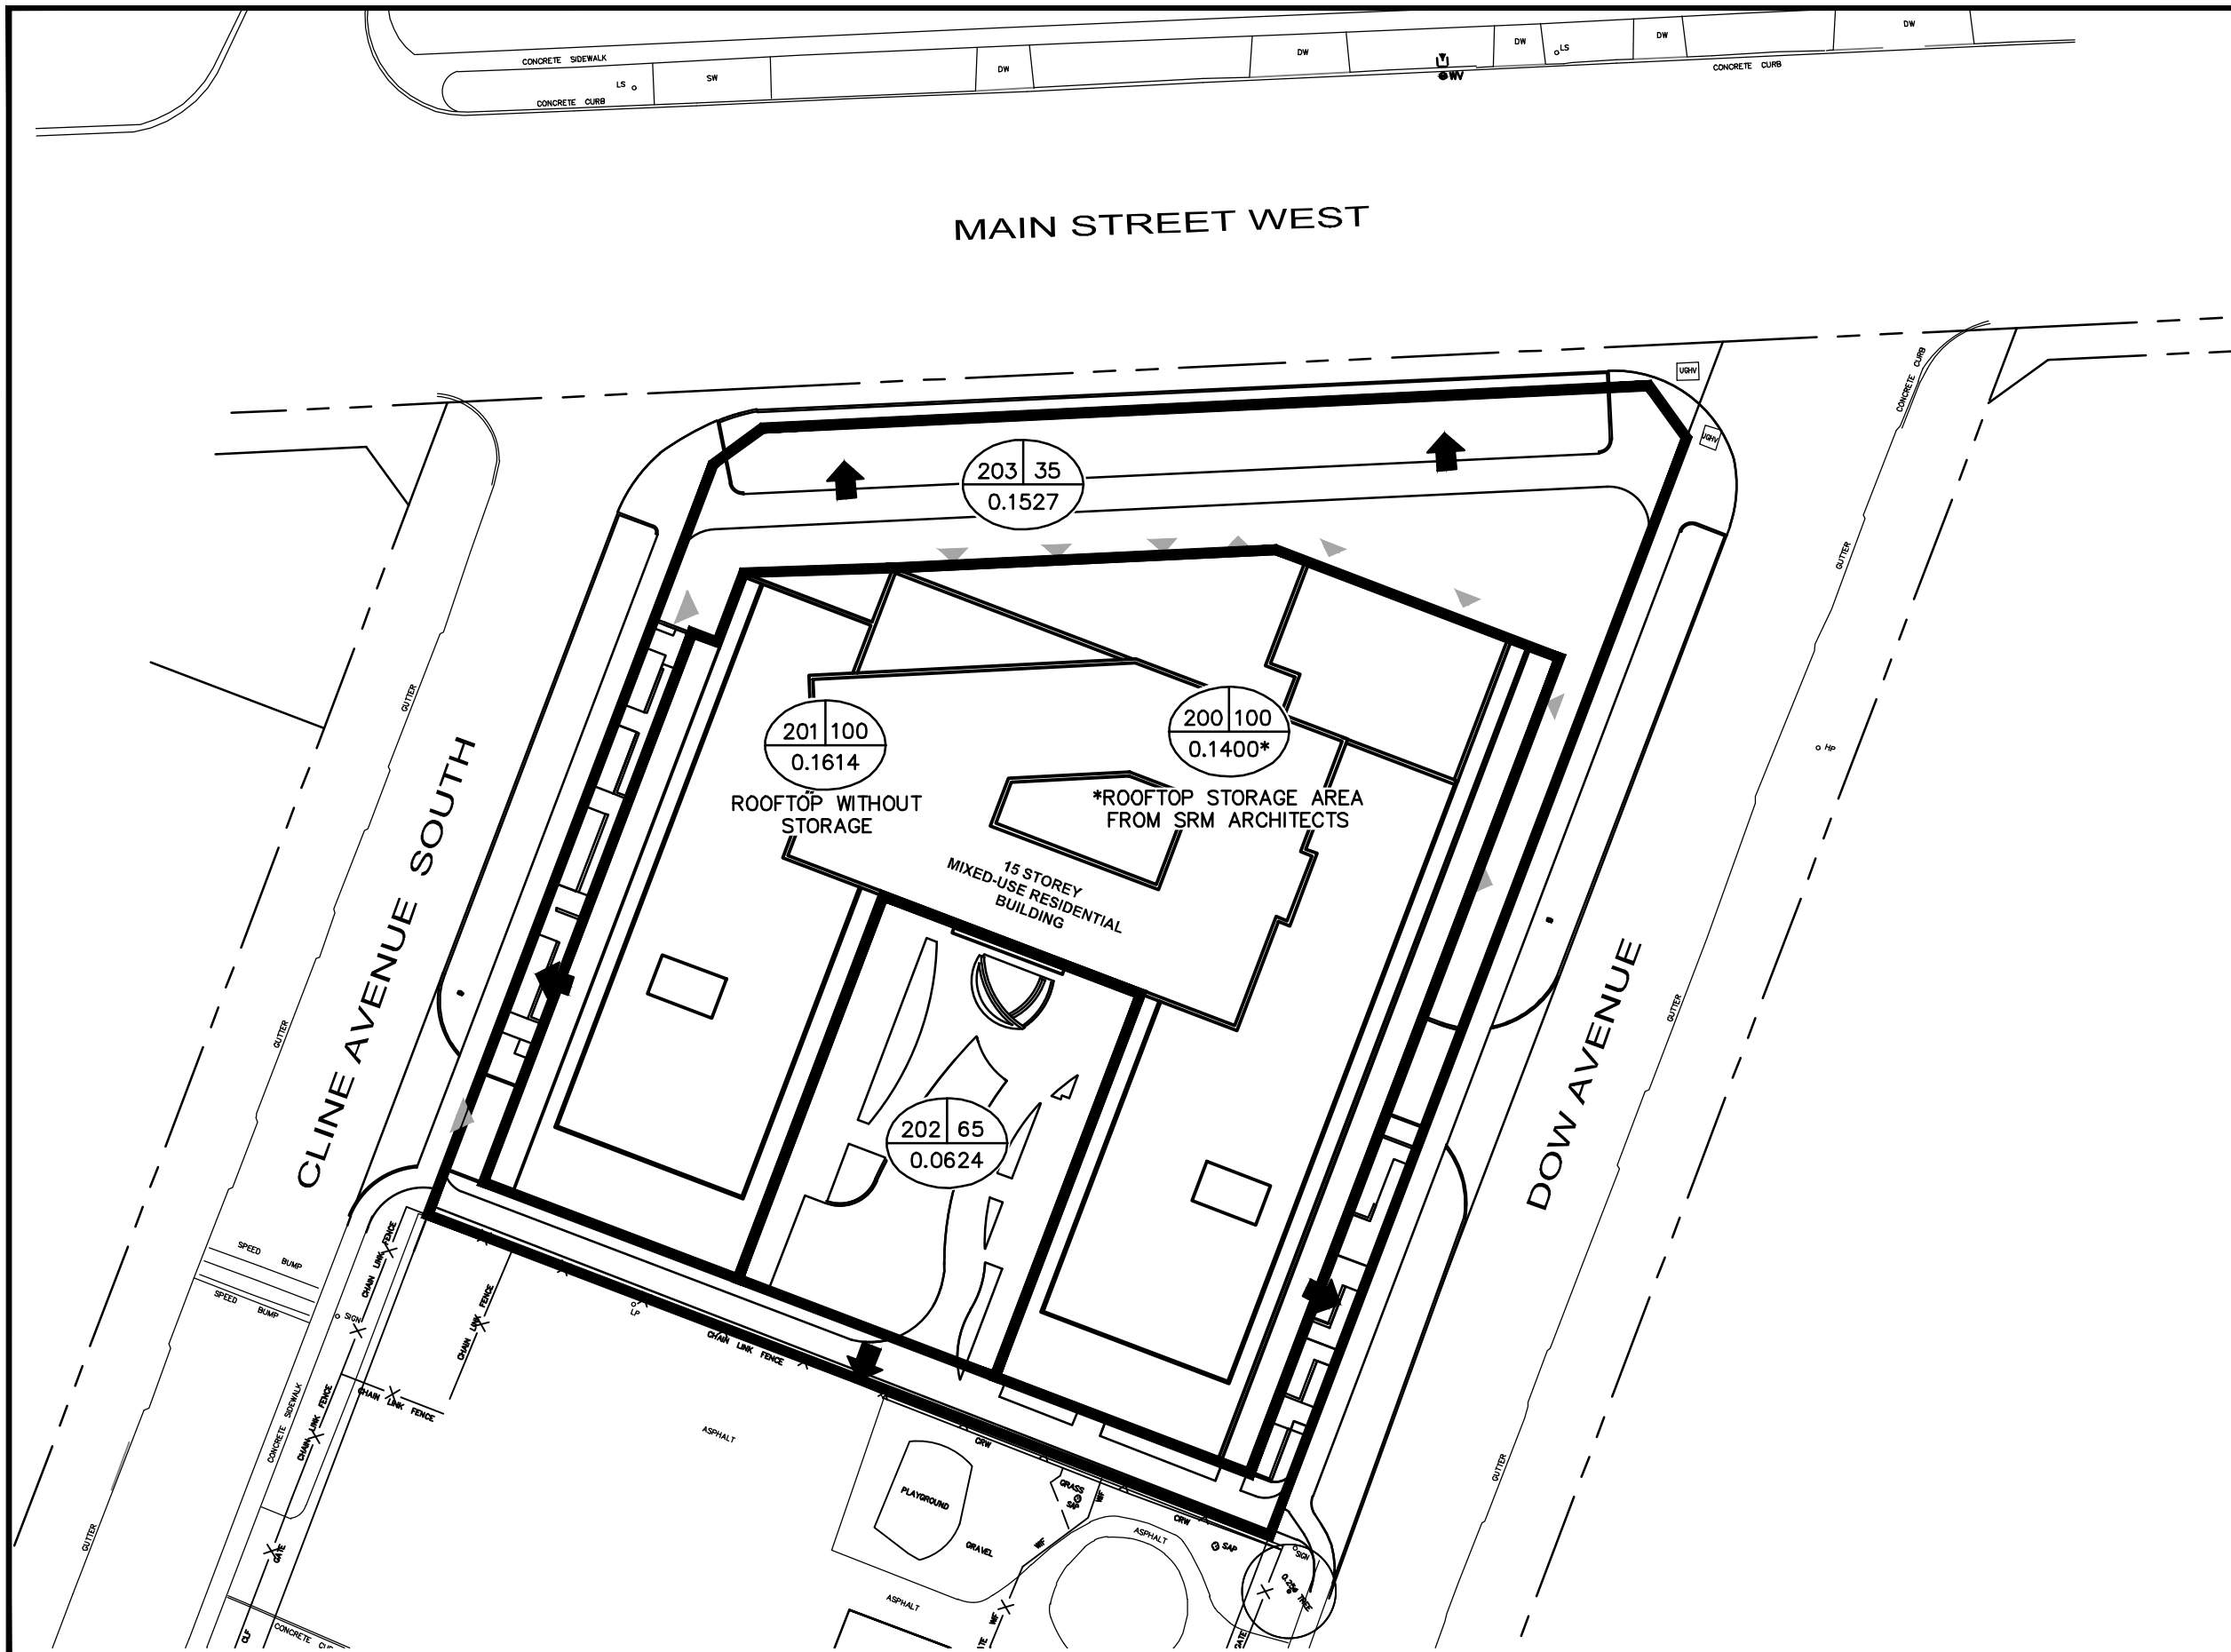


LEGEND

PROPOSED CATCHMENT
BOUNDARIES

CATCHMENT AREA
NUMBER
202 100
0.90
PERCENT IMPERVIOUS
AREA (ha)

PROPOSED OVERLAND FLOW

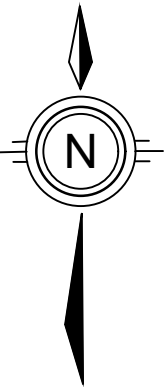

3 1 0 2 4 8
1:200 (m)



IBI GROUP
101 - 410 Albert Street
Waterloo ON N2L 3V3 Canada
tel 519 585 2255 fax 519 585 2269
ibigroup.com

SCALE 1:200
DATE MAY 2021
PROJECT No. 122727

1107 MAIN STREET WEST
HAMILTON, ONTARIO


PROPOSED
SWM PLAN

FIGURE 2

APPENDIX A:



Drawings

FILE:J:\12227_1107MainStW7.0_Production\7.3_Design\04_Civil\Sheets\122727_ESC_LAYOUT.ESC CTB: AIA_Standard.ctb SAVED BY:Patrick.Cloutier, 2020-Nov-11 2:44 PM

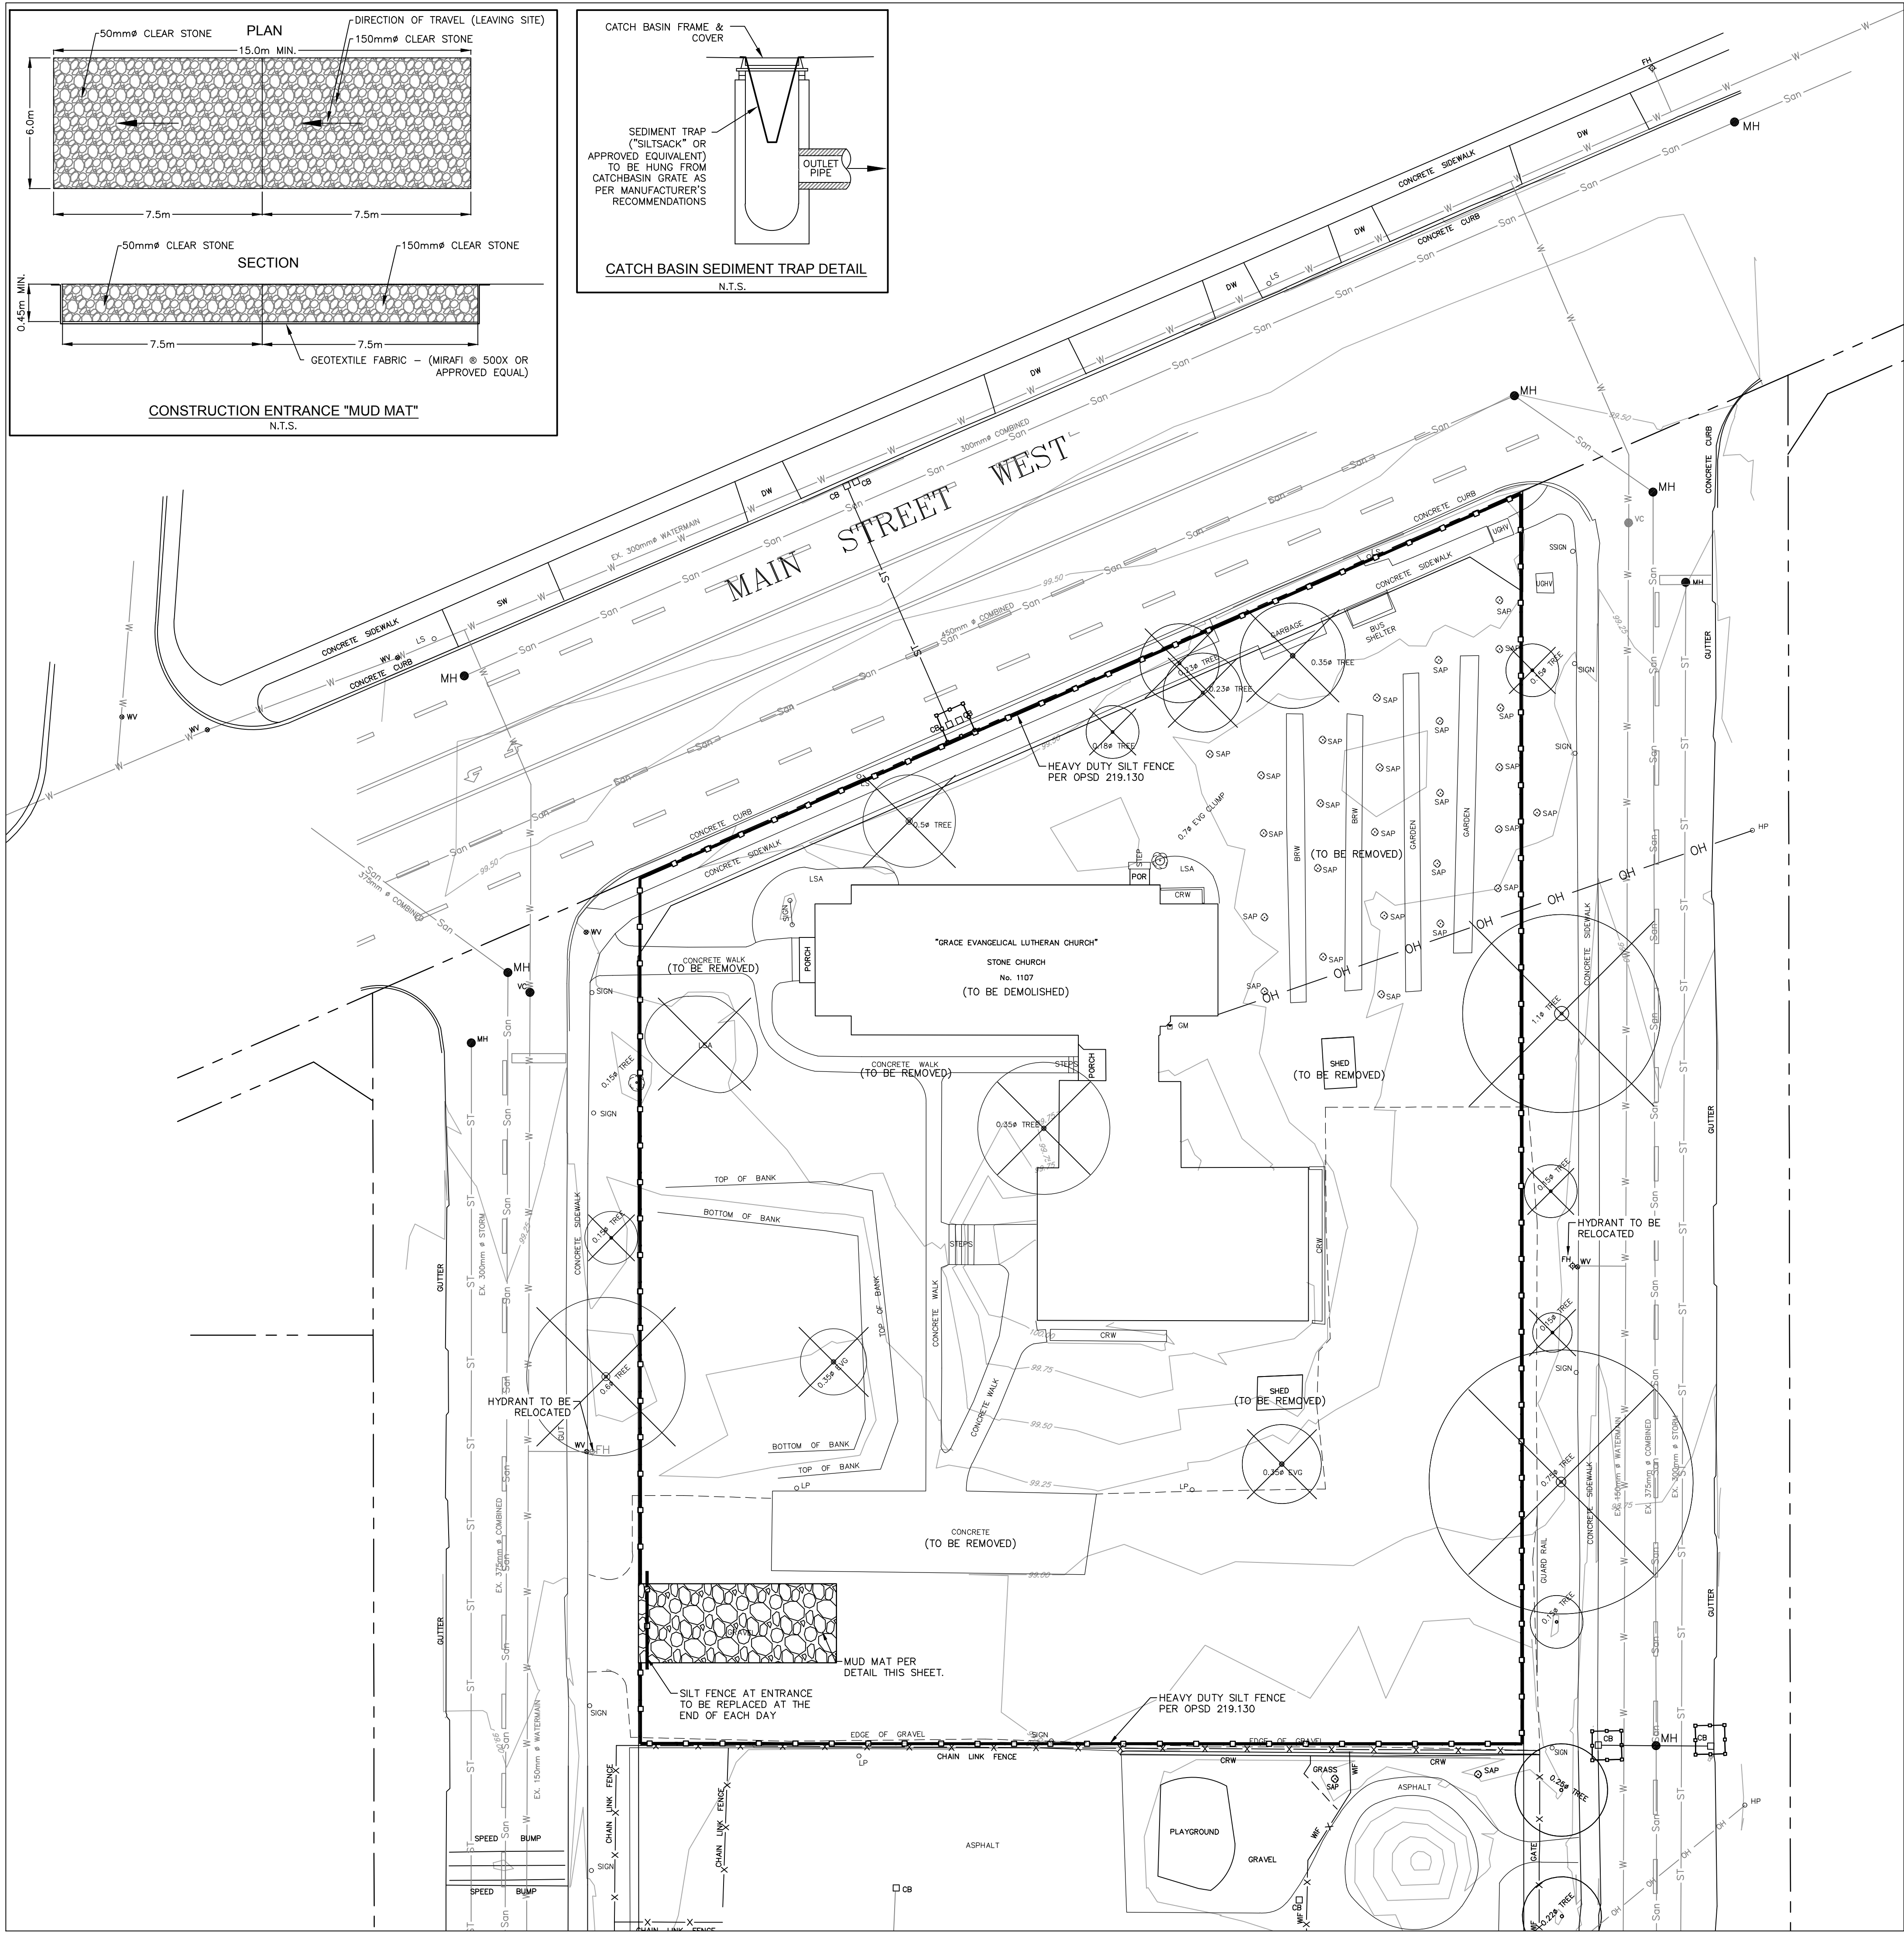

EROSION AND SEDIMENT CONTROL NOTES

- ALL EROSION AND SEDIMENT CONTROL MEASURES (TEMPORARY SEDIMENT CONTROL FENCES, STORM SEWER BULKHEADS, ROCK CHECK DAMS, WORK LIMIT FENCES, SEDIMENT BASINS, ETC.) MUST BE INSTALLED PRIOR TO COMMENCEMENT OF CONSTRUCTION.
- TEMPORARY VEHICLE TRACKING CONTROLS TO BE CONSTRUCTED AS PER REQUIREMENTS IN "EROSION & SEDIMENT CONTROL GUIDELINE FOR URBAN CONSTRUCTION" DATED DECEMBER 2008, AT ALL ACCESS POINTS. CONTRACTOR SHALL MAINTAIN THESE AS REQUIRED AND AS DIRECTED BY THE CITY ENGINEER.
- OVERLAND SHEET FLOW EROSION PROTECTION SHALL BE AS PER OPSD 219.130. IF EXCESSIVE SEDIMENT BUILDUP/BLOCKAGE OCCURS (VISUAL INSPECTION) THEN REPLACEMENT OF THE FILTER CLOTH IS REQUIRED.
- CATCH BASIN SEDIMENT CONTROL DEVICE, I.E. "SILTSACK" BY ACF ENVIRONMENT OR APPROVED EQUIVALENT, TO BE PLACED AS PER MANUFACTURER'S RECOMMENDATIONS (SEE DETAIL "B"). REGULAR MAINTENANCE IS REQUIRED ("SILTSACK" SUMPS SHALL BE INSPECTED FOR SEDIMENT ACCUMULATION AND FILTER CLOTH BLOCKAGE ON A WEEKLY BASIS). THESE SEDIMENT TRAPS ARE NOT TO BE REMOVED UNTIL THE CURBS AND THE BOULEVARDS SODDED. SEDIMENT TRAPS SHALL ALSO BE PLACED AS PER DETAIL "A" AT ALL CATCH BASIN LOCATIONS IN AREAS TO BE VEGETATED AND MAINTAINED UNTIL GROUND COVER IS ESTABLISHED.
- REGULAR MAINTENANCE FOR ALL CATCH BASINS (ON THE PUBLIC ROADWAY AND ON PRIVATE PROPERTY) AND INLET CHAMBERS IS REQUIRED (SEDIMENT TRAPS AND SUMPS SHALL BE INSPECTED FOR SEDIMENT ACCUMULATION, TRASH BUILDUP AND FILTER CLOTH BLOCKAGE ON A WEEKLY BASIS AND AFTER ANY MAJOR RAINFALL EVENT). ACCUMULATED SEDIMENT SHALL BE REMOVED BY MECHANICAL MEANS. FLUSHING OF SEDIMENT INTO THE STORM SEWER SYSTEM IS PROHIBITED. IF STANDING WATER REMAINS IN THE CATCH BASIN 24 HOURS (MINIMUM) AFTER A STORM THEN CLEANING OR REPLACEMENT OF THE FILTER CLOTH IS REQUIRED.
- TOPSOIL PILES SHALL ALSO BE TEMPORARILY SEEDED TO PREVENT EROSION. PLACEMENT OF VEGETATION SHALL BE IN ACCORDANCE WITH OPSD 572. WHERE REQUIRED, EROSION CONTROL BLANKETS SHALL BE PLACED AS PER OPSD 572, AT THE DIRECTION OF THE CITY ENGINEER.
- ALL EROSION AND SEDIMENT CONTROL MEASURES SHALL BE VISUALLY INSPECTED AFTER EACH WORKING DAY AND MAINTAINED WHEN REQUIRED AS DIRECTED BY THE CONSULTANT AND TO THE SATISFACTION OF THE CITY/CONSERVATION AUTHORITY. THE CONSULTANT SHALL KEEP A DAILY RECORD OF INSPECTION, MAINTENANCE, ETC. AND PRESENT THE CITY WITH A COPY OF THE REPORT ON A MONTHLY BASIS.
- ANY DISTURBED AREAS NOT SCHEDULED FOR FURTHER CONSTRUCTION WITHIN 45 DAYS WILL BE PROVIDED WITH A SUITABLE TEMPORARY MULCH AND SEED COVER WITHIN 7 DAYS OF THE COMPLETION OF THAT PARTICULAR PHASE OF CONSTRUCTION.
- ALL DISTURBED EXTERNAL AREAS SHALL BE REVEGETATED WITH PERMANENT COVER (AS DETAILED) WITHIN 7 DAYS OF THE COMPLETION OF THAT PARTICULAR PHASE OF CONSTRUCTION.
- ADDITIONAL EROSION AND SEDIMENT CONTROL LOCATIONS/MEASURES MAY BE REQUIRED AS DETERMINED BY THE CITY/CONSERVATION AUTHORITY.
- THE OWNER IS RESPONSIBLE FOR THE REMOVAL OF ALL MUD AND DEBRIS THAT ARE TRACKED ONTO THE ROADWAYS FROM VEHICLES ENTERING OR LEAVING THE CONSTRUCTION SITE. THE OWNER SHALL, UPON VERBAL AND/OR WRITTEN REQUEST BY THE CITY, IMMEDIATELY PROCEED WITH CLEAN-UP OPERATIONS AT THEIR EXPENSE. SHOULD THE OWNER FAIL TO MAINTAIN THE ROADS DIRECTED, THE CITY WILL HAVE THE CLEANING CARRIED OUT, AND DRAW ON THE OWNER'S SECURITY FOR COSTS AND/OR LAY CHARGES.

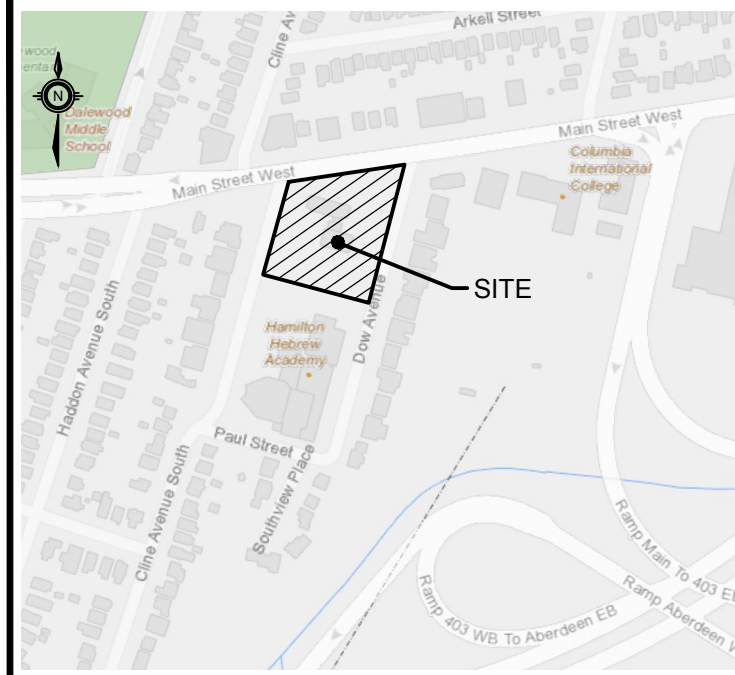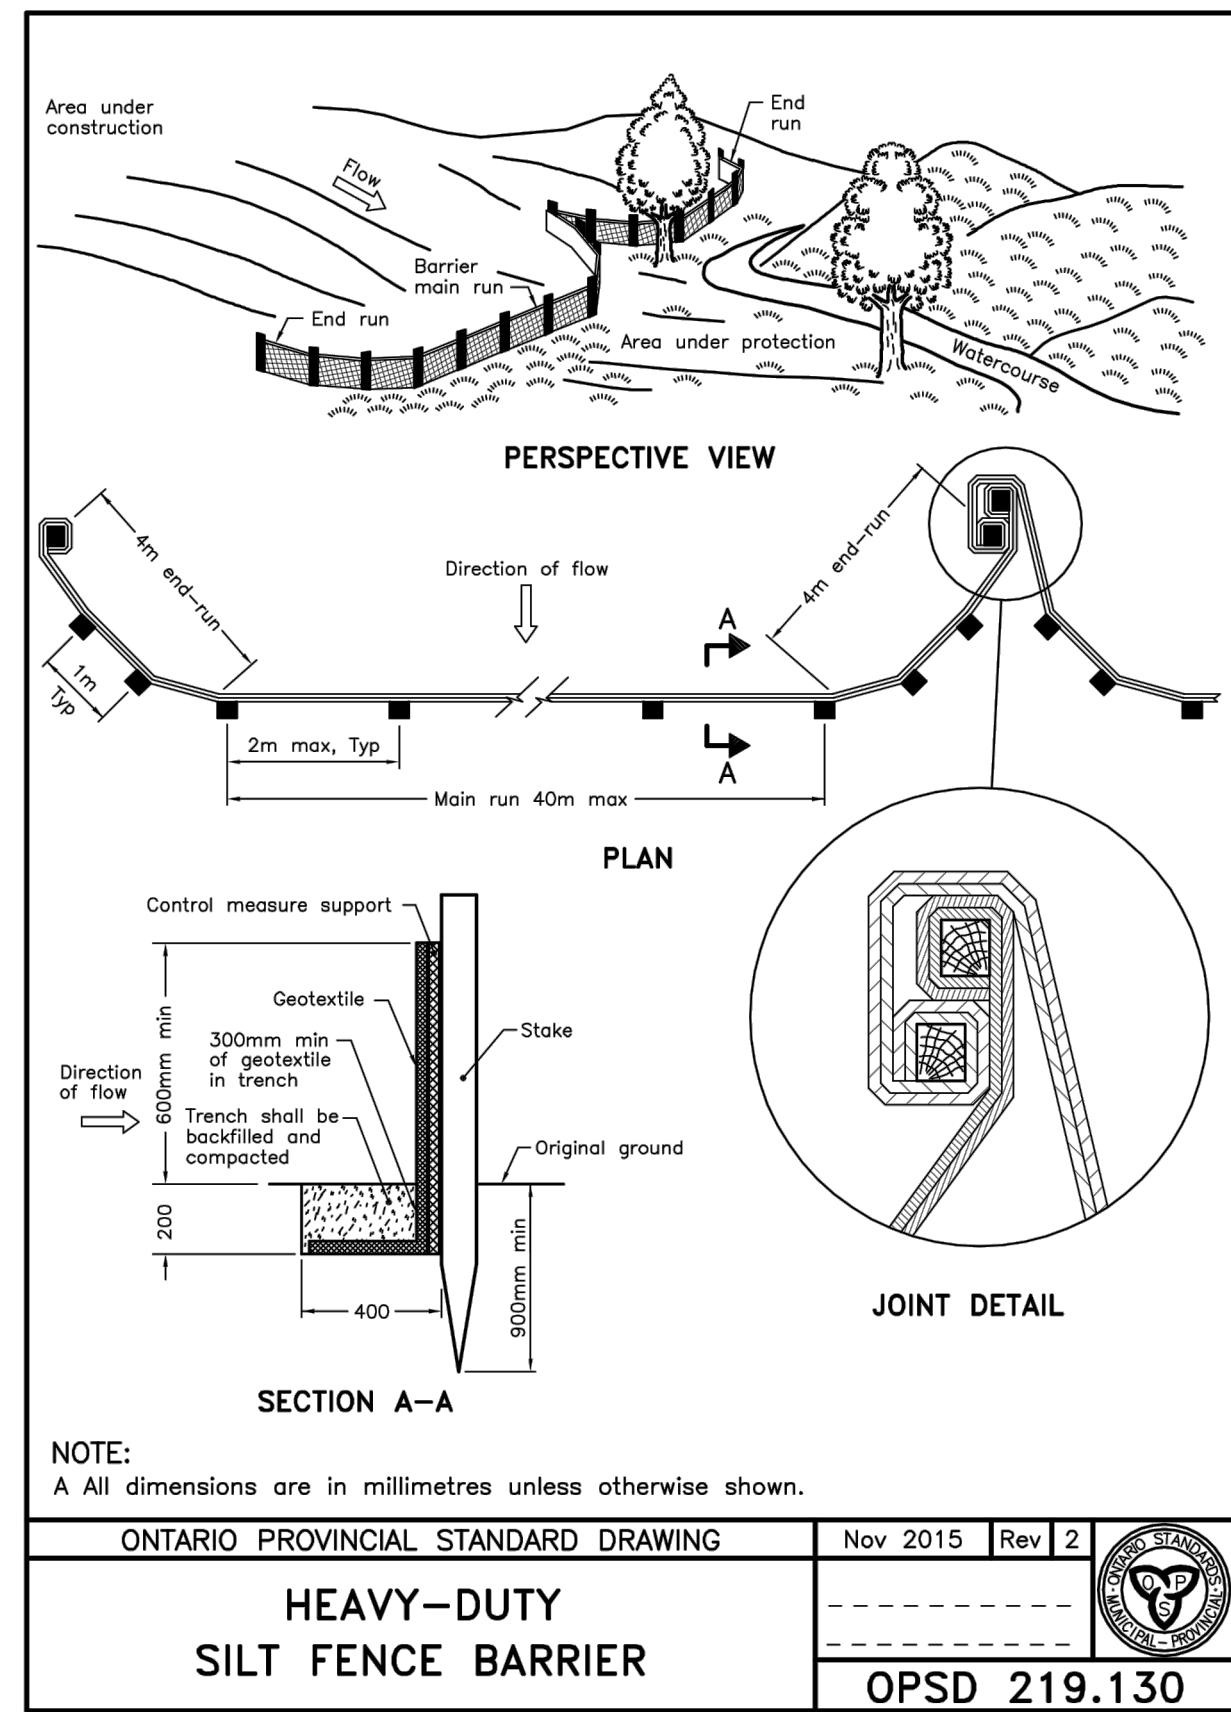

KEY MAP - N.T.S.

LEGEND	
---	PROPERTY LINE
- - -	LOT/EASEMENT LINE
SAN	EXISTING COMBINED SEWER
WM	EXISTING WATERMAIN
STM	EXISTING STM SEWER
OH	EXISTING OVERHEAD HYDRO
○ MH	EXISTING MANHOLE
□ CB	EXISTING CATCH BASIN
⊙ HYD	EXISTING HYDRANT
⊙ WV	EXISTING WATER VALVE
○ 0.2 DIA	EXISTING TREE
● BH	EXISTING BOREHOLE
- - -	EXISTING CONTOURS
—○—	HEAVY DUTY SILT FENCE PER OPSD 219.130
□	CATCH BASIN SEDIMENT TRAP PER DETAIL THIS SHEET
✕	TO BE REMOVED

NOT FOR TENDER

31	2021.05.18	PC	ISSUED FOR ZBA THIRD SUBMISSION
2	2020.11.10	PC	ISSUED FOR ZBA SECOND SUBMISSION
1	2019.10.31	PC	ISSUED FOR ZBA
#	DATE	BY	DESCRIPTION

APPROVALS

IBI GROUP
101 - 410 Albert Street
Waterloo ON N2L 3V3 Canada
tel 519 585 2255
ibigroup.com


CITY OF HAMILTON

1107 MAIN STREET WEST

MIXED-USE RESIDENTIAL BUILDING


EXISTING CONDITIONS AND EROSION AND SEDIMENT CONTROL PLAN

DESIGNED BY:	P. CLOUTIER	SCALE HORIZ:	1:250
DRAWN BY:	J. PERKS	SCALE VERT:	NA
CHECKED BY:		FILE NUMBER:	122727
DATE:	2019-10-31	SHEET NUMBER:	ESC

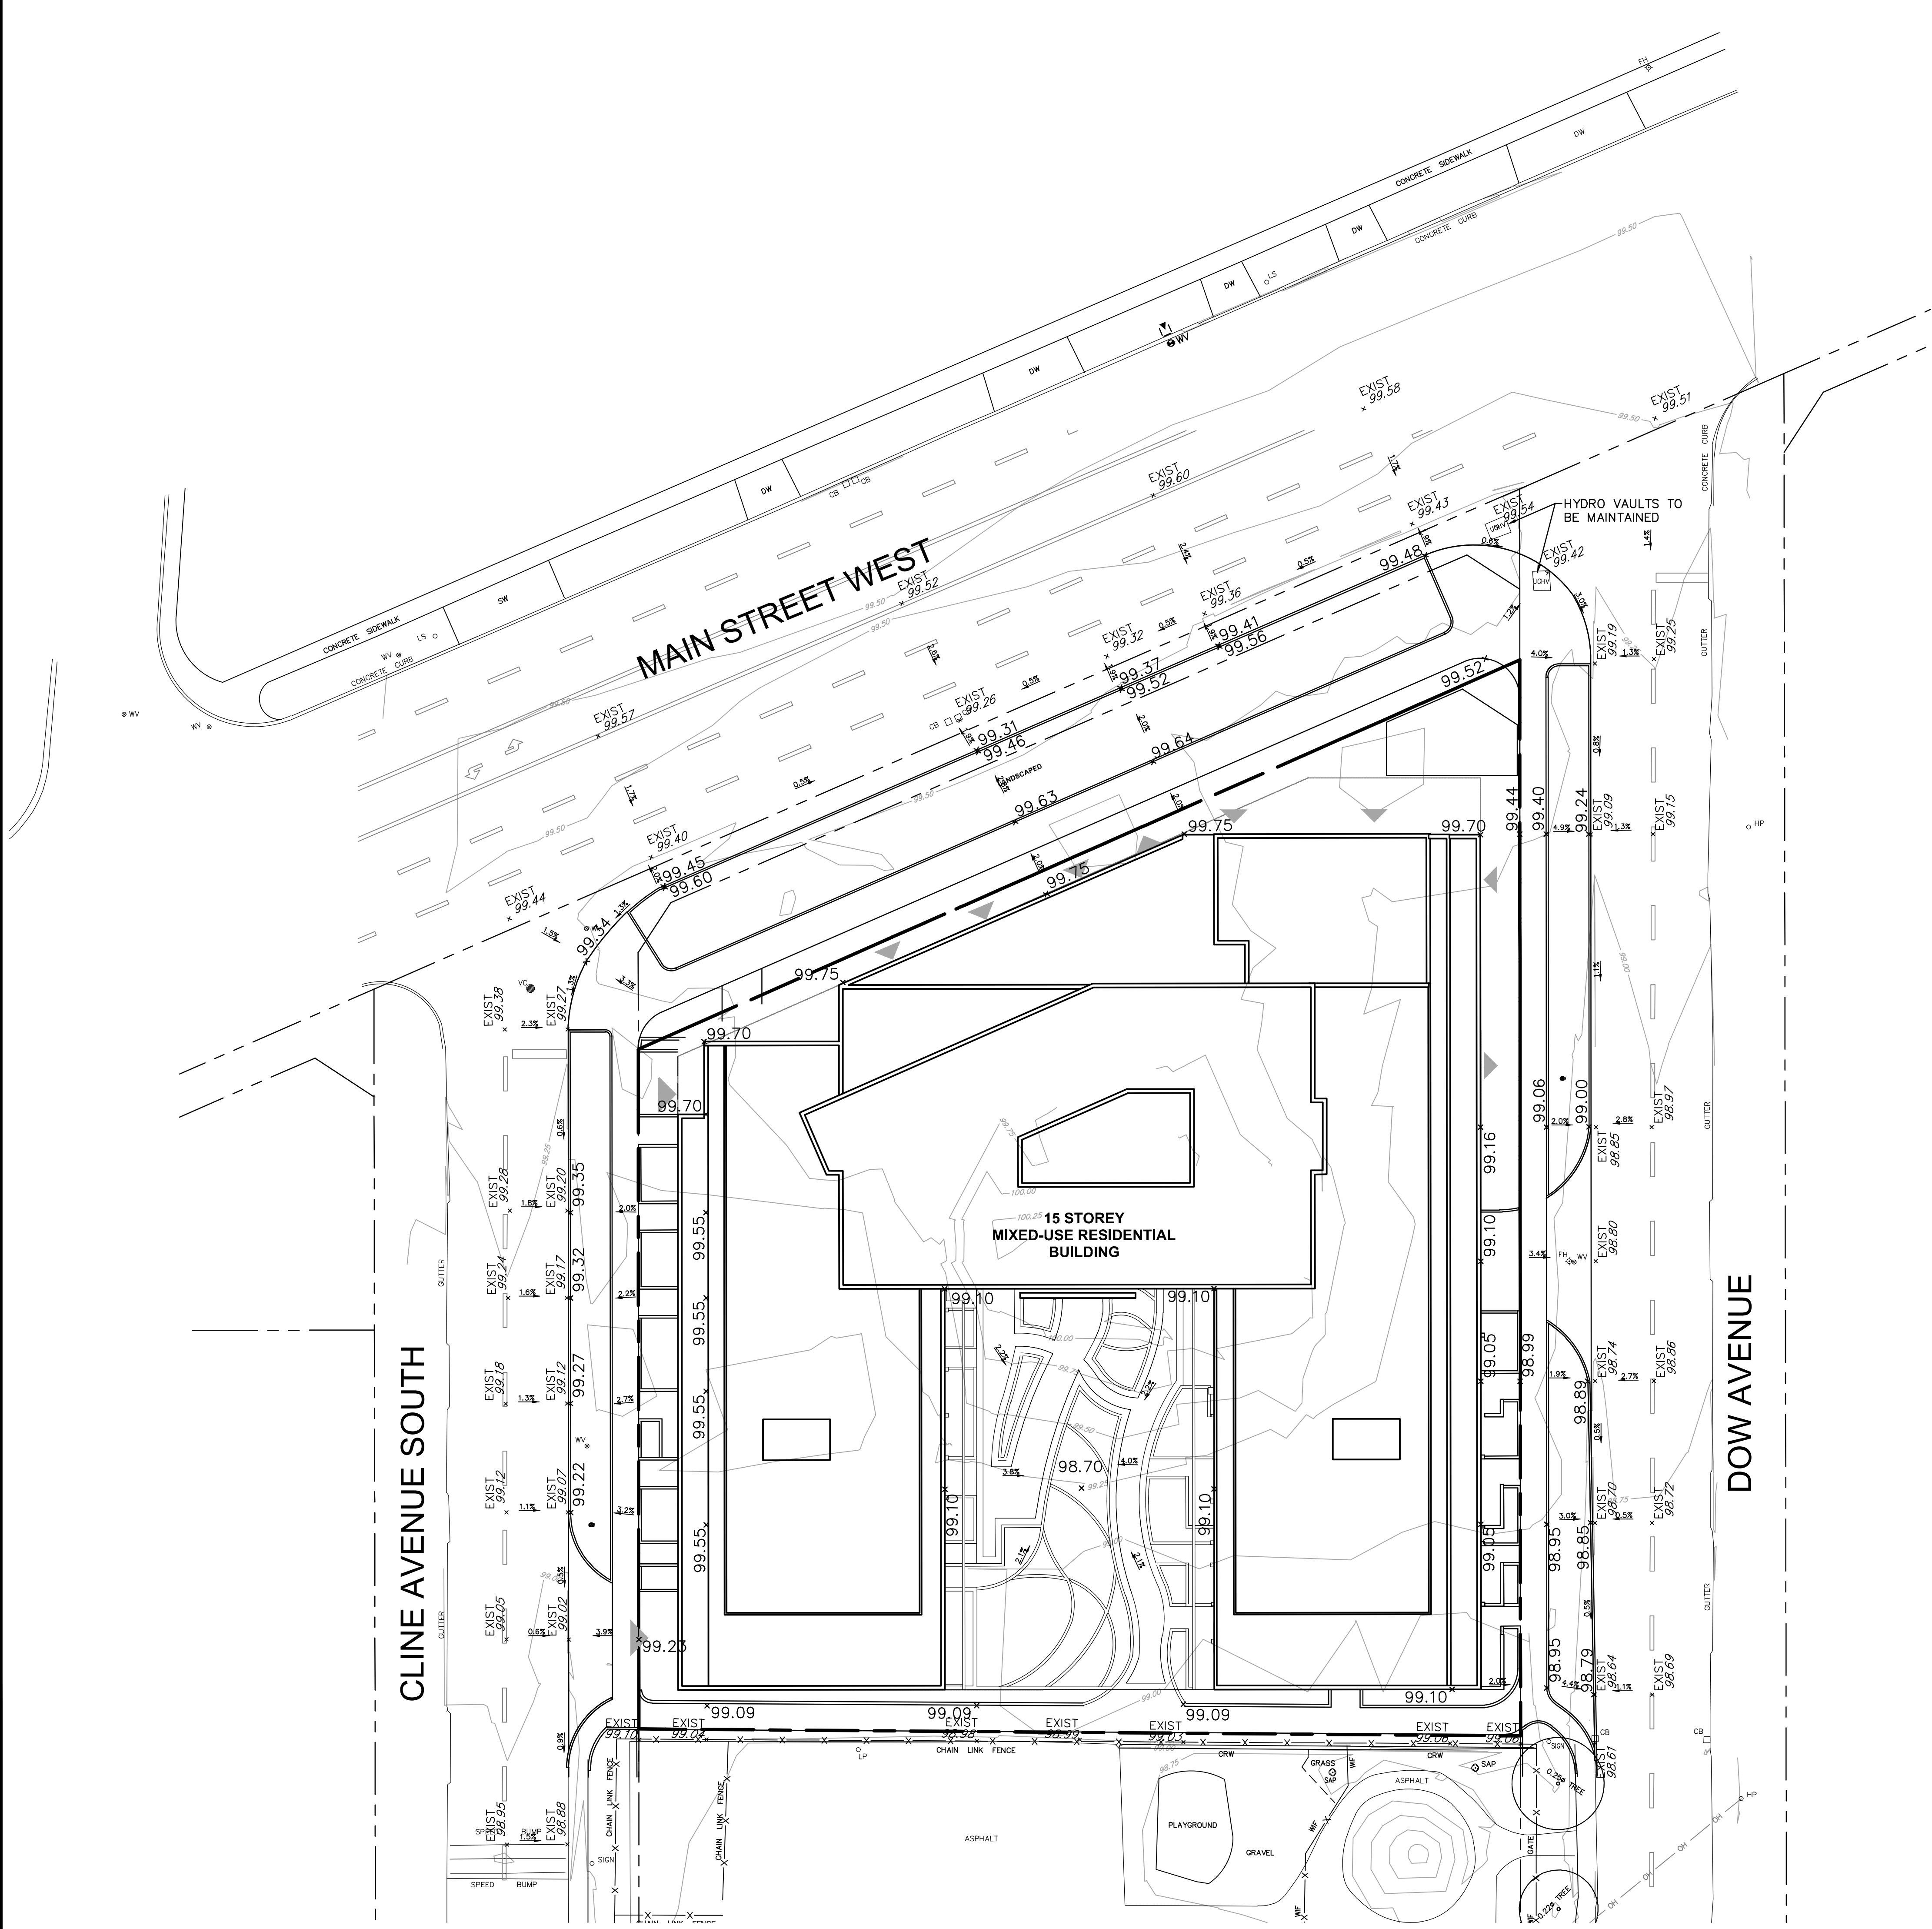

GENERAL GRADING NOTES

- 1) ALONG ADJOINING PROPERTIES GRADE TO MEET EXISTING ELEVATIONS WITH SODDED SLOPES (MIN. 3H TO 1V) AND/OR RETAINING WALLS AS SPECIFIED.
- 2) ALL RETAINING WALLS, WALKWAYS, CURBS, ETC. SHALL BE PLACED A MIN. OF 0.45m OFF THE PROPERTY LINE. ALL WALLS 1.0m OR HIGHER SHALL BE DESIGNED BY A P.ENG.
- 3) SHOULD A RETAINING WALL BE REQUIRED, THE TOP OF WALL ELEVATIONS SHALL BE SET 150mm ABOVE THE SIDE YARDS SWALES.
- 4) RETAINING WALLS 0.6m IN HEIGHT OR GREATER REQUIRE CONSTRUCTION OF A FENCE OR GUARD RAIL AT THE TOP OF THE REAR OF THE WALL. GUARDS FOR RETAINING WALLS SHALL BE DESIGNED AND CONSTRUCTED IN ACCORDANCE WITH THE REQUIREMENTS OF EXTERIOR GUARDS AS CONTAINED IN THE ONTARIO BUILDING CODE.
- 5) SLOPES OF SWALES FOR BOTH "BACK TO FRONT" AND "SPLIT" DRAINAGE SHALL BE NO LESS THAN 2.0% GRADE AND NO GREATER THAN 33% GRADE (3:1 SLOPES).
- 6) WHEN MATCHING TO EXISTING PROPERTIES WHERE A 2.0% GRADE CANNOT BE ACHIEVED, A 1.5% GRADE IS PERMITTED PROVIDED A 150mm SUB-DRAIN IS INSTALLED BELOW THE BOTTOM OF THE SWALE AND DRAINED TO A SUITABLE OUTLET, (WITH A MINIMUM 0.3 COVER OVER THE SUB-DRAIN), OR OTHER MITIGATION MEASURES.
- 7) UNLESS OTHERWISE NOTED, THE GROUND BETWEEN ELEVATIONS ON SIDE LOTS SHALL BE GRADED AS A STRAIGHT LINE.
- 8) TOP OF FOUNDATION WALLS FOR BUILDINGS SHALL BE 150mm (MIN) ABOVE FINISHED GRADE.
- 9) GARAGE FLOOR ELEVATION TO BE SET MINIMUM 0.3m HIGHER THAN BACK OF WALK, UNLESS OTHERWISE SPECIFIED.
- 10) ALL FILL PLACED ON LOTS SHALL BE COMPACTED TO A MINIMUM 95% SPD (UNLESS OTHERWISE RECOMMENDED BY THE GEOTECHNICAL ENGINEER). ALL MATERIAL SHALL BE PLACED IN LAYERS NOT EXCEEDING 300mm LIFTS.
- 11) IF GRADING IS REQUIRED ON LANDS ADJACENT TO THE DEVELOPMENT WHICH ARE NOT OWNED BY THE DEVELOPER, THEN THE DEVELOPER MUST OBTAIN WRITTEN PERMISSION FROM THE ADJACENT PROPERTY OWNER TO ALLOW THE DEVELOPER TO GRADE ON THE ADJACENT LANDS. OTHERWISE RETAINING WALLS MUST BE USED.
- 12) THE WRITTEN PERMISSION REQUIRED FROM THE ADJACENT LANDOWNER SHALL BE OBTAINED PRIOR TO ENTERING THE LANDS. SHOULD PERMISSION NOT BE OBTAINED OR IS WITHDRAWN PRIOR TO COMMENCING THE WORK, THEN THE DEVELOPER SHALL LIMIT HIS ACTIVITIES TO THE LIMITS OF THE DEVELOPMENT SITE.
- 13) DRIVEWAY AND DRIVEWAY APPROACHES SHALL BE LOCATED SUCH THAT HYDRO VAULTS AND OTHER STREET FURNITURE ARE MIN. OF 1.2m FROM THE PROJECTIONS OF THE OUTSIDE GARAGE WALLS.
- 14) ANY CHANGES IN GRADES AND CATCH BASINS REQUIRE THE APPROVAL OF THE DIRECTOR, DEVELOPMENT DIVISION, PLANNING AND DEVELOPMENT DEPARTMENT.
- 15) ALL DRIVEWAYS FROM PROPERTY LINES FOR THE FIRST 7.5m SHALL BE WITHIN 5% MAXIMUM GRADE, THEREAFTER, ALL DRIVEWAYS SHALL BE WITHIN 10% MAXIMUM GRADE.
- 16) THE APPROVAL OF THIS PLAN DOES NOT EXEMPT THE OWNER'S BONDED CONTRACTOR FROM THE REQUIREMENTS TO OBTAIN THE VARIOUS PERMITS/APPROVALS NORMALLY REQUIRED TO COMPLETE A CONSTRUCTION PROJECT, SUCH AS, BUT NOT LIMITED TO THE FOLLOWING:
 - ROAD CUT PERMITS
 - APPROACH APPROVAL PERMITS
 - SEWER PERMITS
 - RELOCATION OF SERVICES
 - ENCROACHMENT AGREEMENTS (IF REQUIRED)

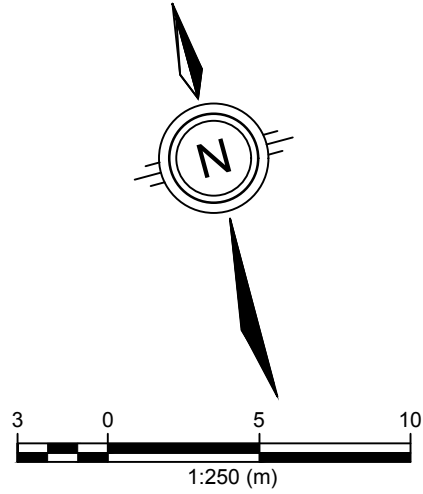

KEY MAP - N.T.S.

- LEGEND
- PROPERTY LINE
 - LOT/EASEMENT LINE
 - EXISTING SPOT ELEVATION
 - PROPOSED SPOT ELEVATION
 - PROPOSED DRAINAGE DIRECTION
 - EXISTING OVERHEAD HYDRO
 - EXISTING MANHOLE
 - EXISTING CATCH BASIN
 - EXISTING HYDRANT
 - EXISTING WATER VALVE
 - EXISTING TREE
 - EXISTING BOREHOLE
 - EXISTING CONTOURS

NOT FOR TENDER

31	2021.05.18	PC	ISSUED FOR ZBA THIRD SUBMISSION
2	2020.11.10	PC	ISSUED FOR ZBA SECOND SUBMISSION
1	2019.11.31	PC	ISSUED FOR ZBA
1	DATE	BY	DESCRIPTION

REVISIONS

APPROVALS


IBI GROUP
101 - 410 Albert Street
Waterloo ON N2L 3V3 Canada
tel 519 585 2255
ibigroup.com

CITY OF
HAMILTON

1107 MAIN STREET WEST
MIXED-USE RESIDENTIAL BUILDING

GRADING PLAN

DESIGNED BY:	P. CLOUTIER	SCALE HORIZ:	1:250
DRAWN BY:	P. CLOUTIER	SCALE VERT:	NA
CHECKED BY:	J. PERKS	FILE NUMBER:	122727
DATE:	2019-10-31	SHEET NUMBER:	GP

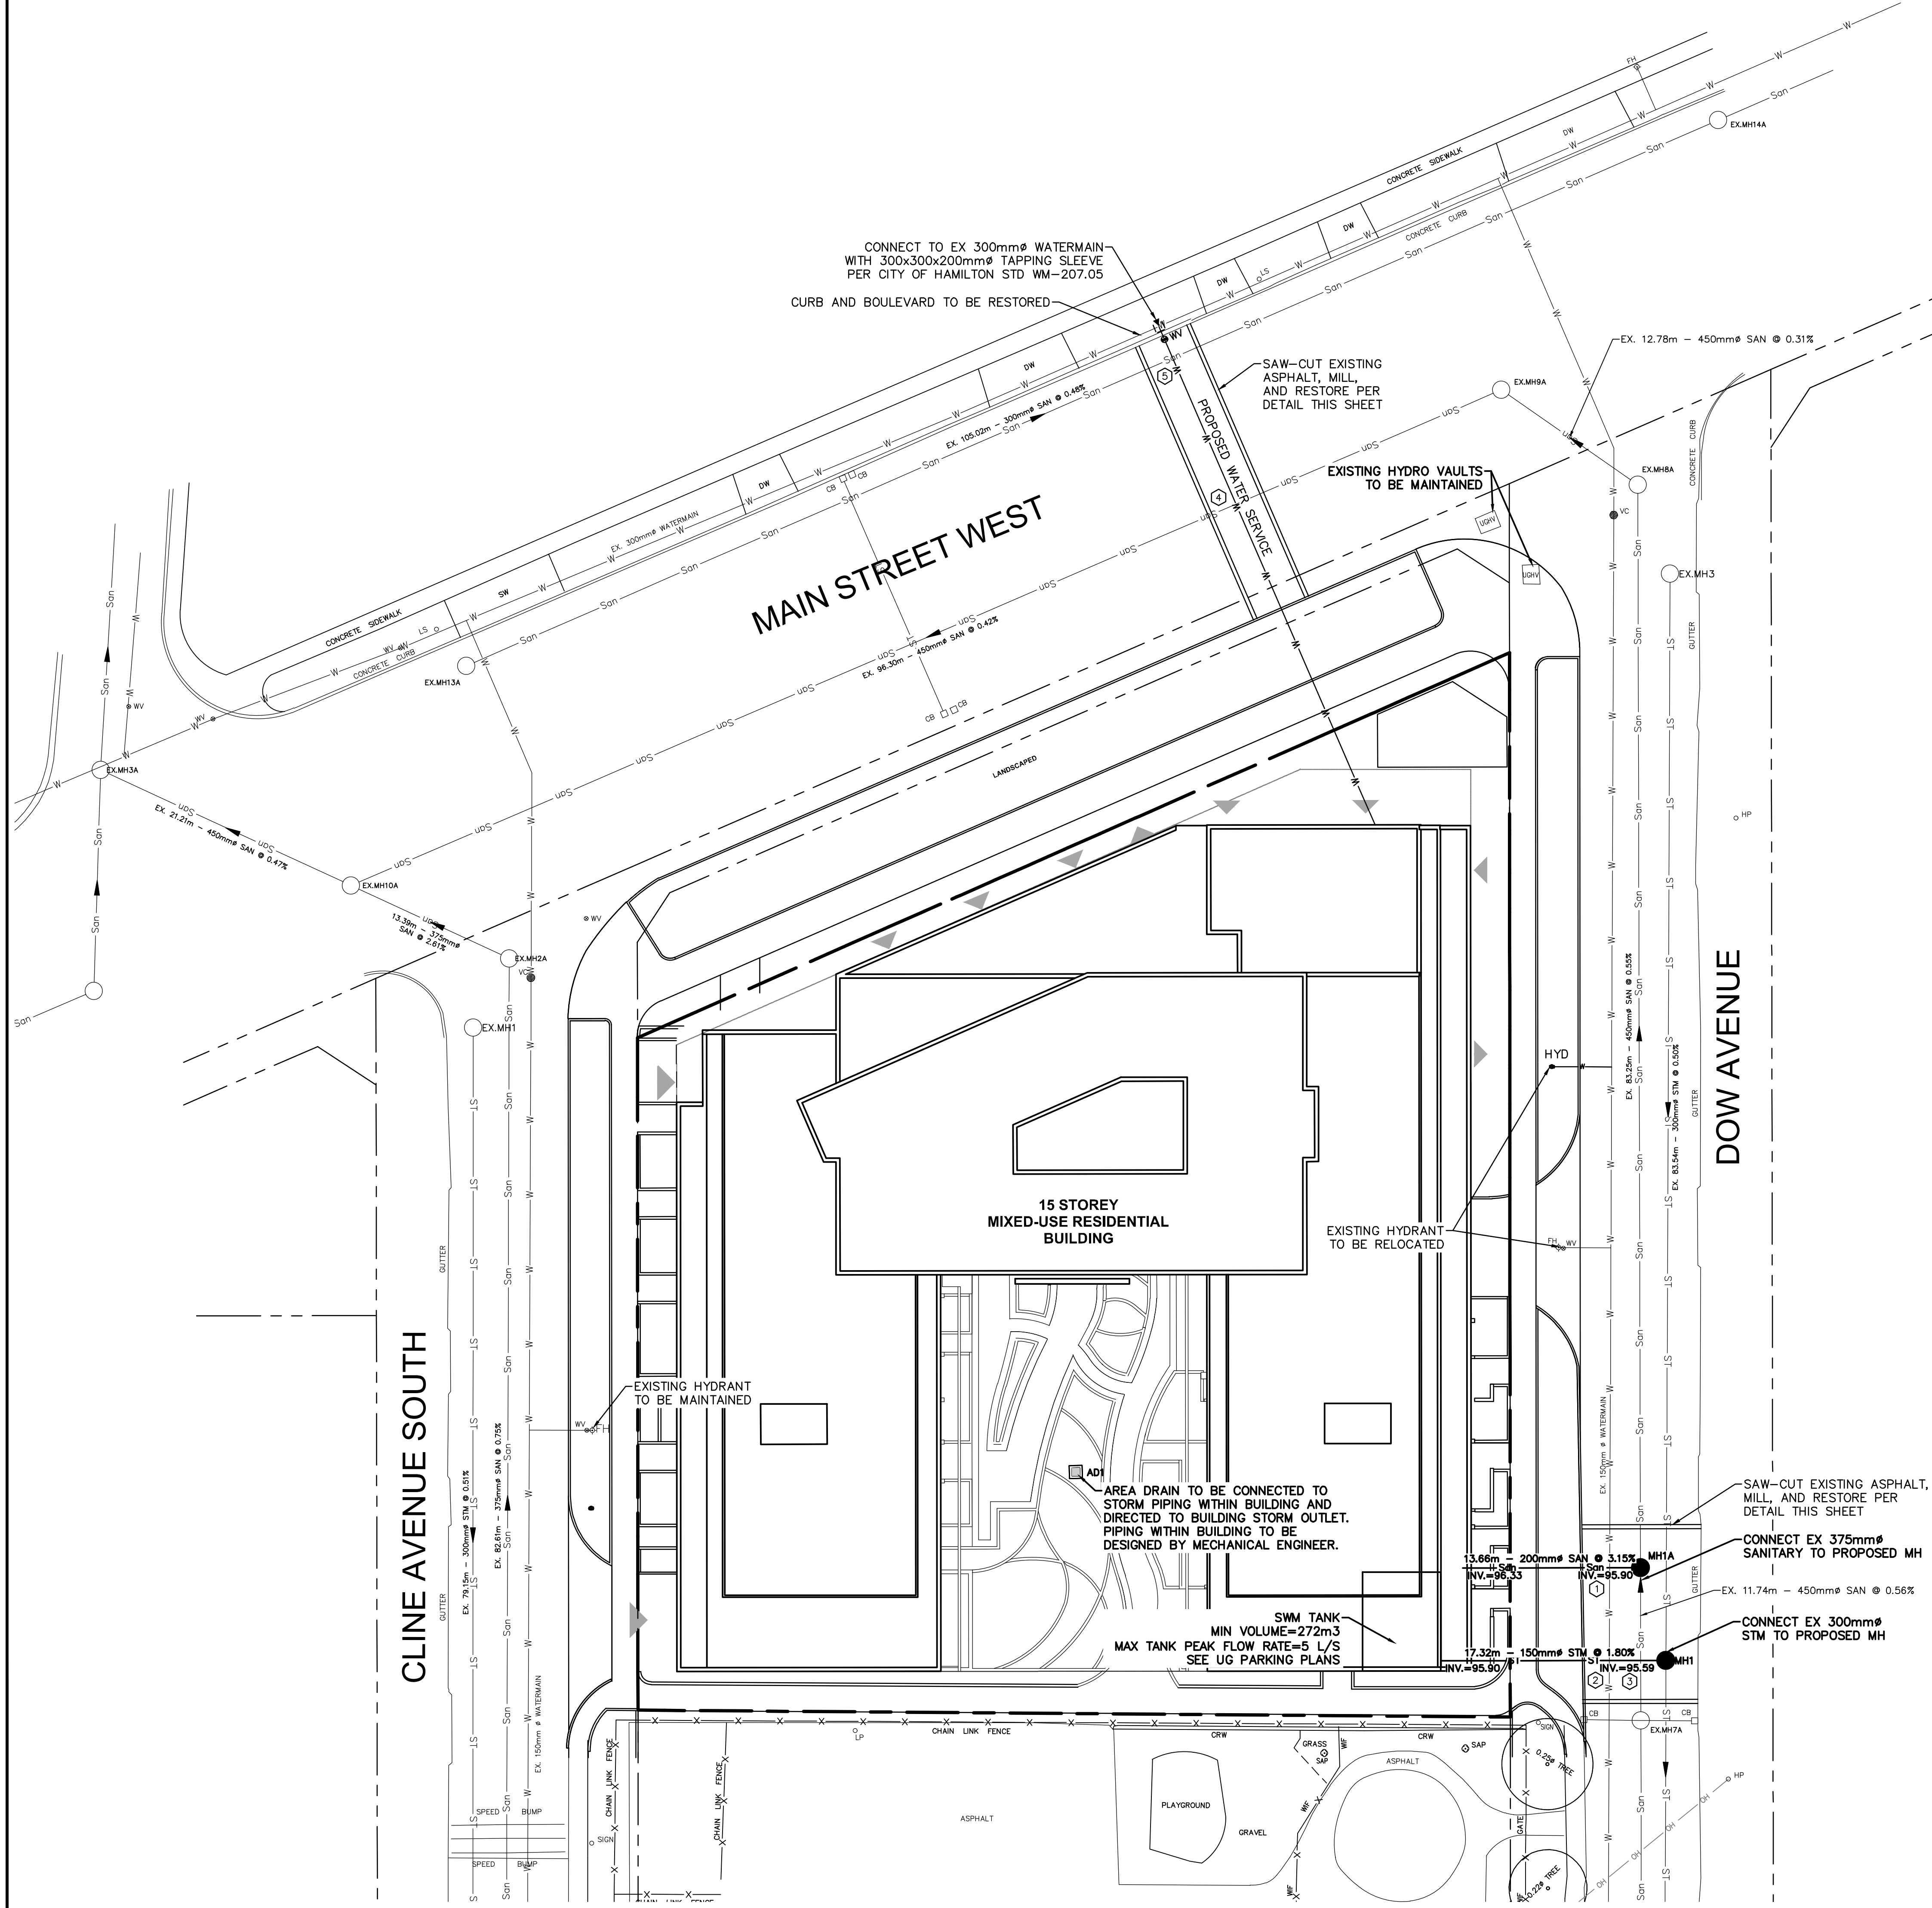

GENERAL NOTES

- ALL WORK INVOLVED IN THE CONSTRUCTION, RELOCATION, REPAIR OF MUNICIPAL SERVICES FOR THE PROJECT SHALL BE TO THE SATISFACTION OF THE DIRECTOR, DEVELOPMENT DIVISION, PLANNING AND DEVELOPMENT DEPARTMENT.
- FIRE ROUTE SIGNS AND 3-WAY FIRE HYDRANTS SHALL BE ESTABLISHED TO THE SATISFACTION OF THE CITY FIRE DEPARTMENT AND AT THE EXPENSE OF THE OWNER.
- MAIN DRIVEWAY DIMENSIONS AT THE PROPERTY LINE BOUNDARIES ARE PLUS OR MINUS 7.5m UNLESS OTHERWISE STATED.
- ALL DRIVEWAYS FROM PROPERTY LINES FOR THE FIRST 7.5m SHALL BE WITHIN 5% MAXIMUM GRADE, THEREAFTER, ALL DRIVEWAYS SHALL BE WITHIN 10% MAXIMUM GRADE.
- THE APPROVAL OF THIS PLAN DOES NOT EXEMPT THE OWNER'S BONDED CONTRACTOR FROM THE REQUIREMENTS TO OBTAIN THE VARIOUS PERMITS/APPROVALS NORMALLY REQUIRED TO COMPLETE A CONSTRUCTION PROJECT, SUCH AS, BUT NOT LIMITED TO THE FOLLOWING:
 - ROAD CUT PERMITS
 - APPROACH APPROVAL PERMITS
 - COMMITTEE OF ADJUSTMENT
 - SEWER PERMITS
 - RELOCATION OF SERVICES
 - ENCROACHMENT AGREEMENTS (IF REQUIRED)
- ABANDONED ACCESSES MUST BE REMOVED AND THE CURB AND BOULEVARD RESTORED WITH SOD AT THE OWNER'S EXPENSE TO THE SATISFACTION OF THE TRAFFIC ENGINEERING SECTION, TRANSPORTATION, OPERATIONS AND ENVIRONMENT DEPARTMENT.
- 3 METRE BY 3 METRE VISIBILITY TRIANGLES IN WHICH THE MAXIMUM HEIGHT OF ANY OBJECTS OR MATURE VEGETATION IS NOT TO EXCEED A HEIGHT OF 0.60 METRES ABOVE THE CORRESPONDING PERPENDICULAR CENTRELINE ELEVATION OF THE ADJACENT STREET.
- SILTATION CONTROL DEVICES SHALL BE INSTALLED PRIOR TO WORKS COMMENCING ON THE SITE AND SHALL BE MAINTAINED FOR THE DURATION OF CONSTRUCTION, TO THE SATISFACTION OF THE CITY.
- THE SUB-GRADE SOILS EXPOSED AFTER EXCAVATION SHALL BE INSPECTED AND CERTIFIED BY A QUALIFIED REGISTERED PROFESSIONAL SOILS ENGINEER AND A COPY OF THE REPORT SHALL BE FORWARDED TO THE CITY OF HAMILTON BUILDING DIVISION. WHERE THE FOOTING WILL BE SITUATED ON FILL MATERIAL, THE FOOTINGS SHALL BE DESIGNED AND APPROVED BY QUALIFIED REGISTERED PROFESSIONAL ENGINEER.
- ALL FILL PLACED ON THE SITE SHALL BE COMPACTED TO A MINIMUM OF 98% STANDARD PROCTOR DENSITY. A SUFFICIENT NUMBER OF TESTS SHALL BE TAKEN AT VARIOUS LEVELS SATISFACTORY TO THE DIRECTOR OF ENGINEERING. TEST RESULTS SHALL BE SENT TO THE CITY WITH A LETTER, SIGNED AND STAMPED BY THE SOILS ENGINEER, STATING THAT A SUFFICIENT NUMBER OF TESTS HAVE BEEN TAKEN AND THE MINIMUM DEGREE OF COMPACTION HAS BEEN REACHED.
- APPROVAL OF THIS DRAWING IS FOR MATERIAL ACCEPTABILITY AND COMPLIANCE WITH MUNICIPAL AND PROVINCIAL SPECIFICATIONS AND STANDARDS ONLY. APPROVAL AND INSPECTION BY THE CITY OF THE WORKS DOES NOT CERTIFY THE LINE AND GRADE OF THE WORKS AND IT IS THE OWNER'S RESPONSIBILITY TO HAVE THEIR ENGINEER CERTIFY THIS ACCORDINGLY.

BEFORE STARTING WORK



- THE CONTRACTOR SHALL NOTIFY THE CITY OF HAMILTON AND IBI GROUP AT LEAST 48 HOURS PRIOR TO COMMENCING CONSTRUCTION.
- THE POSITION OF THE POLE LINES, CONDUITS, WATERMAINS, SEWERS, AND OTHER UTILITIES AND STRUCTURES ARE NOT NECESSARILY SHOWN ON THE CONTRACT DRAWINGS, AND WHERE SHOWN, THE ACCURACY OF THE POSITION OF SUCH UTILITIES AND STRUCTURES IS NOT GUARANTEED.
- PRIOR TO THE COMMENCEMENT OF CONSTRUCTION, ALL BENCHMARKS, ELEVATIONS, DIMENSIONS, AND GRADES MUST BE CHECKED BY THE CONTRACTOR AND ANY DISCREPANCIES REPORTED TO THE ENGINEER.
- ALL EXISTING UNDERGROUND UTILITIES WITHIN THE LIMITS OF CONSTRUCTION SHALL BE LOCATED, MARKED AND PROTECTED. ANY UTILITIES DAMAGED OR DISTURBED DURING CONSTRUCTION SHALL BE REPAIRED OR REPLACED TO THE SATISFACTION OF THE ENGINEER, AT THE CONTRACTOR'S EXPENSE.
- AT LEAST TWO DIFFERENT BENCHMARKS MUST BE REFERRED TO AT ALL TIMES.
- REPRODUCED PLANS SHALL AT NO TIMES BE SCALED AND ASSUMED ACCURATE.

PIPE CROSSING ELEVATIONS			
LOCATION	INVERT	OBVERT	ELEV. DIFFERENCE
1	+96.60 WM	96.10 SAN	0.50m
2	+96.60 WM	95.75 STM	0.85m
3	+95.86 SAN	95.70 STM	0.16m
4	97.30 WM	+95.66 SAN	1.64m
5	97.10 WM	+96.55 SAN	0.55m

NOTE: EX. (4) ELEVATIONS ARE APPROXIMATE, CONTRACTOR TO CONFIRM.

NOTE TO CONTRACTOR

THE POSITION OF POLE LINES, CONDUITS, WATERMAINS, SEWERS AND OTHER UNDERGROUND AND OVERGROUND UTILITIES AND STRUCTURES ARE NOT NECESSARILY SHOWN ON THIS CONTRACT DRAWING, AND WHERE SHOWN, THE ACCURACY OF THE POSITION OF SUCH UTILITIES IS NOT GUARANTEED. BEFORE STARTING WORK THE CONTRACTOR SHALL INFORM THEMSELVES OF THE EXACT LOCATION OF ALL SUCH UTILITIES AND STRUCTURES AND SHALL ASSUME ALL LIABILITY FOR DAMAGE TO THEM.

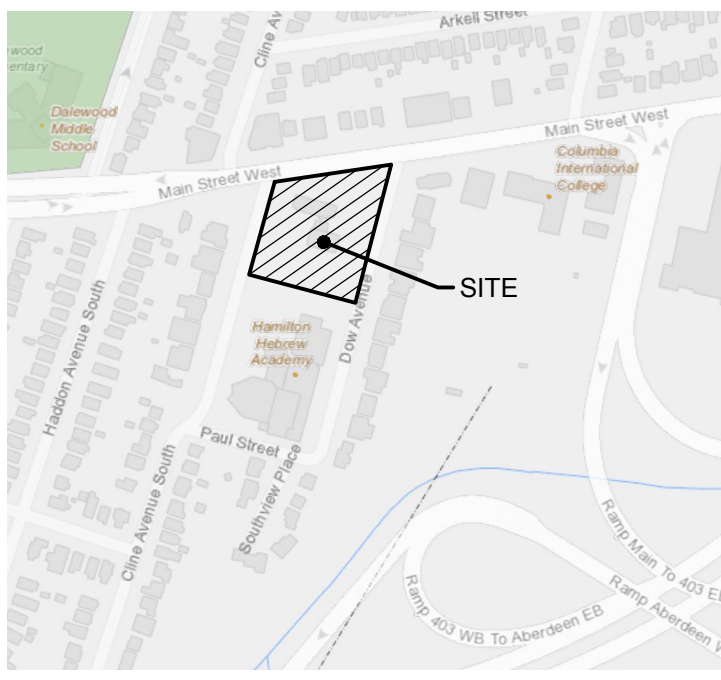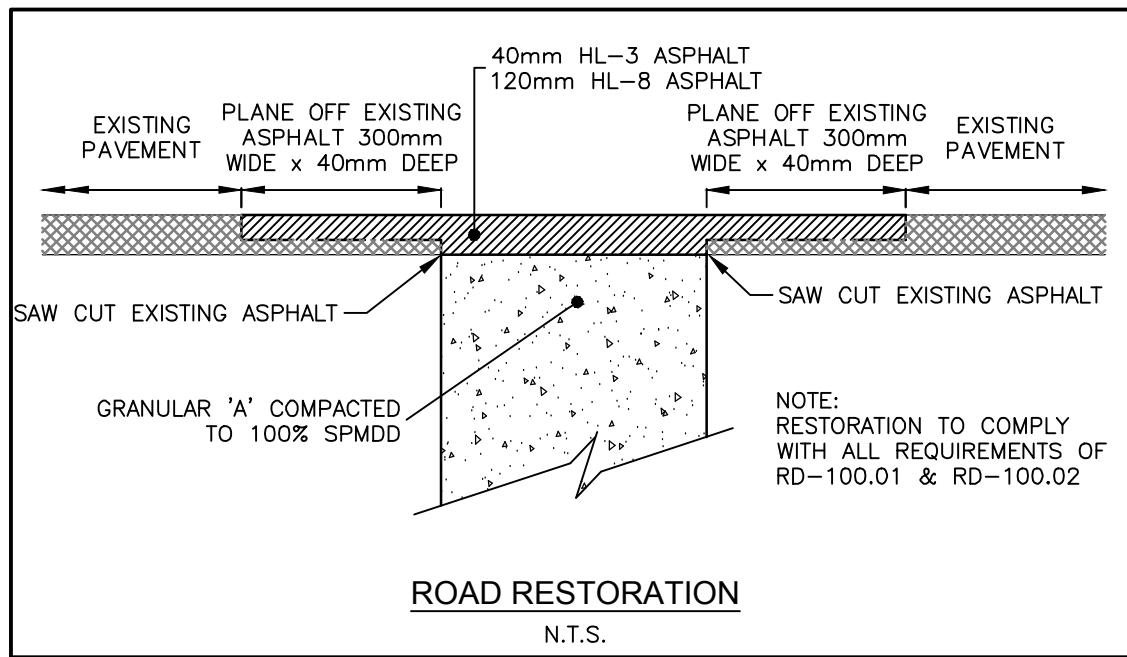

KEY MAP - N.T.S.

LEGEND	
---	PROPERTY LINE
- - -	LOT/EASEMENT LINE
SAN	EXISTING COMBINED SEWER
WM	EXISTING WATERMAIN
STM	EXISTING STM SEWER
OH	EXISTING OVERHEAD HYDRO
○	EXISTING MANHOLE
□	EXISTING CATCH BASIN
⊙	EXISTING HYDRANT
⊗	EXISTING WATER VALVE
○	EXISTING TREE
⊙	EXISTING BOREHOLE
SAN	PROPOSED SANITARY
WM	PROPOSED WATER
STM	PROPOSED STORM
●	PROPOSED MH
⊙	PIPE CROSSING
⊗	PROPOSED WATER VALVE
⊕	PROPOSED TEE

NOT FOR TENDER

31	2021.05.18	PC	ISSUED FOR ZBA THIRD SUBMISSION
2	2020.11.10	PC	ISSUED FOR ZBA SECOND SUBMISSION
1	2019.11.31	PC	ISSUED FOR ZBA
#	DATE	BY	DESCRIPTION

APPROVALS

IBI GROUP
101 - 410 Albert Street
Waterloo ON N2L 3V3 Canada
tel 519 585 2255
ibigroup.com

CITY OF HAMILTON

1107 MAIN STREET WEST
MIXED-USE RESIDENTIAL BUILDING

SERVICING PLAN

DESIGNED BY:	P. CLOUTIER	SCALE HORIZ:	1:250
DRAWN BY:	P. CLOUTIER	SCALE VERT:	NA
CHECKED BY:	J. PERKS	FILE NUMBER:	122727
DATE:	2019-10-31	SHEET NUMBER:	SP

APPENDIX B:

Calculations

City of Hamilton Sanitary Design Flow Review

Project: 1107 Main Street West, Hamilton
File No: 122727
Date: 14-Jun-21
Design By: TC
Checked By: JP
Page: 1 of 2



REQUIREMENT

Design Flow = Average Dry Weather Flow X Peak Flow Factor + Infiltration Allowance

Existing Development Maximum Daily Flow

Land Use	Population Density	Units	Area	Equivalent Population
Church				
Institutional ²	300 ppha	-	0.52 ha	155
Total				155

$$\text{Peaking Factor, } M^2 = 5 / P^{0.2}$$

where: P = design population in thousands

$$\text{Peaking Factor}^2 = 5.00$$

$$\begin{aligned} \text{Average dry weather flow}^2 &= 360 \text{ L/day/p} \\ \text{Dry Weather Flow} &= 55800 \text{ L/day} \\ &= 55.80 \text{ m}^3/\text{day} \\ &= 0.65 \text{ L/s} \end{aligned}$$

$$\begin{aligned} \text{Drainage area} &= 0.52 \text{ ha} \\ \text{Infiltration Allowance}^2 &= 0.400 \text{ L/s/ha} \\ &= 0.21 \text{ L/s} \end{aligned}$$

$$\text{Total Design Flow} = 3.44 \text{ L/s}$$

1- Ontario Building Code Part 8 - Table 8.2.1.3.A

2- City of Hamilton Engineering Guidelines for Servicing Land Under Development Applications Part 2.4.2.6

City of Hamilton Sanitary Sewer Capacity Analysis

Project: 1107 Main Street West, Hamilton
File No: 122727
Date: 14-Jun-21
Design By: TC
Checked By: JP
Page: 1 of 1



n= 0.013

Street Name	Total Proposed Incremental Flow (L/s)	Sewer Calculation					Remarks
		Diameter (mm)	Grade (%)	Capacity (L/s)	Velocity (m/s)	Full %	
Main Street W.	0.00	450	0.42%	184.77	1.16	0%	n/a
Main Street W.	0.00	300	0.48%	67.00	0.95	0%	n/a
Cline Ave. S.	0.00	375	0.75%	151.84	1.37	0%	n/a
Dow Avenue	10.27	375	0.56%	131.21	1.19	8%	Negligible impact

City of Hamilton Sanitary Design Flow Review

Project: 1107 Main Street West, Hamilton
File No: 122727
Date: 14-Jun-21
Design By: TC
Checked By: JP
Page: 2 of 2



REQUIREMENT

Design Flow = Average Dry Weather Flow X Peak Flow Factor + Infiltration Allowance

Proposed Development Maximum Daily Flow

Land Use	Population Density	Units	Area	Equivalent Population
15-Storey Building			-	
1 Bedroom ¹	750.0 L/day 2.08 PPU	73	-	153
1 Bedroom + Den	1100.0 L/day 3.06 PPU	103	-	
2 Bedroom ¹	1100.0 L/day 3.06 PPU	75	-	230
2 Bedroom + Den	1600.0 L/day 4.44 PPU	29	-	
3 Bedroom ¹	1600.0 L/day 4.44 PPU	9	-	40
3 Bedroom + Den	2000.0 L/day 5.56 PPU	6	-	34
Commercial ²	450.0 ppha	-	0.0558 ha	26
Total		295	Total 483	

Peaking Factor, $M^2 = 5 / P^{0.2}$
 where: P = design population in thousands

Peaking Factor² = 5.00

Average dry weather flow² 360 L/day/p
 Dry Weather Flow = 173880 L/day
 = 173.88 m³/day
 = 2.01 L/s

Drainage area 0.52 ha
 Infiltration Allowance² = 0.400 L/s/ha
 = 0.21 L/s

Total Design Flow = 10.27 L/s

1- Ontario Building Code Part 8 - Table 8.2.1.3.A

2- City of Hamilton Engineering Guidelines for Servicing Land Under Development Applications Part 2.4.2.6

City of Hamilton Fire Flow Review

Project: 1107 Main Street West, Hamilton
 File No: 122727
 Date: 14-Jun-21
 Sheet By: TC
 Checked By: JP
 Page: 1 of 1



Required Fire Flow

Formula $F = 220 * C \sqrt{A}$ (Part II, Fire Underwriters Survey, 1999)

Assumptions	Ordinary construction
Subject Floor Area	2794.45 m ²
25% of Floor Area Above	698.6 m ²
25% of Floor Area Below	698.6 m ²
Shared Walls	0 ea.
North Separation*	35.0 m
North Adjustment	5%
East Separation*	23.0 m
East Adjustment	10%
South Separation*	18.0 m
South Adjustment	15%
West Separation*	26.0 m
West Adjustment	10%
A =	4191.7 m ²
C =	1
F =	14,243.49 L/min
Rounded F =	14,000 L/min
Occupancy Fire Hazard Adjustment	-15%
Adjusted due to Occupancy Fire Hazard F =	11,900
Interior Firewall Adjustment	0 (10% per unpeirced party wall)
Exposure Adjustment	4,760 (see Separation Table)
Sprinkler Adjustment	-3570 (30% reduction, Sprinkler System conforming to NFPA 13 and other NFPA Standards)
Adjusted F =	13,000.0 L/min
Required Fire Flow =	216.7 L/s

MIN REQUIRED FLOW = 216.7 L/s
 (@20psi theoretical) 3434 gal(US)/min

Available flow 0.0 L/s
 (To be determined) 0 gal(US)/min

Exposure		
Separation		Charge
From (m)	To (m)	
0	3	25%
3.1	10	20%
10.1	20	15%
20.1	30	10%
30.1	45	5%

Notes:

- 1- All calculations and factors from "Water Supply for Public Fire Protection" by the Fire Underwriters Survey, 1999
- 2- Assumptions based on architect's preliminary floor plans, to be confirmed with architect and client at a later date.

City of Hamilton Domestic Water Demand

Project: 1107 Main Street West, Hamilton
 File No: 122727
 Date: 14-Jun-21
 Sheet By: TC
 Checked By: JP
 Page: 1 of 1



Fixture	Fixture Units per Device ¹	Number of Fixtures	Fixture Units
Bathroom group with greater than 6 LPF flush tank	6	295	1770
Sink, kitchen, domestic, greater than 8.3 L/min	1.5	295	442.5
Dishwasher, domestic	1.4	295	413
Clothes washer, 3.5 kg	1.4	295	413
Lavatory, greater than 8.3 L/min	1	12	12
Total			3050.5

Maximum Water Demand²

80 gpm
5.05 L/s

1- Ontario Building Code Section 7 - Table 7.6.3.2.A

2- American Water Works Association Manual M22 "Sizing Water Service Lines and Meters"- Figure 4.2

**122727 - 1107 Main Street West, City of Hamilton
Area 200 Roof Stage-Storage-Discharge Relationship**

Total Rooftop Area = 1400 (m²)
 Number of Roof Drains = 11
 Roof Cell Area = 127.3 (m²)
 The Length of a Cell Side* = 11.28 (m)
 Maximum Ponding Depth = 0.152 (m)
 Total Number of Notches per Drain = 1

Depth (inch)	Depth (m)	Base Area (m ²)	Cell Volume (m ³)	Total Volume (m ³)	Notch Discharge** (m ³ /s)	Total Discharge (m ³ /s)
0	0.000	0	0.00	0.00	0.00000	0.00000
1	0.025	3.54	0.03	0.33	0.00038	0.00418
2	0.051	14.14	0.24	2.63	0.00076	0.00836
3	0.076	31.82	0.81	8.89	0.00114	0.01254
4	0.102	56.57	1.92	21.07	0.00152	0.01672
5	0.127	88.38	3.74	41.16	0.00190	0.02090
6	0.152	127.27	6.47	74.12	0.00228	0.02508

* - assumed that the cell is square

** - notch discharge given as 0.38 l/s/notch/inch of head

(from Zurn Control-Flo Roof Drainage System Technical Catalogue)

122727 - 1107 Main Street West, City of Hamilton
Underground Tank Stage-Storage-Discharge Relationship

Orifice # 1

Orifice Invert =	95.90	m
Orifice Radius =	0.0250	m
Orifice Diameter =	50	mm
Orifice Centreline =	95.925	m
Orifice Coefficient =	0.6	
Orifice Area =	0.0019634	m ²

Tank # 1 Storage

Tank Invert =	95.95	m		
Tank Obvert =	96.75	m		
Length =	35.00	m	70	units
Width =	10.00	m	20	units
Height =	0.80	m	2	units
Voids =	0.97			
Storage =	339.5	m ³ /m		
Total Storage =	271.6	m ³		

Spill

Spill Elevation =	99.30	m
Weir Length =	6.00	m
Weir Coefficient =	1.6	

Hydraulic Depth (m)	Elevation (m)	Description	Orifice # 1 Flow (m ³ /s)	Weir Flow (m ³ /s)	Total Flow (m ³ /s)	Tank Total Storage (m ³)	Surface Storage (m ³)	Total Active Storage (m ³)
0.00	95.95	Tank Invert	0.0000	0.0000	0.0000	0.0	0.0	0.0
0.05	96.00		0.0014	0.0000	0.0014	17.0	0.0	17.0
0.10	96.05		0.0018	0.0000	0.0018	33.9	0.0	33.9
0.15	96.10		0.0022	0.0000	0.0022	50.9	0.0	50.9
0.25	96.20		0.0027	0.0000	0.0027	84.9	0.0	84.9
0.35	96.30		0.0032	0.0000	0.0032	118.8	0.0	118.8
0.45	96.40		0.0036	0.0000	0.0036	152.8	0.0	152.8
0.55	96.50		0.0040	0.0000	0.0040	186.7	0.0	186.7
0.65	96.60		0.0043	0.0000	0.0043	220.7	0.0	220.7
0.75	96.70		0.0046	0.0000	0.0046	254.6	0.0	254.6
0.80	96.75	Tank Obvert	0.0047	0.0000	0.0047	271.6	0.0	271.6
3.05	99.00	Top of Grate	0.0091	0.0000	0.0091	271.6	0.2	271.8
3.10	99.05		0.0092	0.0000	0.0092	271.6	0.4	272.0
3.15	99.10		0.0093	0.0000	0.0093	271.6	0.6	272.2
3.20	99.15		0.0094	0.0000	0.0094	271.6	0.8	272.4
3.25	99.20		0.0094	0.0000	0.0094	271.6	1.0	272.6
3.30	99.25		0.0095	0.0000	0.0095	271.6	1.2	272.8
3.35	99.30		0.0096	0.0000	0.0096	271.6	1.4	273.0

Orifice equation: $Q = C_o \times A \times (2 \times g \times h)^{0.5}$

where:

A = orifice area (m²)

g = 9.806 m/s²

h = head above c/l of orifice (m)

L = weir length (m)

H = head above weir (m)

Weir equation: $Q = C_w \times L \times (H)^{3/2}$

```

"          MIDUSS Output ----->"
"          MIDUSS version                      Version 2.25 rev. 473"
"          MIDUSS created                      Sunday, February 7, 2010"
"      10  Units used:                          ie METRIC"
"          Job folder:                        \\caneast.ibigroup.com\J\WT\"
"          122727_1107MainStW\7.0_Production\7.99_Submitted\FSR\Appendix B\SWM\May 2021"
"          Output filename:                    122727-3Ch2REV.OUT"
"          Licensee name:                      install"
"          Company                            IBI Group"
"          Date & Time last used:              2021-05-26 at 1:46:03 PM"
" 81      ADD COMMENT=====
"      6  Lines of comment"
"          *****"
"          * 122727 - 1107 MAIN STREET WEST      *"
"          * CITY OF HAMILTON                    *"
"          * IBI GROUP                          *"
"          * JANUARY 2020 - REVISED MAY 2021     *"
"          *****"
" 31      TIME PARAMETERS"
"          5.000 Time Step"
"          180.000 Max. Storm length"
"          3600.000 Max. Hydrograph"
" 81      ADD COMMENT=====
"          4  Lines of comment"
"          *****"
"          * 2 YEAR CHICAGO STORM                *"
"          * MOUNT HOPE IDF PARAMETERS          *"
"          *****"
" 32      STORM Chicago storm"
"          1  Chicago storm"
"          646.000 Coefficient A"
"          6.000 Constant B"
"          0.781 Exponent C"
"          0.400 Fraction R"
"          180.000 Duration"
"          1.000 Time step multiplier"
"          Maximum intensity          99.290 mm/hr"
"          Total depth                32.724 mm"
"          6  002hyd Hydrograph extension used in this file"
" 81      ADD COMMENT=====
"          3  Lines of comment"
"          *****"
"          * EXISTING CONDITIONS                *"
"          *****"
" 81      ADD COMMENT=====
"          3  Lines of comment"
"          *****"
"          * AREA 101 - EXISTING SITE AREA      *"
"          *****"
" 33      CATCHMENT 101"
"          1  Triangular SCS"
"          1  Equal length"
"          1  SCS method"
"          101 101- Exisitng site"
"          50.000 % Impervious"
"          0.516 Total Area"
"          40.000 Flow length"
"          2.000 Overland Slope"
"          0.258 Pervious Area"
"          40.000 Pervious length"
"          2.000 Pervious slope"
"          0.258 Impervious Area"
"          40.000 Impervious length"
"          2.000 Impervious slope"
"          0.250 Pervious Manning 'n'"
"          74.000 Pervious SCS Curve No."

```

```

"      0.153 Pervious Runoff coefficient"
"      0.100 Pervious Ia/S coefficient"
"      8.924 Pervious Initial abstraction"
"      0.015 Impervious Manning 'n'"
" 98.000 Impervious SCS Curve No."
"      0.834 Impervious Runoff coefficient"
"      0.100 Impervious Ia/S coefficient"
"      0.518 Impervious Initial abstraction"
"          0.048      0.000      0.000      0.000 c.m/sec"
"      Catchment 101      Pervious      Impervious      Total Area  "
"      Surface Area      0.258      0.258      0.516      hectare"
"      Time of concentration 35.718      2.736      7.851      minutes"
"      Time to Centroid    147.110      92.738      101.171      minutes"
"      Rainfall depth      32.724      32.724      32.724      mm"
"      Rainfall volume     84.43      84.43      168.85      c.m"
"      Rainfall losses     27.716      5.443      16.579      mm"
"      Runoff depth        5.008      27.281      16.144      mm"
"      Runoff volume       12.92      70.38      83.31      c.m"
"      Runoff coefficient   0.153      0.834      0.493      "
"      Maximum flow        0.003      0.048      0.048      c.m/sec"
" 81      ADD COMMENT=====
"      3      Lines of comment"
"      *****
"      * TOTAL FLOW FROM EXISTING SITE AREA *
"      *****
" 40      HYDROGRAPH Add Runoff "
"      4      Add Runoff "
"          0.048      0.048      0.000      0.000"
" 51      PIPE DESIGN"
"      0.048 Current peak flow      c.m/sec"
"      0.013 Manning 'n'"
"      0.375 Diameter      metre"
"      1.000 Gradient      %"
"      Depth of flow          0.134      metre"
"      Velocity              1.355      m/sec"
"      Pipe capacity          0.175      c.m/sec"
"      Critical depth         0.159      metre"
" 53      ROUTE Zero Route"
"      0.00 Zero Route Reach length ( metre)"
"          0.048      0.048      0.048      0.000 c.m/sec"
" 40      HYDROGRAPH Combine 1"
"      6      Combine "
"      1      Node #"
"      Runoff from existing site"
"      Maximum flow          0.048      c.m/sec"
"      Hydrograph volume     83.305      c.m"
"          0.048      0.048      0.048      0.048"
" 40      HYDROGRAPH Start - New Tributary"
"      2      Start - New Tributary"
"          0.048      0.000      0.048      0.048"
" 81      ADD COMMENT=====
"      3      Lines of comment"
"      *****
"      * PROPOSED CONDITIONS *
"      *****
" 81      ADD COMMENT=====
"      3      Lines of comment"
"      *****
"      * AREA 200 - ROOFTOP SWM STORAGE AREA *
"      *****
" 33      CATCHMENT 200"
"      1      Triangular SCS"
"      1      Equal length"
"      1      SCS method"
"      200    200- Rooftop stormwater storage"
"      100.000 % Impervious"

```

```

"      0.140  Total Area"
"      20.000 Flow length"
"      1.000  Overland Slope"
"      0.000  Pervious Area"
"      20.000 Pervious length"
"      1.000  Pervious slope"
"      0.140  Impervious Area"
"      20.000 Impervious length"
"      1.000  Impervious slope"
"      0.250  Pervious Manning 'n'"
"      75.000 Pervious SCS Curve No."
"      0.000  Pervious Runoff coefficient"
"      0.100  Pervious Ia/S coefficient"
"      8.467  Pervious Initial abstraction"
"      0.015  Impervious Manning 'n'"
"      98.000 Impervious SCS Curve No."
"      0.835  Impervious Runoff coefficient"
"      0.100  Impervious Ia/S coefficient"
"      0.518  Impervious Initial abstraction"
"          0.027      0.000      0.048      0.048 c.m/sec"
"      Catchment 200      Pervious      Impervious Total Area "
"      Surface Area      0.000      0.140      0.140      hectare"
"      Time of concentration 27.548      2.222      2.222      minutes"
"      Time to Centroid      137.677      91.965      91.965      minutes"
"      Rainfall depth      32.724      32.724      32.724      mm"
"      Rainfall volume      0.00      45.81      45.81      c.m"
"      Rainfall losses      27.324      5.403      5.403      mm"
"      Runoff depth      5.400      27.321      27.321      mm"
"      Runoff volume      0.00      38.25      38.25      c.m"
"      Runoff coefficient      0.000      0.835      0.835      "
"      Maximum flow      0.000      0.027      0.027      c.m/sec"
" 40      HYDROGRAPH Add Runoff "
"      4      Add Runoff "
"          0.027      0.027      0.048      0.048"
" 81      ADD COMMENT=====
"      3      Lines of comment"
"      *****
"      * CONTROLLED - ROOFTOP SWM STORAGE * "
"      *****
" 54      POND DESIGN"
"      0.027      Current peak flow      c.m/sec"
"      0.020      Target outflow      c.m/sec"
"      38.2      Hydrograph volume      c.m"
"      7.      Number of stages"
"      0.000      Minimum water level      metre"
"      0.152      Maximum water level      metre"
"      0.000      Starting water level      metre"
"      0      Keep Design Data: 1 = True; 0 = False"
"          Level Discharge      Volume"
"          0.000      0.000      0.000"
"          0.02540      0.00418      0.3300"
"          0.05080      0.00836      2.630"
"          0.07620      0.01254      8.890"
"          0.1016      0.01672      21.070"
"          0.1270      0.02090      41.160"
"          0.1524      0.02508      74.120"
"      Peak outflow      0.013      c.m/sec"
"      Maximum level      0.078      metre"
"      Maximum storage      9.651      c.m"
"      Centroidal lag      1.647      hours"
"          0.027      0.027      0.013      0.048 c.m/sec"
" 40      HYDROGRAPH Combine 2"
"      6      Combine "
"      2      Node #"
"      Runoff to underground storage tank"
"      Maximum flow      0.013      c.m/sec"

```

```

                                122727-3Ch2REV.OUT
"      Hydrograph volume      38.253      c.m"
"      0.027      0.027      0.013      0.013"
" 40      HYDROGRAPH Start - New Tributary"
"      2      Start - New Tributary"
"      0.027      0.000      0.013      0.013"
" 81      ADD COMMENT=====
"      3      Lines of comment"
"      *****
"      * AREA 201 - ROOFTOP AREA WITHOUT SWM STORAGE *
"      *****
" 33      CATCHMENT 201"
"      1      Triangular SCS"
"      1      Equal length"
"      1      SCS method"
"      201      201- Rooftop without storage"
"      100.000      % Impervious"
"      0.161      Total Area"
"      20.000      Flow length"
"      1.000      Overland Slope"
"      0.000      Pervious Area"
"      20.000      Pervious length"
"      1.000      Pervious slope"
"      0.161      Impervious Area"
"      20.000      Impervious length"
"      1.000      Impervious slope"
"      0.250      Pervious Manning 'n'"
"      75.000      Pervious SCS Curve No."
"      0.000      Pervious Runoff coefficient"
"      0.100      Pervious Ia/S coefficient"
"      8.467      Pervious Initial abstraction"
"      0.015      Impervious Manning 'n'"
"      98.000      Impervious SCS Curve No."
"      0.835      Impervious Runoff coefficient"
"      0.100      Impervious Ia/S coefficient"
"      0.518      Impervious Initial abstraction"
"      0.032      0.000      0.013      0.013 c.m/sec"
"      Catchment 201      Pervious      Impervious      Total Area
"      Surface Area      0.000      0.161      0.161      hectare"
"      Time of concentration      27.548      2.222      2.222      minutes"
"      Time to Centroid      137.677      91.965      91.965      minutes"
"      Rainfall depth      32.724      32.724      32.724      mm"
"      Rainfall volume      0.00      52.69      52.69      c.m"
"      Rainfall losses      27.324      5.403      5.403      mm"
"      Runoff depth      5.400      27.321      27.321      mm"
"      Runoff volume      0.00      43.99      43.99      c.m"
"      Runoff coefficient      0.000      0.835      0.835
"      Maximum flow      0.000      0.032      0.032      c.m/sec"
" 40      HYDROGRAPH Add Runoff "
"      4      Add Runoff "
"      0.032      0.032      0.013      0.013"
" 51      PIPE DESIGN"
"      0.032      Current peak flow      c.m/sec"
"      0.013      Manning 'n'"
"      0.375      Diameter      metre"
"      1.000      Gradient      %"
"      Depth of flow      0.108      metre"
"      Velocity      1.203      m/sec"
"      Pipe capacity      0.175      c.m/sec"
"      Critical depth      0.127      metre"
" 53      ROUTE Zero Route"
"      0.00      Zero Route Reach length      ( metre)"
"      0.032      0.032      0.032      0.013 c.m/sec"
" 40      HYDROGRAPH Combine      2"
"      6      Combine "
"      2      Node #"
"      Runoff to underground storage tank"

```



```

122727-3Ch2REV.OUT
"      Maximum flow      0.041      c.m/sec"
"      Hydrograph volume  82.239      c.m"
"      0.032      0.032      0.032      0.041"
" 40      HYDROGRAPH Start - New Tributary"
"      2      Start - New Tributary"
"      0.032      0.000      0.032      0.041"
" 81      ADD COMMENT=====
"      3      Lines of comment"
"      *****
"      * AREA 202 - COURTYARD AREA * "
"      *****
" 33      CATCHMENT 202"
"      1      Triangular SCS"
"      1      Equal length"
"      1      SCS method"
"      202      202- Courtyard"
"      65.000      % Impervious"
"      0.062      Total Area"
"      10.000      Flow length"
"      2.000      Overland Slope"
"      0.022      Pervious Area"
"      10.000      Pervious length"
"      2.000      Pervious slope"
"      0.040      Impervious Area"
"      10.000      Impervious length"
"      2.000      Impervious slope"
"      0.250      Pervious Manning 'n'"
"      74.000      Pervious SCS Curve No."
"      0.153      Pervious Runoff coefficient"
"      0.100      Pervious Ia/S coefficient"
"      8.924      Pervious Initial abstraction"
"      0.015      Impervious Manning 'n'"
"      98.000      Impervious SCS Curve No."
"      0.827      Impervious Runoff coefficient"
"      0.100      Impervious Ia/S coefficient"
"      0.518      Impervious Initial abstraction"
"      0.009      0.000      0.032      0.041 c.m/sec"
"      Catchment 202      Pervious      Impervious      Total Area "
"      Surface Area      0.022      0.040      0.062      hectare"
"      Time of concentration  15.547      1.191      2.489      minutes"
"      Time to Centroid      123.752      90.290      93.316      minutes"
"      Rainfall depth      32.724      32.724      32.724      mm"
"      Rainfall volume      7.10      13.19      20.29      c.m"
"      Rainfall losses      27.727      5.656      13.381      mm"
"      Runoff depth      4.997      27.068      19.343      mm"
"      Runoff volume      1.08      10.91      11.99      c.m"
"      Runoff coefficient      0.153      0.827      0.591      "
"      Maximum flow      0.000      0.009      0.009      c.m/sec"
" 40      HYDROGRAPH Add Runoff "
"      4      Add Runoff "
"      0.009      0.009      0.032      0.041"
" 51      PIPE DESIGN"
"      0.009      Current peak flow      c.m/sec"
"      0.013      Manning 'n'"
"      0.300      Diameter      metre"
"      0.400      Gradient      %"
"      Depth of flow      0.076      metre"
"      Velocity      0.612      m/sec"
"      Pipe capacity      0.061      c.m/sec"
"      Critical depth      0.070      metre"
" 53      ROUTE Zero Route"
"      0.00      Zero Route Reach length      ( metre)"
"      0.009      0.009      0.009      0.041 c.m/sec"
" 40      HYDROGRAPH Combine      2"
"      6      Combine "
"      2      Node #"

```

```

"      Runoff to underground storage tank"
"      Maximum flow          0.050    c.m/sec"
"      Hydrograph volume     94.232    c.m"
"      0.009      0.009      0.009      0.050"
" 81  ADD COMMENT=====
"      3  Lines of comment"
"      *****
"      * CONTROLLED - UNDERGROUND SWM STORAGE TANK * "
"      *****
" 40  HYDROGRAPH Confluence  2"
"      7  Confluence "
"      2  Node #"
"      Runoff to underground storage tank"
"      Maximum flow          0.050    c.m/sec"
"      Hydrograph volume     94.232    c.m"
"      0.009      0.050      0.009      0.000"
" 54  POND DESIGN"
"      0.050  Current peak flow    c.m/sec"
"      0.001  Target outflow      c.m/sec"
"      94.2   Hydrograph volume    c.m"
"      18.    Number of stages"
"      0.000  Minimum water level  metre"
"      3.550  Maximum water level  metre"
"      0.000  Starting water level metre"
"      0      Keep Design Data: 1 = True; 0 = False"
"      Level Discharge  Volume"
"      0.000      0.000      0.000"
"      0.05000  0.00140      17.000"
"      0.1000  0.00180      33.900"
"      0.1500  0.00220      50.900"
"      0.2500  0.00270      84.900"
"      0.3500  0.00320     118.800"
"      0.4500  0.00360     152.800"
"      0.5500  0.00400     186.700"
"      0.6500  0.00430     220.700"
"      0.7500  0.00460     254.600"
"      0.8000  0.00470     271.600"
"      3.050   0.00910     271.800"
"      3.100   0.00920     272.000"
"      3.150   0.00930     272.200"
"      3.200   0.00940     272.400"
"      3.250   0.00940     272.600"
"      3.300   0.00950     272.800"
"      3.350   0.00960     273.000"
"      Peak outflow          0.003    c.m/sec"
"      Maximum level         0.225    metre"
"      Maximum storage       76.510    c.m"
"      Centroidal lag        7.451    hours"
"      0.009      0.050      0.003      0.000 c.m/sec"
" 40  HYDROGRAPH Next link "
"      5  Next link "
"      0.009      0.003      0.003      0.000"
" 81  ADD COMMENT=====
"      3  Lines of comment"
"      *****
"      * AREA 203 - UNCONSTROLLED LAND AREA * "
"      *****
" 33  CATCHMENT 203"
"      1  Triangular SCS"
"      1  Equal length"
"      1  SCS method"
"      203 203- Uncontrolled land"
"      35.000 % Impervious"
"      0.153  Total Area"
"      10.000 Flow length"
"      2.000  Overland Slope"

```

```

"      0.099 Pervious Area"
"    10.000 Pervious length"
"      2.000 Pervious slope"
"      0.054 Impervious Area"
"    10.000 Impervious length"
"      2.000 Impervious slope"
"      0.250 Pervious Manning 'n'"
"    74.000 Pervious SCS Curve No."
"      0.153 Pervious Runoff coefficient"
"      0.100 Pervious Ia/S coefficient"
"      8.924 Pervious Initial abstraction"
"      0.015 Impervious Manning 'n'"
"    98.000 Impervious SCS Curve No."
"      0.827 Impervious Runoff coefficient"
"      0.100 Impervious Ia/S coefficient"
"      0.518 Impervious Initial abstraction"
"          0.012      0.003      0.003      0.000 c.m/sec"
"      Catchment 203      Pervious      Impervious      Total Area  "
"      Surface Area      0.099      0.054      0.153      hectare"
"      Time of concentration 15.547      1.191      4.856      minutes"
"      Time to Centroid    123.752      90.290      98.833      minutes"
"      Rainfall depth      32.724      32.724      32.724      mm"
"      Rainfall volume      32.54      17.52      50.07      c.m"
"      Rainfall losses      27.727      5.655      20.002      mm"
"      Runoff depth      4.997      27.068      12.722      mm"
"      Runoff volume      4.97      14.50      19.46      c.m"
"      Runoff coefficient    0.153      0.827      0.389      "
"      Maximum flow      0.002      0.011      0.012      c.m/sec"
" 81      ADD COMMENT=====
"      3      Lines of comment"
"      *****
"      * TOTAL FLOW FROM PROPOSED SITE AREA *
"      *****
" 40      HYDROGRAPH Add Runoff "
"      4      Add Runoff "
"          0.012      0.013      0.003      0.000"
" 38      START/RE-START TOTALS 203"
"      3      Runoff Totals on EXIT"
"      Total Catchment area      1.032      hectare"
"      Total Impervious area      0.653      hectare"
"      Total % impervious      63.261"
" 19      EXIT"

```

```

"          MIDUSS Output ----->"
"          MIDUSS version                      Version 2.25 rev. 473"
"          MIDUSS created                      Sunday, February 7, 2010"
"      10  Units used:                          ie METRIC"
"          Job folder:                        \\caneast.ibigroup.com\J\WT\"
"          122727_1107MainStW\7.0_Production\7.99_Submitted\FSR\Appendix B\SWM\May 2021"
"          Output filename:                    122727-3Ch5REV.OUT"
"          Licensee name:                      install"
"          Company                            IBI Group"
"          Date & Time last used:              2021-05-26 at 1:44:19 PM"
" 81      ADD COMMENT=====
"      6  Lines of comment"
"          *****"
"          * 122727 - 1107 MAIN STREET WEST      *"
"          * CITY OF HAMILTON                    *"
"          * IBI GROUP                          *"
"          * JANUARY 2020 - REVISED MAY 2021     *"
"          *****"
" 31      TIME PARAMETERS"
"          5.000 Time Step"
"          180.000 Max. Storm length"
"          3600.000 Max. Hydrograph"
" 81      ADD COMMENT=====
"          4  Lines of comment"
"          *****"
"          * 5 YEAR CHICAGO STORM                *"
"          * MOUNT HOPE IDF PARAMETERS          *"
"          *****"
" 32      STORM Chicago storm"
"          1  Chicago storm"
"          1049.500 Coefficient A"
"          8.000 Constant B"
"          0.803 Exponent C"
"          0.400 Fraction R"
"          180.000 Duration"
"          1.000 Time step multiplier"
"          Maximum intensity          133.809 mm/hr"
"          Total depth                46.985 mm"
"          6  005hyd Hydrograph extension used in this file"
" 81      ADD COMMENT=====
"          3  Lines of comment"
"          *****"
"          * EXISTING CONDITIONS                *"
"          *****"
" 81      ADD COMMENT=====
"          3  Lines of comment"
"          *****"
"          * AREA 101 - EXISTING SITE AREA      *"
"          *****"
" 33      CATCHMENT 101"
"          1  Triangular SCS"
"          1  Equal length"
"          1  SCS method"
"          101 101- Exisitng site"
"          50.000 % Impervious"
"          0.516 Total Area"
"          40.000 Flow length"
"          2.000 Overland Slope"
"          0.258 Pervious Area"
"          40.000 Pervious length"
"          2.000 Pervious slope"
"          0.258 Impervious Area"
"          40.000 Impervious length"
"          2.000 Impervious slope"
"          0.250 Pervious Manning 'n'"
"          74.000 Pervious SCS Curve No."

```

```

"      0.242 Pervious Runoff coefficient"
"      0.100 Pervious Ia/S coefficient"
"      8.924 Pervious Initial abstraction"
"      0.015 Impervious Manning 'n'"
" 98.000 Impervious SCS Curve No."
"      0.875 Impervious Runoff coefficient"
"      0.100 Impervious Ia/S coefficient"
"      0.518 Impervious Initial abstraction"
"          0.072      0.000      0.000      0.000 c.m/sec"
"      Catchment 101      Pervious      Impervious      Total Area  "
"      Surface Area      0.258      0.258      0.516      hectare"
"      Time of concentration      23.936      2.392      7.062      minutes"
"      Time to Centroid      131.359      90.884      99.658      minutes"
"      Rainfall depth      46.985      46.985      46.985      mm"
"      Rainfall volume      121.22      121.22      242.44      c.m"
"      Rainfall losses      35.610      5.889      20.749      mm"
"      Runoff depth      11.375      41.095      26.235      mm"
"      Runoff volume      29.35      106.03      135.37      c.m"
"      Runoff coefficient      0.242      0.875      0.558      "
"      Maximum flow      0.008      0.072      0.072      c.m/sec"
" 81      ADD COMMENT=====
"      3      Lines of comment"
"      *****
"      * TOTAL FLOW FROM EXISTING SITE AREA *
"      *****
" 40      HYDROGRAPH Add Runoff "
"      4      Add Runoff "
"          0.072      0.072      0.000      0.000"
" 51      PIPE DESIGN"
"      0.072      Current peak flow      c.m/sec"
"      0.013      Manning 'n'"
"      0.375      Diameter      metre"
"      1.000      Gradient      %"
"      Depth of flow      0.168      metre"
"      Velocity      1.512      m/sec"
"      Pipe capacity      0.175      c.m/sec"
"      Critical depth      0.196      metre"
" 53      ROUTE Zero Route"
"      0.00      Zero Route Reach length      ( metre)"
"          0.072      0.072      0.072      0.000 c.m/sec"
" 40      HYDROGRAPH Combine 1"
"      6      Combine "
"      1      Node #"
"      Runoff from existing site"
"      Maximum flow      0.072      c.m/sec"
"      Hydrograph volume      135.373      c.m"
"          0.072      0.072      0.072      0.072"
" 40      HYDROGRAPH Start - New Tributary"
"      2      Start - New Tributary"
"          0.072      0.000      0.072      0.072"
" 81      ADD COMMENT=====
"      3      Lines of comment"
"      *****
"      * PROPSOED CONDITIONS *
"      *****
" 81      ADD COMMENT=====
"      3      Lines of comment"
"      *****
"      * AREA 200 - ROOFTOP SWM STORAGE AREA *
"      *****
" 33      CATCHMENT 200"
"      1      Triangular SCS"
"      1      Equal length"
"      1      SCS method"
"      200      200- Rooftop stormwater storage"
" 100.000      % Impervious"

```

```

"      0.140  Total Area"
"      20.000  Flow length"
"      1.000  Overland Slope"
"      0.000  Pervious Area"
"      20.000  Pervious length"
"      1.000  Pervious slope"
"      0.140  Impervious Area"
"      20.000  Impervious length"
"      1.000  Impervious slope"
"      0.250  Pervious Manning 'n'"
"      75.000  Pervious SCS Curve No."
"      0.000  Pervious Runoff coefficient"
"      0.100  Pervious Ia/S coefficient"
"      8.467  Pervious Initial abstraction"
"      0.015  Impervious Manning 'n'"
"      98.000  Impervious SCS Curve No."
"      0.877  Impervious Runoff coefficient"
"      0.100  Impervious Ia/S coefficient"
"      0.518  Impervious Initial abstraction"
"          0.040      0.000      0.072      0.072 c.m/sec"
"      Catchment 200      Pervious      Impervious      Total Area "
"      Surface Area      0.000      0.140      0.140      hectare"
"      Time of concentration      18.845      1.943      1.943      minutes"
"      Time to Centroid      124.799      90.147      90.147      minutes"
"      Rainfall depth      46.985      46.985      46.985      mm"
"      Rainfall volume      0.00      65.78      65.78      c.m"
"      Rainfall losses      34.963      5.764      5.764      mm"
"      Runoff depth      12.022      41.220      41.220      mm"
"      Runoff volume      0.00      57.71      57.71      c.m"
"      Runoff coefficient      0.000      0.877      0.877      "
"      Maximum flow      0.000      0.040      0.040      c.m/sec"
" 40      HYDROGRAPH Add Runoff "
"      4      Add Runoff "
"          0.040      0.040      0.072      0.072"
" 81      ADD COMMENT=====
"      3      Lines of comment"
"      *****
"      * CONTROLLED - ROOFTOP SWM STORAGE * "
"      *****
" 54      POND DESIGN"
"      0.040  Current peak flow      c.m/sec"
"      0.020  Target outflow      c.m/sec"
"      57.7  Hydrograph volume      c.m"
"      7.    Number of stages"
"      0.000  Minimum water level      metre"
"      0.152  Maximum water level      metre"
"      0.000  Starting water level      metre"
"      0      Keep Design Data: 1 = True; 0 = False"
"          Level Discharge      Volume"
"          0.000      0.000      0.000"
"          0.02540      0.00418      0.3300"
"          0.05080      0.00836      2.630"
"          0.07620      0.01254      8.890"
"          0.1016      0.01672      21.070"
"          0.1270      0.02090      41.160"
"          0.1524      0.02508      74.120"
"      Peak outflow      0.015      c.m/sec"
"      Maximum level      0.094      metre"
"      Maximum storage      17.353      c.m"
"      Centroidal lag      1.678      hours"
"          0.040      0.040      0.015      0.072 c.m/sec"
" 40      HYDROGRAPH Combine      2"
"      6      Combine "
"      2      Node #"
"      Runoff to underground storage tank"
"      Maximum flow      0.015      c.m/sec"

```



```

122727-3Ch5REV.OUT
"      Hydrograph volume      57.763      c.m"
"      0.040      0.040      0.015      0.015"
" 40      HYDROGRAPH Start - New Tributary"
"      2      Start - New Tributary"
"      0.040      0.000      0.015      0.015"
" 81      ADD COMMENT=====
"      3      Lines of comment"
"      ***** "
"      * AREA 201 - ROOFTOP AREA WITHOUT SWM STORAGE * "
"      *****"
" 33      CATCHMENT 201"
"      1      Triangular SCS"
"      1      Equal length"
"      1      SCS method"
"      201      201- Rooftop without storage"
"      100.000      % Impervious"
"      0.161      Total Area"
"      20.000      Flow length"
"      1.000      Overland Slope"
"      0.000      Pervious Area"
"      20.000      Pervious length"
"      1.000      Pervious slope"
"      0.161      Impervious Area"
"      20.000      Impervious length"
"      1.000      Impervious slope"
"      0.250      Pervious Manning 'n'"
"      75.000      Pervious SCS Curve No."
"      0.000      Pervious Runoff coefficient"
"      0.100      Pervious Ia/S coefficient"
"      8.467      Pervious Initial abstraction"
"      0.015      Impervious Manning 'n'"
"      98.000      Impervious SCS Curve No."
"      0.877      Impervious Runoff coefficient"
"      0.100      Impervious Ia/S coefficient"
"      0.518      Impervious Initial abstraction"
"      0.046      0.000      0.015      0.015 c.m/sec"
"      Catchment 201      Pervious      Impervious      Total Area "
"      Surface Area      0.000      0.161      0.161      hectare"
"      Time of concentration      18.845      1.943      1.943      minutes"
"      Time to Centroid      124.799      90.147      90.147      minutes"
"      Rainfall depth      46.985      46.985      46.985      mm"
"      Rainfall volume      0.00      75.65      75.65      c.m"
"      Rainfall losses      34.963      5.764      5.765      mm"
"      Runoff depth      12.022      41.220      41.220      mm"
"      Runoff volume      0.00      66.36      66.36      c.m"
"      Runoff coefficient      0.000      0.877      0.877      "
"      Maximum flow      0.000      0.046      0.046      c.m/sec"
" 40      HYDROGRAPH Add Runoff "
"      4      Add Runoff "
"      0.046      0.046      0.015      0.015"
" 51      PIPE DESIGN"
"      0.046      Current peak flow      c.m/sec"
"      0.013      Manning 'n'"
"      0.375      Diameter      metre"
"      1.000      Gradient      %"
"      Depth of flow      0.131      metre"
"      Velocity      1.339      m/sec"
"      Pipe capacity      0.175      c.m/sec"
"      Critical depth      0.155      metre"
" 53      ROUTE Zero Route"
"      0.00      Zero Route Reach length      ( metre)"
"      0.046      0.046      0.046      0.015 c.m/sec"
" 40      HYDROGRAPH Combine      2"
"      6      Combine "
"      2      Node #"
"      Runoff to underground storage tank"

```

```

122727-3Ch5REV.OUT
"      Maximum flow      0.058      c.m/sec"
"      Hydrograph volume 124.127      c.m"
"      0.046      0.046      0.046      0.058"
" 40      HYDROGRAPH Start - New Tributary"
"      2      Start - New Tributary"
"      0.046      0.000      0.046      0.058"
" 81      ADD COMMENT=====
"      3      Lines of comment"
"      *****
"      * AREA 202 - COURTYARD AREA * "
"      *****
" 33      CATCHMENT 202"
"      1      Triangular SCS"
"      1      Equal length"
"      1      SCS method"
"      202      202- Courtyard"
"      65.000      % Impervious"
"      0.062      Total Area"
"      10.000      Flow length"
"      2.000      Overland Slope"
"      0.022      Pervious Area"
"      10.000      Pervious length"
"      2.000      Pervious slope"
"      0.040      Impervious Area"
"      10.000      Impervious length"
"      2.000      Impervious slope"
"      0.250      Pervious Manning 'n'"
"      74.000      Pervious SCS Curve No."
"      0.241      Pervious Runoff coefficient"
"      0.100      Pervious Ia/S coefficient"
"      8.924      Pervious Initial abstraction"
"      0.015      Impervious Manning 'n'"
"      98.000      Impervious SCS Curve No."
"      0.862      Impervious Runoff coefficient"
"      0.100      Impervious Ia/S coefficient"
"      0.518      Impervious Initial abstraction"
"      0.013      0.000      0.046      0.058 c.m/sec"
"      Catchment 202      Pervious      Impervious      Total Area "
"      Surface Area      0.022      0.040      0.062      hectare"
"      Time of concentration 10.419      1.041      2.270      minutes"
"      Time to Centroid      114.611      88.724      92.116      minutes"
"      Rainfall depth      46.985      46.985      46.985      mm"
"      Rainfall volume      10.20      18.93      29.13      c.m"
"      Rainfall losses      35.640      6.461      16.674      mm"
"      Runoff depth      11.345      40.524      30.311      mm"
"      Runoff volume      2.46      16.33      18.79      c.m"
"      Runoff coefficient      0.241      0.862      0.645      "
"      Maximum flow      0.001      0.012      0.013      c.m/sec"
" 40      HYDROGRAPH Add Runoff "
"      4      Add Runoff "
"      0.013      0.013      0.046      0.058"
" 51      PIPE DESIGN"
"      0.013      Current peak flow      c.m/sec"
"      0.013      Manning 'n'"
"      0.300      Diameter      metre"
"      0.400      Gradient      %"
"      Depth of flow      0.092      metre"
"      Velocity      0.681      m/sec"
"      Pipe capacity      0.061      c.m/sec"
"      Critical depth      0.084      metre"
" 53      ROUTE Zero Route"
"      0.00      Zero Route Reach length      ( metre)"
"      0.013      0.013      0.013      0.058 c.m/sec"
" 40      HYDROGRAPH Combine      2"
"      6      Combine "
"      2      Node #"

```

```

"      Runoff to underground storage tank"
"      Maximum flow      0.070      c.m/sec"
"      Hydrograph volume      142.920      c.m"
"      0.013      0.013      0.013      0.070"
" 81  ADD COMMENT=====
"      3  Lines of comment"
"      *****
"      * CONTROLLED - UNDERGROUND SWM STORAGE TANK * "
"      *****
" 40  HYDROGRAPH Confluence      2"
"      7  Confluence "
"      2  Node #"
"      Runoff to underground storage tank"
"      Maximum flow      0.070      c.m/sec"
"      Hydrograph volume      142.920      c.m"
"      0.013      0.070      0.013      0.000"
" 54  POND DESIGN"
"      0.070  Current peak flow      c.m/sec"
"      0.001  Target outflow      c.m/sec"
"      142.9  Hydrograph volume      c.m"
"      18.    Number of stages"
"      0.000  Minimum water level      metre"
"      3.550  Maximum water level      metre"
"      0.000  Starting water level      metre"
"      0      Keep Design Data: 1 = True; 0 = False"
"      Level Discharge      Volume"
"      0.000      0.000      0.000"
"      0.05000  0.00140      17.000"
"      0.1000  0.00180      33.900"
"      0.1500  0.00220      50.900"
"      0.2500  0.00270      84.900"
"      0.3500  0.00320      118.800"
"      0.4500  0.00360      152.800"
"      0.5500  0.00400      186.700"
"      0.6500  0.00430      220.700"
"      0.7500  0.00460      254.600"
"      0.8000  0.00470      271.600"
"      3.050  0.00910      271.800"
"      3.100  0.00920      272.000"
"      3.150  0.00930      272.200"
"      3.200  0.00940      272.400"
"      3.250  0.00940      272.600"
"      3.300  0.00950      272.800"
"      3.350  0.00960      273.000"
"      Peak outflow      0.003      c.m/sec"
"      Maximum level      0.355      metre"
"      Maximum storage      120.662      c.m"
"      Centroidal lag      8.869      hours"
"      0.013      0.070      0.003      0.000 c.m/sec"
" 40  HYDROGRAPH Next link "
"      5  Next link "
"      0.013      0.003      0.003      0.000"
" 81  ADD COMMENT=====
"      3  Lines of comment"
"      *****
"      * AREA 203 - UNCONSTROLLED LAND AREA * "
"      *****
" 33  CATCHMENT 203"
"      1  Triangular SCS"
"      1  Equal length"
"      1  SCS method"
"      203  203- Uncontrolled land"
"      35.000 % Impervious"
"      0.153  Total Area"
"      10.000 Flow length"
"      2.000 Overland Slope"

```

```

"      0.099 Pervious Area"
"    10.000 Pervious length"
"      2.000 Pervious slope"
"      0.054 Impervious Area"
"    10.000 Impervious length"
"      2.000 Impervious slope"
"      0.250 Pervious Manning 'n'"
"    74.000 Pervious SCS Curve No."
"      0.241 Pervious Runoff coefficient"
"      0.100 Pervious Ia/S coefficient"
"      8.924 Pervious Initial abstraction"
"      0.015 Impervious Manning 'n'"
"    98.000 Impervious SCS Curve No."
"      0.862 Impervious Runoff coefficient"
"      0.100 Impervious Ia/S coefficient"
"      0.518 Impervious Initial abstraction"
"          0.017      0.003      0.003      0.000 c.m/sec"
"      Catchment 203      Pervious      Impervious      Total Area  "
"      Surface Area      0.099      0.054      0.153      hectare"
"      Time of concentration 10.419      1.041      4.249      minutes"
"      Time to Centroid 114.611      88.724      97.579      minutes"
"      Rainfall depth 46.985      46.985      46.985      mm"
"      Rainfall volume 46.73      25.16      71.89      c.m"
"      Rainfall losses 35.640      6.461      25.427      mm"
"      Runoff depth 11.345      40.524      21.557      mm"
"      Runoff volume 11.28      21.70      32.98      c.m"
"      Runoff coefficient 0.241      0.862      0.459      "
"      Maximum flow 0.005      0.016      0.017      c.m/sec"
" 81      ADD COMMENT=====
"      3 Lines of comment"
"      *****
"      * TOTAL FLOW FROM PROPOSED SITE AREA *
"      *****
" 40      HYDROGRAPH Add Runoff "
"      4 Add Runoff "
"          0.017      0.019      0.003      0.000"
" 38      START/RE-START TOTALS 203"
"      3 Runoff Totals on EXIT"
"      Total Catchment area      1.032      hectare"
"      Total Impervious area      0.653      hectare"
"      Total % impervious      63.261"
" 19      EXIT"

```

```

"          MIDUSS Output ----->"
"          MIDUSS version                      Version 2.25 rev. 473"
"          MIDUSS created                      Sunday, February 7, 2010"
"      10  Units used:                          ie METRIC"
"          Job folder:                        \\caneast.ibigroup.com\J\WT\"
"          122727_1107MainStW\7.0_Production\7.99_Submitted\FSR\Appendix B\SWM\May 2021"
"          Output filename:                    122727-3Ch10REV.OUT"
"          Licensee name:                      install"
"          Company                            IBI Group"
"          Date & Time last used:              2021-05-26 at 1:42:37 PM"
" 81      ADD COMMENT=====
"      6  Lines of comment"
"          *****"
"          * 122727 - 1107 MAIN STREET WEST      *"
"          * CITY OF HAMILTON                    *"
"          * IBI GROUP                          *"
"          * JANUARY 2020 - REVISED MAY 2021     *"
"          *****"
" 31      TIME PARAMETERS"
"          5.000 Time Step"
"          180.000 Max. Storm length"
"          3600.000 Max. Hydrograph"
" 81      ADD COMMENT=====
"          4  Lines of comment"
"          *****"
"          * 10 YEAR CHICAGO STORM      *"
"          * MOUNT HOPE IDF PARAMETERS  *"
"          *****"
" 32      STORM Chicago storm"
"          1  Chicago storm"
"          1343.700 Coefficient A"
"          9.000 Constant B"
"          0.814 Exponent C"
"          0.400 Fraction R"
"          180.000 Duration"
"          1.000 Time step multiplier"
"          Maximum intensity          156.803 mm/hr"
"          Total depth                56.544 mm"
"          6  010hyd Hydrograph extension used in this file"
" 81      ADD COMMENT=====
"          3  Lines of comment"
"          *****"
"          * EXISTING CONDITIONS      *"
"          *****"
" 81      ADD COMMENT=====
"          3  Lines of comment"
"          *****"
"          * AREA 101 - EXISTING SITE AREA      *"
"          *****"
" 33      CATCHMENT 101"
"          1  Triangular SCS"
"          1  Equal length"
"          1  SCS method"
"          101 101- Exisitng site"
"          50.000 % Impervious"
"          0.516 Total Area"
"          40.000 Flow length"
"          2.000 Overland Slope"
"          0.258 Pervious Area"
"          40.000 Pervious length"
"          2.000 Pervious slope"
"          0.258 Impervious Area"
"          40.000 Impervious length"
"          2.000 Impervious slope"
"          0.250 Pervious Manning 'n'"
"          74.000 Pervious SCS Curve No."

```

```

"      0.293 Pervious Runoff coefficient"
"      0.100 Pervious Ia/S coefficient"
"      8.924 Pervious Initial abstraction"
"      0.015 Impervious Manning 'n'"
" 98.000 Impervious SCS Curve No."
"      0.893 Impervious Runoff coefficient"
"      0.100 Impervious Ia/S coefficient"
"      0.518 Impervious Initial abstraction"
"              0.089      0.000      0.000      0.000 c.m/sec"
"      Catchment 101      Pervious      Impervious      Total Area      "
"      Surface Area      0.258      0.258      0.516      hectare"
"      Time of concentration      20.286      2.234      6.691      minutes"
"      Time to Centroid      125.568      90.036      98.810      minutes"
"      Rainfall depth      56.544      56.544      56.544      mm"
"      Rainfall volume      145.88      145.88      291.77      c.m"
"      Rainfall losses      39.989      6.057      23.023      mm"
"      Runoff depth      16.554      50.487      33.520      mm"
"      Runoff volume      42.71      130.26      172.97      c.m"
"      Runoff coefficient      0.293      0.893      0.593      "
"      Maximum flow      0.013      0.087      0.089      c.m/sec"
" 81      ADD COMMENT=====
"      3      Lines of comment"
"      *****
"      * TOTAL FLOW FROM EXISTING SITE AREA *
"      *****
" 40      HYDROGRAPH Add Runoff "
"      4      Add Runoff "
"              0.089      0.089      0.000      0.000"
" 51      PIPE DESIGN"
"      0.089      Current peak flow      c.m/sec"
"      0.013      Manning 'n'"
"      0.375      Diameter      metre"
"      1.000      Gradient      %"
"      Depth of flow      0.189      metre"
"      Velocity      1.592      m/sec"
"      Pipe capacity      0.175      c.m/sec"
"      Critical depth      0.218      metre"
" 53      ROUTE Zero Route"
"      0.00      Zero Route Reach length      ( metre)"
"              0.089      0.089      0.089      0.000 c.m/sec"
" 40      HYDROGRAPH Combine 1"
"      6      Combine "
"      1      Node #"
"      Runoff from existing site"
"      Maximum flow      0.089      c.m/sec"
"      Hydrograph volume      172.966      c.m"
"              0.089      0.089      0.089      0.089"
" 40      HYDROGRAPH Start - New Tributary"
"      2      Start - New Tributary"
"              0.089      0.000      0.089      0.089"
" 81      ADD COMMENT=====
"      3      Lines of comment"
"      *****
"      * PROPOSED CONDITIONS *
"      *****
" 81      ADD COMMENT=====
"      3      Lines of comment"
"      *****
"      * AREA 200 - ROOFTOP SWM STORAGE AREA *
"      *****
" 33      CATCHMENT 200"
"      1      Triangular SCS"
"      1      Equal length"
"      1      SCS method"
"      200      200- Rooftop stormwater storage"
" 100.000      % Impervious"

```



```

"      0.140 Total Area"
" 20.000 Flow length"
"      1.000 Overland Slope"
"      0.000 Pervious Area"
" 20.000 Pervious length"
"      1.000 Pervious slope"
"      0.140 Impervious Area"
" 20.000 Impervious length"
"      1.000 Impervious slope"
"      0.250 Pervious Manning 'n'"
" 75.000 Pervious SCS Curve No."
"      0.000 Pervious Runoff coefficient"
"      0.100 Pervious Ia/S coefficient"
"      8.467 Pervious Initial abstraction"
"      0.015 Impervious Manning 'n'"
" 98.000 Impervious SCS Curve No."
"      0.894 Impervious Runoff coefficient"
"      0.100 Impervious Ia/S coefficient"
"      0.518 Impervious Initial abstraction"
"          0.048      0.000      0.089      0.089 c.m/sec"
"      Catchment 200      Pervious      Impervious Total Area "
"      Surface Area      0.000      0.140      0.140      hectare"
"      Time of concentration      16.056      1.814      1.814      minutes"
"      Time to Centroid      120.033      89.331      89.331      minutes"
"      Rainfall depth      56.544      56.544      56.544      mm"
"      Rainfall volume      0.00      79.16      79.16      c.m"
"      Rainfall losses      39.180      6.000      6.000      mm"
"      Runoff depth      17.364      50.544      50.544      mm"
"      Runoff volume      0.00      70.76      70.76      c.m"
"      Runoff coefficient      0.000      0.894      0.894      "
"      Maximum flow      0.000      0.048      0.048      c.m/sec"
" 40 HYDROGRAPH Add Runoff "
"      4 Add Runoff "
"          0.048      0.048      0.089      0.089"
" 81 ADD COMMENT=====
"      3 Lines of comment"
"      *****
"      * CONTROLLED - ROOFTOP SWM STORAGE * "
"      *****
" 54 POND DESIGN"
"      0.048 Current peak flow      c.m/sec"
"      0.020 Target outflow      c.m/sec"
"      70.8 Hydrograph volume      c.m"
"      7. Number of stages"
"      0.000 Minimum water level      metre"
"      0.152 Maximum water level      metre"
"      0.000 Starting water level      metre"
"      0 Keep Design Data: 1 = True; 0 = False"
"          Level Discharge      Volume"
"          0.000      0.000      0.000"
"          0.02540      0.00418      0.3300"
"          0.05080      0.00836      2.630"
"          0.07620      0.01254      8.890"
"          0.1016      0.01672      21.070"
"          0.1270      0.02090      41.160"
"          0.1524      0.02508      74.120"
"      Peak outflow      0.017      c.m/sec"
"      Maximum level      0.104      metre"
"      Maximum storage      23.054      c.m"
"      Centroidal lag      1.705      hours"
"          0.048      0.048      0.017      0.089 c.m/sec"
" 40 HYDROGRAPH Combine 2"
"      6 Combine "
"      2 Node #"
"      Runoff to underground storage tank"
"      Maximum flow      0.017      c.m/sec"

```

```

122727-3Ch10REV.OUT
"      Hydrograph volume      70.786      c.m"
"      0.048      0.048      0.017      0.017"
" 40      HYDROGRAPH Start - New Tributary"
"      2      Start - New Tributary"
"      0.048      0.000      0.017      0.017"
" 81      ADD COMMENT=====
"      3      Lines of comment"
"      ***** "
"      * AREA 201 - ROOFTOP AREA WITHOUT SWM STORAGE * "
"      *****"
" 33      CATCHMENT 201"
"      1      Triangular SCS"
"      1      Equal length"
"      1      SCS method"
"      201      201- Rooftop without storage"
"      100.000      % Impervious"
"      0.161      Total Area"
"      20.000      Flow length"
"      1.000      Overland Slope"
"      0.000      Pervious Area"
"      20.000      Pervious length"
"      1.000      Pervious slope"
"      0.161      Impervious Area"
"      20.000      Impervious length"
"      1.000      Impervious slope"
"      0.250      Pervious Manning 'n'"
"      75.000      Pervious SCS Curve No."
"      0.000      Pervious Runoff coefficient"
"      0.100      Pervious Ia/S coefficient"
"      8.467      Pervious Initial abstraction"
"      0.015      Impervious Manning 'n'"
"      98.000      Impervious SCS Curve No."
"      0.894      Impervious Runoff coefficient"
"      0.100      Impervious Ia/S coefficient"
"      0.518      Impervious Initial abstraction"
"      0.056      0.000      0.017      0.017 c.m/sec"
"      Catchment 201      Pervious      Impervious Total Area "
"      Surface Area      0.000      0.161      0.161      hectare"
"      Time of concentration      16.056      1.814      1.814      minutes"
"      Time to Centroid      120.033      89.331      89.331      minutes"
"      Rainfall depth      56.544      56.544      56.544      mm"
"      Rainfall volume      0.00      91.04      91.04      c.m"
"      Rainfall losses      39.180      6.000      6.000      mm"
"      Runoff depth      17.364      50.544      50.544      mm"
"      Runoff volume      0.00      81.38      81.38      c.m"
"      Runoff coefficient      0.000      0.894      0.894      "
"      Maximum flow      0.000      0.056      0.056      c.m/sec"
" 40      HYDROGRAPH Add Runoff "
"      4      Add Runoff "
"      0.056      0.056      0.017      0.017"
" 51      PIPE DESIGN"
"      0.056      Current peak flow      c.m/sec"
"      0.013      Manning 'n'"
"      0.375      Diameter      metre"
"      1.000      Gradient      %"
"      Depth of flow      0.145      metre"
"      Velocity      1.410      m/sec"
"      Pipe capacity      0.175      c.m/sec"
"      Critical depth      0.171      metre"
" 53      ROUTE Zero Route"
"      0.00      Zero Route Reach length      ( metre)"
"      0.056      0.056      0.056      0.017 c.m/sec"
" 40      HYDROGRAPH Combine      2"
"      6      Combine "
"      2      Node #"
"      Runoff to underground storage tank"

```

```

122727-3Ch10REV.OUT
"      Maximum flow      0.069      c.m/sec"
"      Hydrograph volume  152.161      c.m"
"      0.056      0.056      0.056      0.069"
" 40      HYDROGRAPH Start - New Tributary"
"      2      Start - New Tributary"
"      0.056      0.000      0.056      0.069"
" 81      ADD COMMENT=====
"      3      Lines of comment"
"      *****
"      * AREA 202 - COURTYARD AREA * "
"      *****
" 33      CATCHMENT 202"
"      1      Triangular SCS"
"      1      Equal length"
"      1      SCS method"
"      202      202- Courtyard"
"      65.000      % Impervious"
"      0.062      Total Area"
"      10.000      Flow length"
"      2.000      Overland Slope"
"      0.022      Pervious Area"
"      10.000      Pervious length"
"      2.000      Pervious slope"
"      0.040      Impervious Area"
"      10.000      Impervious length"
"      2.000      Impervious slope"
"      0.250      Pervious Manning 'n'"
"      74.000      Pervious SCS Curve No."
"      0.292      Pervious Runoff coefficient"
"      0.100      Pervious Ia/S coefficient"
"      8.924      Pervious Initial abstraction"
"      0.015      Impervious Manning 'n'"
"      98.000      Impervious SCS Curve No."
"      0.876      Impervious Runoff coefficient"
"      0.100      Impervious Ia/S coefficient"
"      0.518      Impervious Initial abstraction"
"      0.015      0.000      0.056      0.069 c.m/sec"
"      Catchment 202      Pervious      Impervious      Total Area "
"      Surface Area      0.022      0.040      0.062      hectare"
"      Time of concentration  8.830      0.972      2.167      minutes"
"      Time to Centroid      111.155      88.058      91.571      minutes"
"      Rainfall depth      56.544      56.544      56.544      mm"
"      Rainfall volume      12.27      22.79      35.06      c.m"
"      Rainfall losses      40.047      7.028      18.585      mm"
"      Runoff depth      16.496      49.516      37.959      mm"
"      Runoff volume      3.58      19.95      23.53      c.m"
"      Runoff coefficient      0.292      0.876      0.671      "
"      Maximum flow      0.002      0.015      0.015      c.m/sec"
" 40      HYDROGRAPH Add Runoff "
"      4      Add Runoff "
"      0.015      0.015      0.056      0.069"
" 51      PIPE DESIGN"
"      0.015      Current peak flow      c.m/sec"
"      0.013      Manning 'n'"
"      0.300      Diameter      metre"
"      0.400      Gradient      %"
"      Depth of flow      0.102      metre"
"      Velocity      0.718      m/sec"
"      Pipe capacity      0.061      c.m/sec"
"      Critical depth      0.093      metre"
" 53      ROUTE Zero Route"
"      0.00      Zero Route Reach length      ( metre)"
"      0.015      0.015      0.015      0.069 c.m/sec"
" 40      HYDROGRAPH Combine      2"
"      6      Combine "
"      2      Node #"

```

```

"      Runoff to underground storage tank"
"      Maximum flow          0.084      c.m/sec"
"      Hydrograph volume     175.696    c.m"
"      0.015      0.015      0.015      0.084"
" 81  ADD COMMENT=====
"      3  Lines of comment"
"      *****
"      * CONTROLLED - UNDERGROUND SWM STORAGE TANK * "
"      *****
" 40  HYDROGRAPH Confluence  2"
"      7  Confluence "
"      2  Node #"
"      Runoff to underground storage tank"
"      Maximum flow          0.084      c.m/sec"
"      Hydrograph volume     175.696    c.m"
"      0.015      0.084      0.015      0.000"
" 54  POND DESIGN"
"      0.084  Current peak flow  c.m/sec"
"      0.001  Target outflow    c.m/sec"
"      175.7  Hydrograph volume  c.m"
"      18.    Number of stages"
"      0.000  Minimum water level  metre"
"      3.550  Maximum water level  metre"
"      0.000  Starting water level  metre"
"      0      Keep Design Data: 1 = True; 0 = False"
"      Level Discharge  Volume"
"      0.000      0.000      0.000"
"      0.05000  0.00140      17.000"
"      0.1000  0.00180      33.900"
"      0.1500  0.00220      50.900"
"      0.2500  0.00270      84.900"
"      0.3500  0.00320     118.800"
"      0.4500  0.00360     152.800"
"      0.5500  0.00400     186.700"
"      0.6500  0.00430     220.700"
"      0.7500  0.00460     254.600"
"      0.8000  0.00470     271.600"
"      3.050   0.00910     271.800"
"      3.100   0.00920     272.000"
"      3.150   0.00930     272.200"
"      3.200   0.00940     272.400"
"      3.250   0.00940     272.600"
"      3.300   0.00950     272.800"
"      3.350   0.00960     273.000"
"      Peak outflow          0.004      c.m/sec"
"      Maximum level         0.444      metre"
"      Maximum storage       150.909    c.m"
"      Centroidal lag        9.697      hours"
"      0.015      0.084      0.004      0.000 c.m/sec"
" 40  HYDROGRAPH Next link "
"      5  Next link "
"      0.015      0.004      0.004      0.000"
" 81  ADD COMMENT=====
"      3  Lines of comment"
"      *****
"      * AREA 203 - UNCONSTROLLED LAND AREA * "
"      *****
" 33  CATCHMENT 203"
"      1  Triangular SCS"
"      1  Equal length"
"      1  SCS method"
"      203  203- Uncontrolled land"
"      35.000 % Impervious"
"      0.153  Total Area"
"      10.000 Flow length"
"      2.000  Overland Slope"

```

```

"      0.099 Pervious Area"
"    10.000 Pervious length"
"      2.000 Pervious slope"
"      0.054 Impervious Area"
"    10.000 Impervious length"
"      2.000 Impervious slope"
"      0.250 Pervious Manning 'n'"
"    74.000 Pervious SCS Curve No."
"      0.292 Pervious Runoff coefficient"
"      0.100 Pervious Ia/S coefficient"
"      8.924 Pervious Initial abstraction"
"      0.015 Impervious Manning 'n'"
"    98.000 Impervious SCS Curve No."
"      0.876 Impervious Runoff coefficient"
"      0.100 Impervious Ia/S coefficient"
"      0.518 Impervious Initial abstraction"
"          0.022      0.004      0.004      0.000 c.m/sec"
"      Catchment 203      Pervious      Impervious      Total Area  "
"      Surface Area      0.099      0.054      0.153      hectare"
"      Time of concentration 8.830      0.972      3.976      minutes"
"      Time to Centroid 111.155      88.058      96.886      minutes"
"      Rainfall depth 56.544      56.544      56.544      mm"
"      Rainfall volume 56.23      30.28      86.51      c.m"
"      Rainfall losses 40.047      7.028      28.490      mm"
"      Runoff depth 16.496      49.516      28.053      mm"
"      Runoff volume 16.41      26.52      42.92      c.m"
"      Runoff coefficient 0.292      0.876      0.496      "
"      Maximum flow 0.008      0.020      0.022      c.m/sec"
" 81      ADD COMMENT=====
"      3 Lines of comment"
"      *****
"      * TOTAL FLOW FROM PROPOSED SITE AREA *
"      *****
" 40      HYDROGRAPH Add Runoff "
"      4 Add Runoff "
"          0.022      0.024      0.004      0.000"
" 38      START/RE-START TOTALS 203"
"      3 Runoff Totals on EXIT"
"      Total Catchment area      1.032      hectare"
"      Total Impervious area      0.653      hectare"
"      Total % impervious      63.261"
" 19      EXIT"

```

```

"          MIDUSS Output ----->"
"          MIDUSS version                      Version 2.25 rev. 473"
"          MIDUSS created                      Sunday, February 7, 2010"
"      10  Units used:                          ie METRIC"
"          Job folder:                        \\caneast.ibigroup.com\J\WT\"
"          122727_1107MainStW\7.0_Production\7.99_Submitted\FSR\Appendix B\SWM\May 2021"
"          Output filename:                    122727-3Ch25REV.OUT"
"          Licensee name:                      install"
"          Company                            IBI Group"
"          Date & Time last used:              2021-05-26 at 1:40:45 PM"
" 81      ADD COMMENT=====
"      6  Lines of comment"
"          *****"
"          * 122727 - 1107 MAIN STREET WEST      *"
"          * CITY OF HAMILTON                    *"
"          * IBI GROUP                          *"
"          * JANUARY 2020 - REVISED MAY 2021     *"
"          *****"
" 31      TIME PARAMETERS"
"          5.000  Time Step"
"          180.000 Max. Storm length"
"          3600.000 Max. Hydrograph"
" 81      ADD COMMENT=====
"          4  Lines of comment"
"          *****"
"          * 25 YEAR CHICAGO STORM      *"
"          * MOUNT HOPE IDF PARAMETERS  *"
"          *****"
" 32      STORM Chicago storm"
"          1  Chicago storm"
"          1719.500 Coefficient A"
"          10.000  Constant B"
"          0.823   Exponent C"
"          0.400   Fraction R"
"          180.000 Duration"
"          1.000   Time step multiplier"
"          Maximum intensity      185.131   mm/hr"
"          Total depth            68.724   mm"
"          6  025hyd Hydrograph extension used in this file"
" 81      ADD COMMENT=====
"          3  Lines of comment"
"          *****"
"          * EXISTING CONDITIONS  *"
"          *****"
" 81      ADD COMMENT=====
"          3  Lines of comment"
"          *****"
"          * AREA 101 - EXISTING SITE AREA  *"
"          *****"
" 33      CATCHMENT 101"
"          1  Triangular SCS"
"          1  Equal length"
"          1  SCS method"
"          101 101- Exisitng site"
"          50.000 % Impervious"
"          0.516  Total Area"
"          40.000 Flow length"
"          2.000  Overland Slope"
"          0.258  Pervious Area"
"          40.000 Pervious length"
"          2.000  Pervious slope"
"          0.258  Impervious Area"
"          40.000 Impervious length"
"          2.000  Impervious slope"
"          0.250  Pervious Manning 'n'"
"          74.000 Pervious SCS Curve No."

```

```

"      0.349 Pervious Runoff coefficient"
"      0.100 Pervious Ia/S coefficient"
"      8.924 Pervious Initial abstraction"
"      0.015 Impervious Manning 'n'"
" 98.000 Impervious SCS Curve No."
"      0.909 Impervious Runoff coefficient"
"      0.100 Impervious Ia/S coefficient"
"      0.518 Impervious Initial abstraction"
"          0.109      0.000      0.000      0.000 c.m/sec"
"      Catchment 101      Pervious      Impervious      Total Area  "
"      Surface Area      0.258      0.258      0.516      hectare"
"      Time of concentration 17.353      2.082      6.317      minutes"
"      Time to Centroid      120.707      89.276      97.993      minutes"
"      Rainfall depth      68.724      68.724      68.724      mm"
"      Rainfall volume      177.31      177.31      354.62      c.m"
"      Rainfall losses      44.748      6.242      25.495      mm"
"      Runoff depth      23.976      62.482      43.229      mm"
"      Runoff volume      61.86      161.20      223.06      c.m"
"      Runoff coefficient      0.349      0.909      0.629      "
"      Maximum flow      0.021      0.106      0.109      c.m/sec"
" 81      ADD COMMENT=====
"      3      Lines of comment"
"      *****
"      * TOTAL FLOW FROM EXISTING SITE AREA *
"      *****
" 40      HYDROGRAPH Add Runoff "
"      4      Add Runoff "
"          0.109      0.109      0.000      0.000"
" 51      PIPE DESIGN"
"      0.109 Current peak flow      c.m/sec"
"      0.013 Manning 'n'"
"      0.375 Diameter      metre"
"      1.000 Gradient      %"
"      Depth of flow      0.214      metre"
"      Velocity      1.673      m/sec"
"      Pipe capacity      0.175      c.m/sec"
"      Critical depth      0.243      metre"
" 53      ROUTE Zero Route"
"      0.00 Zero Route Reach length      ( metre)"
"          0.109      0.109      0.109      0.000 c.m/sec"
" 40      HYDROGRAPH Combine 1"
"      6      Combine "
"      1      Node #"
"      Runoff from existing site"
"      Maximum flow      0.109      c.m/sec"
"      Hydrograph volume      223.064      c.m"
"          0.109      0.109      0.109      0.109"
" 40      HYDROGRAPH Start - New Tributary"
"      2      Start - New Tributary"
"          0.109      0.000      0.109      0.109"
" 81      ADD COMMENT=====
"      3      Lines of comment"
"      *****
"      * PROPOSED CONDITIONS *
"      *****
" 81      ADD COMMENT=====
"      3      Lines of comment"
"      *****
"      * AREA 200 - ROOFTOP SWM STORAGE AREA *
"      *****
" 33      CATCHMENT 200"
"      1      Triangular SCS"
"      1      Equal length"
"      1      SCS method"
"      200      200- Rooftop stormwater storage"
" 100.000 % Impervious"

```



```

"      0.140  Total Area"
" 20.000  Flow length"
"      1.000  Overland Slope"
"      0.000  Pervious Area"
" 20.000  Pervious length"
"      1.000  Pervious slope"
"      0.140  Impervious Area"
" 20.000  Impervious length"
"      1.000  Impervious slope"
"      0.250  Pervious Manning 'n'"
" 75.000  Pervious SCS Curve No."
"      0.000  Pervious Runoff coefficient"
"      0.100  Pervious Ia/S coefficient"
"      8.467  Pervious Initial abstraction"
"      0.015  Impervious Manning 'n'"
" 98.000  Impervious SCS Curve No."
"      0.909  Impervious Runoff coefficient"
"      0.100  Impervious Ia/S coefficient"
"      0.518  Impervious Initial abstraction"
"          0.059      0.000      0.109      0.109 c.m/sec"
"      Catchment 200      Pervious      Impervious      Total Area "
"      Surface Area      0.000      0.140      0.140      hectare"
"      Time of concentration      13.791      1.691      1.691      minutes"
"      Time to Centroid      115.937      88.619      88.619      minutes"
"      Rainfall depth      68.724      68.724      68.724      mm"
"      Rainfall volume      0.00      96.21      96.21      c.m"
"      Rainfall losses      43.739      6.244      6.244      mm"
"      Runoff depth      24.985      62.480      62.480      mm"
"      Runoff volume      0.00      87.47      87.47      c.m"
"      Runoff coefficient      0.000      0.909      0.909      "
"      Maximum flow      0.000      0.059      0.059      c.m/sec"
" 40      HYDROGRAPH Add Runoff "
"      4      Add Runoff "
"          0.059      0.059      0.109      0.109"
" 81      ADD COMMENT=====
"      3      Lines of comment"
"      *****
"      * CONTROLLED - ROOFTOP SWM STORAGE * "
"      *****
" 54      POND DESIGN"
"      0.059  Current peak flow      c.m/sec"
"      0.020  Target outflow      c.m/sec"
"      87.5   Hydrograph volume      c.m"
"      7.     Number of stages"
"      0.000  Minimum water level      metre"
"      0.152  Maximum water level      metre"
"      0.000  Starting water level      metre"
"      0      Keep Design Data: 1 = True; 0 = False"
"          Level Discharge      Volume"
"          0.000      0.000      0.000"
"          0.02540      0.00418      0.3300"
"          0.05080      0.00836      2.630"
"          0.07620      0.01254      8.890"
"          0.1016      0.01672      21.070"
"          0.1270      0.02090      41.160"
"          0.1524      0.02508      74.120"
"      Peak outflow      0.019      c.m/sec"
"      Maximum level      0.114      metre"
"      Maximum storage      30.705      c.m"
"      Centroidal lag      1.747      hours"
"          0.059      0.059      0.019      0.109 c.m/sec"
" 40      HYDROGRAPH Combine      2"
"      6      Combine "
"      2      Node #"
"      Runoff to underground storage tank"
"      Maximum flow      0.019      c.m/sec"

```

```

122727-3Ch25REV.OUT
"      Hydrograph volume      87.385      c.m"
"      0.059      0.059      0.019      0.019"
" 40      HYDROGRAPH Start - New Tributary"
"      2      Start - New Tributary"
"      0.059      0.000      0.019      0.019"
" 81      ADD COMMENT=====
"      3      Lines of comment"
"      ***** "
"      * AREA 201 - ROOFTOP AREA WITHOUT SWM STORAGE * "
"      *****"
" 33      CATCHMENT 201"
"      1      Triangular SCS"
"      1      Equal length"
"      1      SCS method"
"      201      201- Rooftop without storage"
"      100.000      % Impervious"
"      0.161      Total Area"
"      20.000      Flow length"
"      1.000      Overland Slope"
"      0.000      Pervious Area"
"      20.000      Pervious length"
"      1.000      Pervious slope"
"      0.161      Impervious Area"
"      20.000      Impervious length"
"      1.000      Impervious slope"
"      0.250      Pervious Manning 'n'"
"      75.000      Pervious SCS Curve No."
"      0.000      Pervious Runoff coefficient"
"      0.100      Pervious Ia/S coefficient"
"      8.467      Pervious Initial abstraction"
"      0.015      Impervious Manning 'n'"
"      98.000      Impervious SCS Curve No."
"      0.909      Impervious Runoff coefficient"
"      0.100      Impervious Ia/S coefficient"
"      0.518      Impervious Initial abstraction"
"      0.068      0.000      0.019      0.019 c.m/sec"
"      Catchment 201      Pervious      Impervious      Total Area "
"      Surface Area      0.000      0.161      0.161      hectare"
"      Time of concentration      13.791      1.691      1.691      minutes"
"      Time to Centroid      115.937      88.619      88.619      minutes"
"      Rainfall depth      68.724      68.724      68.724      mm"
"      Rainfall volume      0.00      110.65      110.65      c.m"
"      Rainfall losses      43.739      6.244      6.244      mm"
"      Runoff depth      24.985      62.480      62.480      mm"
"      Runoff volume      0.00      100.59      100.59      c.m"
"      Runoff coefficient      0.000      0.909      0.909      "
"      Maximum flow      0.000      0.068      0.068      c.m/sec"
" 40      HYDROGRAPH Add Runoff "
"      4      Add Runoff "
"      0.068      0.068      0.019      0.019"
" 51      PIPE DESIGN"
"      0.068      Current peak flow      c.m/sec"
"      0.013      Manning 'n'"
"      0.375      Diameter      metre"
"      1.000      Gradient      %"
"      Depth of flow      0.162      metre"
"      Velocity      1.486      m/sec"
"      Pipe capacity      0.175      c.m/sec"
"      Critical depth      0.190      metre"
" 53      ROUTE Zero Route"
"      0.00      Zero Route Reach length      ( metre)"
"      0.068      0.068      0.068      0.019 c.m/sec"
" 40      HYDROGRAPH Combine      2"
"      6      Combine "
"      2      Node #"
"      Runoff to underground storage tank"

```

```

122727-3Ch25REV.OUT
"      Maximum flow      0.082      c.m/sec"
"      Hydrograph volume  187.978      c.m"
"      0.068      0.068      0.068      0.082"
" 40      HYDROGRAPH Start - New Tributary"
"      2      Start - New Tributary"
"      0.068      0.000      0.068      0.082"
" 81      ADD COMMENT=====
"      3      Lines of comment"
"      *****
"      * AREA 202 - COURTYARD AREA * "
"      *****
" 33      CATCHMENT 202"
"      1      Triangular SCS"
"      1      Equal length"
"      1      SCS method"
"      202      202- Courtyard"
"      65.000      % Impervious"
"      0.062      Total Area"
"      10.000      Flow length"
"      2.000      Overland Slope"
"      0.022      Pervious Area"
"      10.000      Pervious length"
"      2.000      Pervious slope"
"      0.040      Impervious Area"
"      10.000      Impervious length"
"      2.000      Impervious slope"
"      0.250      Pervious Manning 'n'"
"      74.000      Pervious SCS Curve No."
"      0.348      Pervious Runoff coefficient"
"      0.100      Pervious Ia/S coefficient"
"      8.924      Pervious Initial abstraction"
"      0.015      Impervious Manning 'n'"
"      98.000      Impervious SCS Curve No."
"      0.887      Impervious Runoff coefficient"
"      0.100      Impervious Ia/S coefficient"
"      0.518      Impervious Initial abstraction"
"      0.018      0.000      0.068      0.082 c.m/sec"
"      Catchment 202      Pervious      Impervious      Total Area "
"      Surface Area      0.022      0.040      0.062      hectare"
"      Time of concentration      7.553      0.906      2.065      minutes"
"      Time to Centroid      108.279      87.524      91.141      minutes"
"      Rainfall depth      68.724      68.724      68.724      mm"
"      Rainfall volume      14.91      27.70      42.61      c.m"
"      Rainfall losses      44.836      7.781      20.750      mm"
"      Runoff depth      23.888      60.944      47.974      mm"
"      Runoff volume      5.18      24.56      29.74      c.m"
"      Runoff coefficient      0.348      0.887      0.698      "
"      Maximum flow      0.003      0.018      0.018      c.m/sec"
" 40      HYDROGRAPH Add Runoff "
"      4      Add Runoff "
"      0.018      0.018      0.068      0.082"
" 51      PIPE DESIGN"
"      0.018      Current peak flow      c.m/sec"
"      0.013      Manning 'n'"
"      0.300      Diameter      metre"
"      0.400      Gradient      %"
"      Depth of flow      0.113      metre"
"      Velocity      0.757      m/sec"
"      Pipe capacity      0.061      c.m/sec"
"      Critical depth      0.103      metre"
" 53      ROUTE Zero Route"
"      0.00      Zero Route Reach length      ( metre)"
"      0.018      0.018      0.018      0.082 c.m/sec"
" 40      HYDROGRAPH Combine      2"
"      6      Combine "
"      2      Node #"

```

```

"      Runoff to underground storage tank"
"      Maximum flow          0.100    c.m/sec"
"      Hydrograph volume     217.722  c.m"
"      0.018    0.018    0.018    0.100"
" 81  ADD COMMENT=====
"      3  Lines of comment"
"      *****
"      * CONTROLLED - UNDERGROUND SWM STORAGE TANK * "
"      *****
" 40  HYDROGRAPH Confluence  2"
"      7  Confluence "
"      2  Node #"
"      Runoff to underground storage tank"
"      Maximum flow          0.100    c.m/sec"
"      Hydrograph volume     217.722  c.m"
"      0.018    0.100    0.018    0.000"
" 54  POND DESIGN"
"      0.100  Current peak flow  c.m/sec"
"      0.001  Target outflow    c.m/sec"
"      217.7  Hydrograph volume  c.m"
"      18.    Number of stages"
"      0.000  Minimum water level  metre"
"      3.550  Maximum water level  metre"
"      0.000  Starting water level  metre"
"      0      Keep Design Data: 1 = True; 0 = False"
"      Level Discharge  Volume"
"      0.000    0.000    0.000"
"      0.05000  0.00140  17.000"
"      0.1000  0.00180  33.900"
"      0.1500  0.00220  50.900"
"      0.2500  0.00270  84.900"
"      0.3500  0.00320  118.800"
"      0.4500  0.00360  152.800"
"      0.5500  0.00400  186.700"
"      0.6500  0.00430  220.700"
"      0.7500  0.00460  254.600"
"      0.8000  0.00470  271.600"
"      3.050  0.00910  271.800"
"      3.100  0.00920  272.000"
"      3.150  0.00930  272.200"
"      3.200  0.00940  272.400"
"      3.250  0.00940  272.600"
"      3.300  0.00950  272.800"
"      3.350  0.00960  273.000"
"      Peak outflow          0.004    c.m/sec"
"      Maximum level         0.560    metre"
"      Maximum storage       189.955  c.m"
"      Centroidal lag        10.646  hours"
"      0.018    0.100    0.004    0.000 c.m/sec"
" 40  HYDROGRAPH Next link "
"      5  Next link "
"      0.018    0.004    0.004    0.000"
" 81  ADD COMMENT=====
"      3  Lines of comment"
"      *****
"      * AREA 203 - UNCONSTROLLED LAND AREA * "
"      *****
" 33  CATCHMENT 203"
"      1  Triangular SCS"
"      1  Equal length"
"      1  SCS method"
"      203  203- Uncontrolled land"
"      35.000 % Impervious"
"      0.153  Total Area"
"      10.000 Flow length"
"      2.000 Overland Slope"

```

```

"      0.099 Pervious Area"
"    10.000 Pervious length"
"      2.000 Pervious slope"
"      0.054 Impervious Area"
"    10.000 Impervious length"
"      2.000 Impervious slope"
"      0.250 Pervious Manning 'n'"
"    74.000 Pervious SCS Curve No."
"      0.348 Pervious Runoff coefficient"
"      0.100 Pervious Ia/S coefficient"
"      8.924 Pervious Initial abstraction"
"      0.015 Impervious Manning 'n'"
"    98.000 Impervious SCS Curve No."
"      0.887 Impervious Runoff coefficient"
"      0.100 Impervious Ia/S coefficient"
"      0.518 Impervious Initial abstraction"
"          0.027      0.004      0.004      0.000 c.m/sec"
"      Catchment 203      Pervious      Impervious      Total Area  "
"      Surface Area      0.099      0.054      0.153      hectare"
"      Time of concentration 7.553      0.906      3.706      minutes"
"      Time to Centroid    108.279      87.524      96.268      minutes"
"      Rainfall depth      68.724      68.724      68.724      mm"
"      Rainfall volume      68.35      36.80      105.15      c.m"
"      Rainfall losses      44.836      7.781      31.866      mm"
"      Runoff depth      23.888      60.944      36.858      mm"
"      Runoff volume      23.76      32.64      56.39      c.m"
"      Runoff coefficient    0.348      0.887      0.536      "
"      Maximum flow      0.012      0.023      0.027      c.m/sec"
" 81      ADD COMMENT=====
"      3 Lines of comment"
"      *****
"      * TOTAL FLOW FROM PROPOSED SITE AREA *
"      *****
" 40      HYDROGRAPH Add Runoff "
"      4 Add Runoff "
"          0.027      0.029      0.004      0.000"
" 38      START/RE-START TOTALS 203"
"      3 Runoff Totals on EXIT"
"      Total Catchment area      1.032      hectare"
"      Total Impervious area      0.653      hectare"
"      Total % impervious      63.261"
" 19      EXIT"

```

```

"          MIDUSS Output ----->"
"          MIDUSS version                      Version 2.25 rev. 473"
"          MIDUSS created                      Sunday, February 7, 2010"
"      10  Units used:                          ie METRIC"
"          Job folder:                        \\caneast.ibigroup.com\J\WT\"
"          122727_1107MainStW\7.0_Production\7.99_Submitted\FSR\Appendix B\SWM\May 2021"
"          Output filename:                    122727-3Ch50REV.OUT"
"          Licensee name:                      install"
"          Company                            IBI Group"
"          Date & Time last used:              2021-05-26 at 1:39:13 PM"
" 81      ADD COMMENT=====
"      6  Lines of comment"
"          *****"
"          * 122727 - 1107 MAIN STREET WEST      *"
"          * CITY OF HAMILTON                    *"
"          * IBI GROUP                          *"
"          * JANUARY 2020 - REVISED MAY 2021     *"
"          *****"
" 31      TIME PARAMETERS"
"          5.000 Time Step"
"          180.000 Max. Storm length"
"          3600.000 Max. Hydrograph"
" 81      ADD COMMENT=====
"          4  Lines of comment"
"          *****"
"          * 50 YEAR CHICAGO STORM              *"
"          * MOUNT HOPE IDF PARAMETERS          *"
"          *****"
" 32      STORM Chicago storm"
"          1  Chicago storm"
"          1954.800 Coefficient A"
"          10.000 Constant B"
"          0.826 Exponent C"
"          0.400 Fraction R"
"          180.000 Duration"
"          1.000 Time step multiplier"
"          Maximum intensity          208.762 mm/hr"
"          Total depth                76.908 mm"
"          6  050hyd Hydrograph extension used in this file"
" 81      ADD COMMENT=====
"          3  Lines of comment"
"          *****"
"          * EXISTING CONDITIONS              *"
"          *****"
" 81      ADD COMMENT=====
"          3  Lines of comment"
"          *****"
"          * AREA 101 - EXISTING SITE AREA    *"
"          *****"
" 33      CATCHMENT 101"
"          1  Triangular SCS"
"          1  Equal length"
"          1  SCS method"
"          101 101- Exisitng site"
"          50.000 % Impervious"
"          0.516 Total Area"
"          40.000 Flow length"
"          2.000 Overland Slope"
"          0.258 Pervious Area"
"          40.000 Pervious length"
"          2.000 Pervious slope"
"          0.258 Impervious Area"
"          40.000 Impervious length"
"          2.000 Impervious slope"
"          0.250 Pervious Manning 'n'"
"          74.000 Pervious SCS Curve No."

```

```

"      0.381 Pervious Runoff coefficient"
"      0.100 Pervious Ia/S coefficient"
"      8.924 Pervious Initial abstraction"
"      0.015 Impervious Manning 'n'"
" 98.000 Impervious SCS Curve No."
"      0.917 Impervious Runoff coefficient"
"      0.100 Impervious Ia/S coefficient"
"      0.518 Impervious Initial abstraction"
"          0.125      0.000      0.000      0.000 c.m/sec"
"      Catchment 101      Pervious      Impervious      Total Area "
"      Surface Area      0.258      0.258      0.516      hectare"
"      Time of concentration      15.802      1.980      6.041      minutes"
"      Time to Centroid      118.106      88.795      97.406      minutes"
"      Rainfall depth      76.908      76.908      76.908      mm"
"      Rainfall volume      198.42      198.42      396.85      c.m"
"      Rainfall losses      47.583      6.412      26.998      mm"
"      Runoff depth      29.325      70.496      49.911      mm"
"      Runoff volume      75.66      181.88      257.54      c.m"
"      Runoff coefficient      0.381      0.917      0.649      "
"      Maximum flow      0.028      0.120      0.125      c.m/sec"
" 81      ADD COMMENT=====
"      3      Lines of comment"
"      *****
"      * TOTAL FLOW FROM EXISTING SITE AREA *
"      *****
" 40      HYDROGRAPH Add Runoff "
"      4      Add Runoff "
"          0.125      0.125      0.000      0.000"
" 51      PIPE DESIGN"
"      0.125      Current peak flow      c.m/sec"
"      0.013      Manning 'n'"
"      0.375      Diameter      metre"
"      1.000      Gradient      %"
"      Depth of flow      0.234      metre"
"      Velocity      1.724      m/sec"
"      Pipe capacity      0.175      c.m/sec"
"      Critical depth      0.261      metre"
" 53      ROUTE Zero Route"
"      0.00      Zero Route Reach length      ( metre)"
"          0.125      0.125      0.125      0.000 c.m/sec"
" 40      HYDROGRAPH Combine 1"
"      6      Combine "
"      1      Node #"
"      Runoff from existing site"
"      Maximum flow      0.125      c.m/sec"
"      Hydrograph volume      257.539      c.m"
"          0.125      0.125      0.125      0.125"
" 40      HYDROGRAPH Start - New Tributary"
"      2      Start - New Tributary"
"          0.125      0.000      0.125      0.125"
" 81      ADD COMMENT=====
"      3      Lines of comment"
"      *****
"      * PROPOSED CONDITIONS *
"      *****
" 81      ADD COMMENT=====
"      3      Lines of comment"
"      *****
"      * AREA 200 - ROOFTOP SWM STORAGE AREA *
"      *****
" 33      CATCHMENT 200"
"      1      Triangular SCS"
"      1      Equal length"
"      1      SCS method"
"      200      200- Rooftop stormwater storage"
" 100.000      % Impervious"

```

```

"      0.140  Total Area"
" 20.000  Flow length"
"      1.000  Overland Slope"
"      0.000  Pervious Area"
" 20.000  Pervious length"
"      1.000  Pervious slope"
"      0.140  Impervious Area"
" 20.000  Impervious length"
"      1.000  Impervious slope"
"      0.250  Pervious Manning 'n'"
" 75.000  Pervious SCS Curve No."
"      0.000  Pervious Runoff coefficient"
"      0.100  Pervious Ia/S coefficient"
"      8.467  Pervious Initial abstraction"
"      0.015  Impervious Manning 'n'"
" 98.000  Impervious SCS Curve No."
"      0.917  Impervious Runoff coefficient"
"      0.100  Impervious Ia/S coefficient"
"      0.518  Impervious Initial abstraction"
"          0.067      0.000      0.125      0.125 c.m/sec"
"      Catchment 200      Pervious      Impervious      Total Area "
"      Surface Area      0.000      0.140      0.140      hectare"
"      Time of concentration      12.582      1.609      1.609      minutes"
"      Time to Centroid      113.690      88.202      88.202      minutes"
"      Rainfall depth      76.908      76.908      76.908      mm"
"      Rainfall volume      0.00      107.67      107.67      c.m"
"      Rainfall losses      46.385      6.417      6.417      mm"
"      Runoff depth      30.524      70.491      70.491      mm"
"      Runoff volume      0.00      98.69      98.69      c.m"
"      Runoff coefficient      0.000      0.917      0.917      "
"      Maximum flow      0.000      0.067      0.067      c.m/sec"
" 40      HYDROGRAPH Add Runoff "
"      4      Add Runoff "
"          0.067      0.067      0.125      0.125"
" 81      ADD COMMENT=====
"      3      Lines of comment"
"      *****
"      * CONTROLLED - ROOFTOP SWM STORAGE * "
"      *****
" 54      POND DESIGN"
"      0.067      Current peak flow      c.m/sec"
"      0.020      Target outflow      c.m/sec"
"      98.7      Hydrograph volume      c.m"
"      7.      Number of stages"
"      0.000      Minimum water level      metre"
"      0.152      Maximum water level      metre"
"      0.000      Starting water level      metre"
"      0      Keep Design Data: 1 = True; 0 = False"
"          Level Discharge      Volume"
"          0.000      0.000      0.000"
"          0.02540      0.00418      0.3300"
"          0.05080      0.00836      2.630"
"          0.07620      0.01254      8.890"
"          0.1016      0.01672      21.070"
"          0.1270      0.02090      41.160"
"          0.1524      0.02508      74.120"
"      Peak outflow      0.020      c.m/sec"
"      Maximum level      0.121      metre"
"      Maximum storage      36.436      c.m"
"      Centroidal lag      1.775      hours"
"          0.067      0.067      0.020      0.125 c.m/sec"
" 40      HYDROGRAPH Combine      2"
"      6      Combine "
"      2      Node #"
"      Runoff to underground storage tank"
"      Maximum flow      0.020      c.m/sec"

```



```

122727-3Ch50REV.OUT
"      Hydrograph volume      98.672      c.m"
"      0.067      0.067      0.020      0.020"
" 40      HYDROGRAPH Start - New Tributary"
"      2      Start - New Tributary"
"      0.067      0.000      0.020      0.020"
" 81      ADD COMMENT=====
"      3      Lines of comment"
"      ***** "
"      * AREA 201 - ROOFTOP AREA WITHOUT SWM STORAGE * "
"      *****"
" 33      CATCHMENT 201"
"      1      Triangular SCS"
"      1      Equal length"
"      1      SCS method"
"      201      201- Rooftop without storage"
" 100.000 % Impervious"
"      0.161      Total Area"
"      20.000      Flow length"
"      1.000      Overland Slope"
"      0.000      Pervious Area"
"      20.000      Pervious length"
"      1.000      Pervious slope"
"      0.161      Impervious Area"
"      20.000      Impervious length"
"      1.000      Impervious slope"
"      0.250      Pervious Manning 'n'"
"      75.000      Pervious SCS Curve No."
"      0.000      Pervious Runoff coefficient"
"      0.100      Pervious Ia/S coefficient"
"      8.467      Pervious Initial abstraction"
"      0.015      Impervious Manning 'n'"
"      98.000      Impervious SCS Curve No."
"      0.917      Impervious Runoff coefficient"
"      0.100      Impervious Ia/S coefficient"
"      0.518      Impervious Initial abstraction"
"      0.077      0.000      0.020      0.020 c.m/sec"
"      Catchment 201      Pervious      Impervious      Total Area "
"      Surface Area      0.000      0.161      0.161      hectare"
"      Time of concentration      12.582      1.609      1.609      minutes"
"      Time to Centroid      113.690      88.202      88.202      minutes"
"      Rainfall depth      76.908      76.908      76.908      mm"
"      Rainfall volume      0.00      123.82      123.82      c.m"
"      Rainfall losses      46.385      6.417      6.417      mm"
"      Runoff depth      30.524      70.491      70.491      mm"
"      Runoff volume      0.00      113.49      113.49      c.m"
"      Runoff coefficient      0.000      0.917      0.917      "
"      Maximum flow      0.000      0.077      0.077      c.m/sec"
" 40      HYDROGRAPH Add Runoff "
"      4      Add Runoff "
"      0.077      0.077      0.020      0.020"
" 51      PIPE DESIGN"
"      0.077      Current peak flow      c.m/sec"
"      0.013      Manning 'n'"
"      0.375      Diameter      metre"
"      1.000      Gradient      %"
"      Depth of flow      0.174      metre"
"      Velocity      1.538      m/sec"
"      Pipe capacity      0.175      c.m/sec"
"      Critical depth      0.203      metre"
" 53      ROUTE Zero Route"
"      0.00      Zero Route Reach length      ( metre)"
"      0.077      0.077      0.077      0.020 c.m/sec"
" 40      HYDROGRAPH Combine      2"
"      6      Combine "
"      2      Node #"
"      Runoff to underground storage tank"

```

```

122727-3Ch50REV.OUT
"      Maximum flow      0.093      c.m/sec"
"      Hydrograph volume  212.162      c.m"
"      0.077      0.077      0.077      0.093"
" 40      HYDROGRAPH Start - New Tributary"
"      2      Start - New Tributary"
"      0.077      0.000      0.077      0.093"
" 81      ADD COMMENT=====
"      3      Lines of comment"
"      *****
"      * AREA 202 - COURTYARD AREA * "
"      *****
" 33      CATCHMENT 202"
"      1      Triangular SCS"
"      1      Equal length"
"      1      SCS method"
"      202      202- Courtyard"
"      65.000      % Impervious"
"      0.062      Total Area"
"      10.000      Flow length"
"      2.000      Overland Slope"
"      0.022      Pervious Area"
"      10.000      Pervious length"
"      2.000      Pervious slope"
"      0.040      Impervious Area"
"      10.000      Impervious length"
"      2.000      Impervious slope"
"      0.250      Pervious Manning 'n'"
"      74.000      Pervious SCS Curve No."
"      0.379      Pervious Runoff coefficient"
"      0.100      Pervious Ia/S coefficient"
"      8.924      Pervious Initial abstraction"
"      0.015      Impervious Manning 'n'"
"      98.000      Impervious SCS Curve No."
"      0.891      Impervious Runoff coefficient"
"      0.100      Impervious Ia/S coefficient"
"      0.518      Impervious Initial abstraction"
"      0.021      0.000      0.077      0.093 c.m/sec"
"      Catchment 202      Pervious      Impervious      Total Area "
"      Surface Area      0.022      0.040      0.062      hectare"
"      Time of concentration      6.878      0.862      1.982      minutes"
"      Time to Centroid      106.727      87.204      90.839      minutes"
"      Rainfall depth      76.908      76.908      76.908      mm"
"      Rainfall volume      16.69      30.99      47.68      c.m"
"      Rainfall losses      47.780      8.361      22.157      mm"
"      Runoff depth      29.129      68.548      54.751      mm"
"      Runoff volume      6.32      27.62      33.95      c.m"
"      Runoff coefficient      0.379      0.891      0.712      "
"      Maximum flow      0.003      0.020      0.021      c.m/sec"
" 40      HYDROGRAPH Add Runoff "
"      4      Add Runoff "
"      0.021      0.021      0.077      0.093"
" 51      PIPE DESIGN"
"      0.021      Current peak flow      c.m/sec"
"      0.013      Manning 'n'"
"      0.300      Diameter      metre"
"      0.400      Gradient      %"
"      Depth of flow      0.122      metre"
"      Velocity      0.787      m/sec"
"      Pipe capacity      0.061      c.m/sec"
"      Critical depth      0.111      metre"
" 53      ROUTE Zero Route"
"      0.00      Zero Route Reach length      ( metre)"
"      0.021      0.021      0.021      0.093 c.m/sec"
" 40      HYDROGRAPH Combine      2"
"      6      Combine "
"      2      Node #"

```

```

"      Runoff to underground storage tank"
"      Maximum flow          0.114      c.m/sec"
"      Hydrograph volume     246.107    c.m"
"      0.021      0.021      0.021      0.114"
" 81  ADD COMMENT=====
"      3  Lines of comment"
"      *****
"      * CONTROLLED - UNDERGROUND SWM STORAGE TANK * "
"      *****
" 40  HYDROGRAPH Confluence  2"
"      7  Confluence "
"      2  Node #"
"      Runoff to underground storage tank"
"      Maximum flow          0.114      c.m/sec"
"      Hydrograph volume     246.107    c.m"
"      0.021      0.114      0.021      0.000"
" 54  POND DESIGN"
"      0.114  Current peak flow  c.m/sec"
"      0.001  Target outflow    c.m/sec"
"      246.1  Hydrograph volume  c.m"
"      18.    Number of stages"
"      0.000  Minimum water level  metre"
"      3.550  Maximum water level  metre"
"      0.000  Starting water level  metre"
"      0      Keep Design Data: 1 = True; 0 = False"
"      Level Discharge  Volume"
"      0.000      0.000      0.000"
"      0.05000  0.00140      17.000"
"      0.1000  0.00180      33.900"
"      0.1500  0.00220      50.900"
"      0.2500  0.00270      84.900"
"      0.3500  0.00320     118.800"
"      0.4500  0.00360     152.800"
"      0.5500  0.00400     186.700"
"      0.6500  0.00430     220.700"
"      0.7500  0.00460     254.600"
"      0.8000  0.00470     271.600"
"      3.050   0.00910     271.800"
"      3.100   0.00920     272.000"
"      3.150   0.00930     272.200"
"      3.200   0.00940     272.400"
"      3.250   0.00940     272.600"
"      3.300   0.00950     272.800"
"      3.350   0.00960     273.000"
"      Peak outflow          0.004      c.m/sec"
"      Maximum level         0.638      metre"
"      Maximum storage       216.594    c.m"
"      Centroidal lag        11.249    hours"
"      0.021      0.114      0.004      0.000 c.m/sec"
" 40  HYDROGRAPH Next link "
"      5  Next link "
"      0.021      0.004      0.004      0.000"
" 81  ADD COMMENT=====
"      3  Lines of comment"
"      *****
"      * AREA 203 - UNCONSTROLLED LAND AREA * "
"      *****
" 33  CATCHMENT 203"
"      1  Triangular SCS"
"      1  Equal length"
"      1  SCS method"
"      203  203- Uncontrolled land"
"      35.000 % Impervious"
"      0.153  Total Area"
"      10.000 Flow length"
"      2.000  Overland Slope"

```

```

"      0.099 Pervious Area"
"    10.000 Pervious length"
"      2.000 Pervious slope"
"      0.054 Impervious Area"
"    10.000 Impervious length"
"      2.000 Impervious slope"
"      0.250 Pervious Manning 'n'"
"    74.000 Pervious SCS Curve No."
"      0.379 Pervious Runoff coefficient"
"      0.100 Pervious Ia/S coefficient"
"      8.924 Pervious Initial abstraction"
"      0.015 Impervious Manning 'n'"
"    98.000 Impervious SCS Curve No."
"      0.891 Impervious Runoff coefficient"
"      0.100 Impervious Ia/S coefficient"
"      0.518 Impervious Initial abstraction"
"          0.032      0.004      0.004      0.000 c.m/sec"
"      Catchment 203      Pervious      Impervious      Total Area  "
"      Surface Area      0.099      0.054      0.153      hectare"
"      Time of concentration 6.878      0.862      3.516      minutes"
"      Time to Centroid 106.727      87.204      95.815      minutes"
"      Rainfall depth      76.908      76.908      76.908      mm"
"      Rainfall volume      76.49      41.18      117.67      c.m"
"      Rainfall losses      47.780      8.361      33.983      mm"
"      Runoff depth      29.129      68.548      42.925      mm"
"      Runoff volume      28.97      36.71      65.68      c.m"
"      Runoff coefficient      0.379      0.891      0.558      "
"      Maximum flow      0.016      0.027      0.032      c.m/sec"
" 81      ADD COMMENT=====
"      3 Lines of comment"
"      *****
"      * TOTAL FLOW FROM PROPOSED SITE AREA *
"      *****
" 40      HYDROGRAPH Add Runoff "
"      4 Add Runoff "
"          0.032      0.035      0.004      0.000"
" 38      START/RE-START TOTALS 203"
"      3 Runoff Totals on EXIT"
"      Total Catchment area      1.032      hectare"
"      Total Impervious area      0.653      hectare"
"      Total % impervious      63.261"
" 19      EXIT"

```

```

"          MIDUSS Output ----->"
"          MIDUSS version                      Version 2.25 rev. 473"
"          MIDUSS created                      Sunday, February 7, 2010"
"      10  Units used:                          ie METRIC"
"          Job folder:                        \\caneast.ibigroup.com\J\WT\"
"          122727_1107MainStW\7.0_Production\7.99_Submitted\FSR\Appendix B\SWM\May 2021"
"          Output filename:                    122727-3Ch100REV.OUT"
"          Licensee name:                      install"
"          Company                            IBI Group"
"          Date & Time last used:              2021-05-26 at 1:37:23 PM"
" 81      ADD COMMENT=====
"      6  Lines of comment"
"          *****"
"          * 122727 - 1107 MAIN STREET WEST      *"
"          * CITY OF HAMILTON                    *"
"          * IBI GROUP                          *"
"          * JANUARY 2020 - REVISED MAY 2021     *"
"          *****"
" 31      TIME PARAMETERS"
"          5.000  Time Step"
"          180.000 Max. Storm length"
"          3600.000 Max. Hydrograph"
" 81      ADD COMMENT=====
"          4  Lines of comment"
"          *****"
"          * 100 YEAR CHICAGO STORM      *"
"          * MOUNT HOPE IDF PARAMETERS  *"
"          *****"
" 32      STORM Chicago storm"
"          1  Chicago storm"
"          2317.400 Coefficient A"
"          11.000  Constant B"
"          0.836  Exponent C"
"          0.400  Fraction R"
"          180.000 Duration"
"          1.000  Time step multiplier"
"          Maximum intensity      228.222  mm/hr"
"          Total depth            86.135  mm"
"          6  100hyd Hydrograph extension used in this file"
" 81      ADD COMMENT=====
"          3  Lines of comment"
"          *****"
"          * EXISTING CONDITIONS  *"
"          *****"
" 81      ADD COMMENT=====
"          3  Lines of comment"
"          *****"
"          * AREA 101 - EXISTING SITE AREA  *"
"          *****"
" 33      CATCHMENT 101"
"          1  Triangular SCS"
"          1  Equal length"
"          1  SCS method"
"          101 101- Exisitng site"
"          50.000 % Impervious"
"          0.516  Total Area"
"          40.000 Flow length"
"          2.000  Overland Slope"
"          0.258  Pervious Area"
"          40.000 Pervious length"
"          2.000  Pervious slope"
"          0.258  Impervious Area"
"          40.000 Impervious length"
"          2.000  Impervious slope"
"          0.250  Pervious Manning 'n'"
"          74.000 Pervious SCS Curve No."

```

```

"      0.415 Pervious Runoff coefficient"
"      0.100 Pervious Ia/S coefficient"
"      8.924 Pervious Initial abstraction"
"      0.015 Impervious Manning 'n'"
" 98.000 Impervious SCS Curve No."
"      0.924 Impervious Runoff coefficient"
"      0.100 Impervious Ia/S coefficient"
"      0.518 Impervious Initial abstraction"
"              0.141      0.000      0.000      0.000 c.m/sec"
"      Catchment 101      Pervious      Impervious      Total Area      "
"      Surface Area      0.258      0.258      0.516      hectare"
"      Time of concentration      14.629      1.908      5.855      minutes"
"      Time to Centroid      115.787      88.362      96.871      minutes"
"      Rainfall depth      86.135      86.135      86.135      mm"
"      Rainfall volume      222.23      222.23      444.46      c.m"
"      Rainfall losses      50.350      6.577      28.463      mm"
"      Runoff depth      35.785      79.557      57.671      mm"
"      Runoff volume      92.33      205.26      297.58      c.m"
"      Runoff coefficient      0.415      0.924      0.670      "
"      Maximum flow      0.036      0.133      0.141      c.m/sec"
" 81      ADD COMMENT=====
"      3      Lines of comment"
"      *****
"      * TOTAL FLOW FROM EXISTING SITE AREA *
"      *****
" 40      HYDROGRAPH Add Runoff "
"      4      Add Runoff "
"              0.141      0.141      0.000      0.000"
" 51      PIPE DESIGN"
"      0.141      Current peak flow      c.m/sec"
"      0.013      Manning 'n'"
"      0.375      Diameter      metre"
"      1.000      Gradient      %"
"      Depth of flow      0.254      metre"
"      Velocity      1.764      m/sec"
"      Pipe capacity      0.175      c.m/sec"
"      Critical depth      0.276      metre"
" 53      ROUTE Zero Route"
"      0.00      Zero Route Reach length      ( metre)"
"              0.141      0.141      0.141      0.000 c.m/sec"
" 40      HYDROGRAPH Combine 1"
"      6      Combine "
"      1      Node #"
"      Runoff from existing site"
"      Maximum flow      0.141      c.m/sec"
"      Hydrograph volume      297.584      c.m"
"              0.141      0.141      0.141      0.141"
" 40      HYDROGRAPH Start - New Tributary"
"      2      Start - New Tributary"
"              0.141      0.000      0.141      0.141"
" 81      ADD COMMENT=====
"      3      Lines of comment"
"      *****
"      * PROPOSED CONDITIONS *
"      *****
" 81      ADD COMMENT=====
"      3      Lines of comment"
"      *****
"      * AREA 200 - ROOFTOP SWM STORAGE AREA *
"      *****
" 33      CATCHMENT 200"
"      1      Triangular SCS"
"      1      Equal length"
"      1      SCS method"
"      200      200- Rooftop stormwater storage"
" 100.000      % Impervious"

```

```

"      0.140 Total Area"
" 20.000 Flow length"
"      1.000 Overland Slope"
"      0.000 Pervious Area"
" 20.000 Pervious length"
"      1.000 Pervious slope"
"      0.140 Impervious Area"
" 20.000 Impervious length"
"      1.000 Impervious slope"
"      0.250 Pervious Manning 'n'"
" 75.000 Pervious SCS Curve No."
"      0.000 Pervious Runoff coefficient"
"      0.100 Pervious Ia/S coefficient"
"      8.467 Pervious Initial abstraction"
"      0.015 Impervious Manning 'n'"
" 98.000 Impervious SCS Curve No."
"      0.924 Impervious Runoff coefficient"
"      0.100 Impervious Ia/S coefficient"
"      0.518 Impervious Initial abstraction"
"          0.075      0.000      0.141      0.141 c.m/sec"
"      Catchment 200      Pervious      Impervious Total Area "
"      Surface Area      0.000      0.140      0.140      hectare"
"      Time of concentration      11.669      1.550      1.550      minutes"
"      Time to Centroid      111.711      87.838      87.838      minutes"
"      Rainfall depth      86.135      86.135      86.135      mm"
"      Rainfall volume      0.00      120.59      120.59      c.m"
"      Rainfall losses      49.069      6.578      6.579      mm"
"      Runoff depth      37.065      79.556      79.556      mm"
"      Runoff volume      0.00      111.38      111.38      c.m"
"      Runoff coefficient      0.000      0.924      0.924      "
"      Maximum flow      0.000      0.075      0.075      c.m/sec"
" 40 HYDROGRAPH Add Runoff "
"      4 Add Runoff "
"          0.075      0.075      0.141      0.141"
" 81 ADD COMMENT=====
"      3 Lines of comment"
"      *****
"      * CONTROLLED - ROOFTOP SWM STORAGE * "
"      *****
" 54 POND DESIGN"
"      0.075 Current peak flow      c.m/sec"
"      0.020 Target outflow      c.m/sec"
"      111.4 Hydrograph volume      c.m"
"      7. Number of stages"
"      0.000 Minimum water level      metre"
"      0.152 Maximum water level      metre"
"      0.000 Starting water level      metre"
"      0 Keep Design Data: 1 = True; 0 = False"
"          Level Discharge      Volume"
"          0.000      0.000      0.000"
"          0.02540      0.00418      0.3300"
"          0.05080      0.00836      2.630"
"          0.07620      0.01254      8.890"
"          0.1016      0.01672      21.070"
"          0.1270      0.02090      41.160"
"          0.1524      0.02508      74.120"
"      Peak outflow      0.021      c.m/sec"
"      Maximum level      0.128      metre"
"      Maximum storage      42.736      c.m"
"      Centroidal lag      1.808      hours"
"          0.075      0.075      0.021      0.141 c.m/sec"
" 40 HYDROGRAPH Combine 2"
"      6 Combine "
"      2 Node #"
"      Runoff to underground storage tank"
"      Maximum flow      0.021      c.m/sec"

```

```

122727-3Ch100REV.OUT
"      Hydrograph volume      111.429      c.m"
"      0.075      0.075      0.021      0.021"
" 40      HYDROGRAPH Start - New Tributary"
"      2      Start - New Tributary"
"      0.075      0.000      0.021      0.021"
" 81      ADD COMMENT=====
"      3      Lines of comment"
"      ***** "
"      * AREA 201 - ROOFTOP AREA WITHOUT SWM STORAGE * "
"      *****"
" 33      CATCHMENT 201"
"      1      Triangular SCS"
"      1      Equal length"
"      1      SCS method"
"      201      201- Rooftop without storage"
"      100.000      % Impervious"
"      0.161      Total Area"
"      20.000      Flow length"
"      1.000      Overland Slope"
"      0.000      Pervious Area"
"      20.000      Pervious length"
"      1.000      Pervious slope"
"      0.161      Impervious Area"
"      20.000      Impervious length"
"      1.000      Impervious slope"
"      0.250      Pervious Manning 'n'"
"      75.000      Pervious SCS Curve No."
"      0.000      Pervious Runoff coefficient"
"      0.100      Pervious Ia/S coefficient"
"      8.467      Pervious Initial abstraction"
"      0.015      Impervious Manning 'n'"
"      98.000      Impervious SCS Curve No."
"      0.924      Impervious Runoff coefficient"
"      0.100      Impervious Ia/S coefficient"
"      0.518      Impervious Initial abstraction"
"      0.086      0.000      0.021      0.021 c.m/sec"
"      Catchment 201      Pervious      Impervious Total Area "
"      Surface Area      0.000      0.161      0.161      hectare"
"      Time of concentration      11.669      1.550      1.550      minutes"
"      Time to Centroid      111.711      87.838      87.838      minutes"
"      Rainfall depth      86.135      86.135      86.135      mm"
"      Rainfall volume      0.00      138.68      138.68      c.m"
"      Rainfall losses      49.069      6.578      6.579      mm"
"      Runoff depth      37.065      79.556      79.556      mm"
"      Runoff volume      0.00      128.09      128.09      c.m"
"      Runoff coefficient      0.000      0.924      0.924      "
"      Maximum flow      0.000      0.086      0.086      c.m/sec"
" 40      HYDROGRAPH Add Runoff "
"      4      Add Runoff "
"      0.086      0.086      0.021      0.021"
" 51      PIPE DESIGN"
"      0.086      Current peak flow      c.m/sec"
"      0.013      Manning 'n'"
"      0.375      Diameter      metre"
"      1.000      Gradient      %"
"      Depth of flow      0.185      metre"
"      Velocity      1.579      m/sec"
"      Pipe capacity      0.175      c.m/sec"
"      Critical depth      0.214      metre"
" 53      ROUTE Zero Route"
"      0.00      Zero Route Reach length      ( metre)"
"      0.086      0.086      0.086      0.021 c.m/sec"
" 40      HYDROGRAPH Combine      2"
"      6      Combine "
"      2      Node #"
"      Runoff to underground storage tank"

```



```

122727-3Ch100REV.OUT
"      Maximum flow      0.102      c.m/sec"
"      Hydrograph volume  239.515      c.m"
"      0.086      0.086      0.086      0.102"
" 40      HYDROGRAPH Start - New Tributary"
"      2      Start - New Tributary"
"      0.086      0.000      0.086      0.102"
" 81      ADD COMMENT=====
"      3      Lines of comment"
"      *****
"      * AREA 202 - COURTYARD AREA * "
"      *****
" 33      CATCHMENT 202"
"      1      Triangular SCS"
"      1      Equal length"
"      1      SCS method"
"      202      202- Courtyard"
"      65.000      % Impervious"
"      0.062      Total Area"
"      10.000      Flow length"
"      2.000      Overland Slope"
"      0.022      Pervious Area"
"      10.000      Pervious length"
"      2.000      Pervious slope"
"      0.040      Impervious Area"
"      10.000      Impervious length"
"      2.000      Impervious slope"
"      0.250      Pervious Manning 'n'"
"      74.000      Pervious SCS Curve No."
"      0.412      Pervious Runoff coefficient"
"      0.100      Pervious Ia/S coefficient"
"      8.924      Pervious Initial abstraction"
"      0.015      Impervious Manning 'n'"
"      98.000      Impervious SCS Curve No."
"      0.896      Impervious Runoff coefficient"
"      0.100      Impervious Ia/S coefficient"
"      0.518      Impervious Initial abstraction"
"      0.024      0.000      0.086      0.102 c.m/sec"
"      Catchment 202      Pervious      Impervious      Total Area "
"      Surface Area      0.022      0.040      0.062      hectare"
"      Time of concentration  6.368      0.831      1.930      minutes"
"      Time to Centroid      105.229      86.939      90.572      minutes"
"      Rainfall depth      86.135      86.135      86.135      mm"
"      Rainfall volume      18.69      34.71      53.40      c.m"
"      Rainfall losses      50.622      8.985      23.558      mm"
"      Runoff depth      35.513      77.149      62.577      mm"
"      Runoff volume      7.71      31.09      38.80      c.m"
"      Runoff coefficient      0.412      0.896      0.726      "
"      Maximum flow      0.004      0.022      0.024      c.m/sec"
" 40      HYDROGRAPH Add Runoff "
"      4      Add Runoff "
"      0.024      0.024      0.086      0.102"
" 51      PIPE DESIGN"
"      0.024      Current peak flow      c.m/sec"
"      0.013      Manning 'n'"
"      0.300      Diameter      metre"
"      0.400      Gradient      %"
"      Depth of flow      0.130      metre"
"      Velocity      0.812      m/sec"
"      Pipe capacity      0.061      c.m/sec"
"      Critical depth      0.118      metre"
" 53      ROUTE Zero Route"
"      0.00      Zero Route Reach length      ( metre)"
"      0.024      0.024      0.024      0.102 c.m/sec"
" 40      HYDROGRAPH Combine      2"
"      6      Combine "
"      2      Node #"

```

```

"      Runoff to underground storage tank"
"      Maximum flow          0.126    c.m/sec"
"      Hydrograph volume     278.312  c.m"
"      0.024    0.024    0.024    0.126"
" 81  ADD COMMENT=====
"      3  Lines of comment"
"      *****
"      * CONTROLLED - UNDERGROUND SWM STORAGE TANK * "
"      *****
" 40  HYDROGRAPH Confluence  2"
"      7  Confluence "
"      2  Node #"
"      Runoff to underground storage tank"
"      Maximum flow          0.126    c.m/sec"
"      Hydrograph volume     278.312  c.m"
"      0.024    0.126    0.024    0.000"
" 54  POND DESIGN"
"      0.126  Current peak flow  c.m/sec"
"      0.001  Target outflow    c.m/sec"
"      278.3  Hydrograph volume  c.m"
"      18.    Number of stages"
"      0.000  Minimum water level  metre"
"      3.550  Maximum water level  metre"
"      0.000  Starting water level  metre"
"      0      Keep Design Data: 1 = True; 0 = False"
"      Level Discharge  Volume"
"      0.000    0.000    0.000"
"      0.05000  0.00140  17.000"
"      0.1000  0.00180  33.900"
"      0.1500  0.00220  50.900"
"      0.2500  0.00270  84.900"
"      0.3500  0.00320  118.800"
"      0.4500  0.00360  152.800"
"      0.5500  0.00400  186.700"
"      0.6500  0.00430  220.700"
"      0.7500  0.00460  254.600"
"      0.8000  0.00470  271.600"
"      3.050  0.00910  271.800"
"      3.100  0.00920  272.000"
"      3.150  0.00930  272.200"
"      3.200  0.00940  272.400"
"      3.250  0.00940  272.600"
"      3.300  0.00950  272.800"
"      3.350  0.00960  273.000"
"      Peak outflow          0.005    c.m/sec"
"      Maximum level         0.727    metre"
"      Maximum storage       246.935  c.m"
"      Centroidal lag        11.903  hours"
"      0.024    0.126    0.005    0.000 c.m/sec"
" 40  HYDROGRAPH Next link "
"      5  Next link "
"      0.024    0.005    0.005    0.000"
" 81  ADD COMMENT=====
"      3  Lines of comment"
"      *****
"      * AREA 203 - UNCONSTROLLED LAND AREA * "
"      *****
" 33  CATCHMENT 203"
"      1  Triangular SCS"
"      1  Equal length"
"      1  SCS method"
"      203  203- Uncontrolled land"
"      35.000 % Impervious"
"      0.153  Total Area"
"      10.000 Flow length"
"      2.000  Overland Slope"

```

```

"      0.099 Pervious Area"
"    10.000 Pervious length"
"      2.000 Pervious slope"
"      0.054 Impervious Area"
"    10.000 Impervious length"
"      2.000 Impervious slope"
"      0.250 Pervious Manning 'n'"
"    74.000 Pervious SCS Curve No."
"      0.412 Pervious Runoff coefficient"
"      0.100 Pervious Ia/S coefficient"
"      8.924 Pervious Initial abstraction"
"      0.015 Impervious Manning 'n'"
"    98.000 Impervious SCS Curve No."
"      0.896 Impervious Runoff coefficient"
"      0.100 Impervious Ia/S coefficient"
"      0.518 Impervious Initial abstraction"
"          0.038      0.005      0.005      0.000 c.m/sec"
"      Catchment 203      Pervious      Impervious      Total Area  "
"      Surface Area      0.099      0.054      0.153      hectare"
"      Time of concentration 6.368      0.831      3.382      minutes"
"      Time to Centroid    105.229      86.939      95.368      minutes"
"      Rainfall depth      86.135      86.135      86.135      mm"
"      Rainfall volume     85.66      46.13      131.79      c.m"
"      Rainfall losses     50.622      8.985      36.049      mm"
"      Runoff depth        35.513      77.149      50.086      mm"
"      Runoff volume       35.32      41.31      76.63      c.m"
"      Runoff coefficient   0.412      0.896      0.581      "
"      Maximum flow        0.019      0.029      0.038      c.m/sec"
" 81      ADD COMMENT=====
"      3 Lines of comment"
"      *****
"      * TOTAL FLOW FROM PROPOSED SITE AREA *
"      *****
" 40      HYDROGRAPH Add Runoff "
"      4 Add Runoff "
"          0.038      0.040      0.005      0.000"
" 38      START/RE-START TOTALS 203"
"      3 Runoff Totals on EXIT"
"      Total Catchment area      1.032      hectare"
"      Total Impervious area      0.653      hectare"
"      Total % impervious      63.261"
" 19      EXIT"

```

```

"          MIDUSS Output ----->"
"          MIDUSS version                      Version 2.25 rev. 473"
"          MIDUSS created                      Sunday, February 7, 2010"
"      10  Units used:                          ie METRIC"
"          Job folder:                        \\caneast.ibigroup.com\J\WT\"
"          122727_1107MainStW\7.0_Production\7.99_Submitted\FSR\Appendix B\SWM\May 2021"
"          Output filename:                    122727-6h2REV.OUT"
"          Licensee name:                      install"
"          Company                            IBI Group"
"          Date & Time last used:              2021-05-26 at 1:35:55 PM"
" 81      ADD COMMENT=====
"      6  Lines of comment"
"          *****"
"          * 122727 - 1107 MAIN STREET WEST      *"
"          * CITY OF HAMILTON                    *"
"          * IBI GROUP                          *"
"          * JANUARY 2020 - REVISED MAY 2021     *"
"          *****"
" 31      TIME PARAMETERS"
"      10.000 Time Step"
"      360.000 Max. Storm length"
"      3600.000 Max. Hydrograph"
" 81      ADD COMMENT=====
"      4  Lines of comment"
"          *****"
"          * 2 YEAR 6 HOUR SCS STORM            *"
"          * MOUNT HOPE IDF PARAMETERS          *"
"          *****"
" 32      STORM Historic"
"      5  Historic"
"      360.000 Duration"
"      36.000 Rainfall intensity values"
"          1.590      1.590      1.590      2.380      2.380"
"          2.380      2.380      2.380      2.380      3.970"
"          3.970      3.970      4.760      4.760      4.760"
"          23.820     42.880     61.930      8.730      8.730"
"          8.730      3.970      3.970      3.970      3.180"
"          3.180      3.180      2.380      2.380      2.380"
"          1.590      1.590      1.590      1.590      1.590"
"          1.590"
"          Maximum intensity      61.930      mm/hr"
"          Total depth            39.698      mm"
"      6  002hyd Hydrograph extension used in this file"
" 81      ADD COMMENT=====
"      3  Lines of comment"
"          *****"
"          * EXISTING CONDITIONS                *"
"          *****"
" 81      ADD COMMENT=====
"      3  Lines of comment"
"          *****"
"          * AREA 101 - EXISTING SITE AREA      *"
"          *****"
" 33      CATCHMENT 101"
"      1  Triangular SCS"
"      1  Equal length"
"      1  SCS method"
"      101 101- Exisitng site"
"      50.000 % Impervious"
"      0.516 Total Area"
"      40.000 Flow length"
"      2.000 Overland Slope"
"      0.258 Pervious Area"
"      40.000 Pervious length"
"      2.000 Pervious slope"
"      0.258 Impervious Area"

```

```

"      40.000  Impervious length"
"      2.000  Impervious slope"
"      0.250  Pervious Manning 'n'"
"      74.000  Pervious SCS Curve No."
"      0.199  Pervious Runoff coefficient"
"      0.100  Pervious Ia/S coefficient"
"      8.924  Pervious Initial abstraction"
"      0.015  Impervious Manning 'n'"
"      98.000  Impervious SCS Curve No."
"      0.861  Impervious Runoff coefficient"
"      0.100  Impervious Ia/S coefficient"
"      0.518  Impervious Initial abstraction"
"          0.040  0.000  0.000  0.000 c.m/sec"
"      Catchment 101      Pervious  Impervious  Total Area  "
"      Surface Area      0.258      0.258      0.516      hectare"
"      Time of concentration  29.434      3.238      8.150      minutes"
"      Time to Centroid      258.018      193.655      205.724      minutes"
"      Rainfall depth      39.698      39.698      39.698      mm"
"      Rainfall volume      102.42      102.42      204.84      c.m"
"      Rainfall losses      31.814      5.535      18.675      mm"
"      Runoff depth      7.884      34.163      21.024      mm"
"      Runoff volume      20.34      88.14      108.48      c.m"
"      Runoff coefficient      0.199      0.861      0.530      "
"      Maximum flow      0.005      0.039      0.040      c.m/sec"
" 81      ADD COMMENT=====
"      3  Lines of comment"
"      *****
"      * TOTAL FLOW FROM EXISTING SITE AREA *
"      *****
" 40      HYDROGRAPH Add Runoff "
"      4  Add Runoff "
"          0.040  0.040  0.000  0.000"
" 51      PIPE DESIGN"
"      0.040  Current peak flow  c.m/sec"
"      0.013  Manning 'n'"
"      0.375  Diameter  metre"
"      1.000  Gradient  %"
"          Depth of flow      0.122  metre"
"          Velocity      1.289  m/sec"
"          Pipe capacity      0.175  c.m/sec"
"          Critical depth      0.145  metre"
" 53      ROUTE Zero Route"
"      0.00  Zero Route Reach length  ( metre)"
"          0.040  0.040  0.040  0.000 c.m/sec"
" 40      HYDROGRAPH Combine  1"
"      6  Combine "
"      1  Node #"
"          Runoff from existing site"
"          Maximum flow      0.040  c.m/sec"
"          Hydrograph volume      108.482  c.m"
"          0.040  0.040  0.040  0.040"
" 40      HYDROGRAPH Start - New Tributary"
"      2  Start - New Tributary"
"          0.040  0.000  0.040  0.040"
" 81      ADD COMMENT=====
"      3  Lines of comment"
"      *****
"      * PROPSOED CONDITIONS *
"      *****
" 81      ADD COMMENT=====
"      3  Lines of comment"
"      *****
"      * AREA 200 - ROOFTOP SWM STORAGE AREA *
"      *****
" 33      CATCHMENT 200"
"      1  Triangular SCS"

```

```

"      1 Equal length"
"      1 SCS method"
"     200 200- Rooftop stormwater storage"
"    100.000 % Impervious"
"      0.140 Total Area"
"     20.000 Flow length"
"      1.000 Overland Slope"
"      0.000 Pervious Area"
"     20.000 Pervious length"
"      1.000 Pervious slope"
"      0.140 Impervious Area"
"     20.000 Impervious length"
"      1.000 Impervious slope"
"      0.250 Pervious Manning 'n'"
"     75.000 Pervious SCS Curve No."
"      0.000 Pervious Runoff coefficient"
"      0.100 Pervious Ia/S coefficient"
"      8.467 Pervious Initial abstraction"
"      0.015 Impervious Manning 'n'"
"     98.000 Impervious SCS Curve No."
"      0.854 Impervious Runoff coefficient"
"      0.100 Impervious Ia/S coefficient"
"      0.518 Impervious Initial abstraction"
"          0.021      0.000      0.040      0.040 c.m/sec"
"      Catchment 200      Pervious      Impervious      Total Area "
"      Surface Area      0.000      0.140      0.140      hectare"
"      Time of concentration      23.294      2.630      2.630      minutes"
"      Time to Centroid      248.413      192.972      192.972      minutes"
"      Rainfall depth      39.698      39.698      39.698      mm"
"      Rainfall volume      0.00      55.58      55.58      c.m"
"      Rainfall losses      31.291      5.795      5.795      mm"
"      Runoff depth      8.407      33.903      33.903      mm"
"      Runoff volume      0.00      47.46      47.46      c.m"
"      Runoff coefficient      0.000      0.854      0.854      "
"      Maximum flow      0.000      0.021      0.021      c.m/sec"
" 40 HYDROGRAPH Add Runoff "
"      4 Add Runoff "
"          0.021      0.021      0.040      0.040"
" 81 ADD COMMENT=====
"      3 Lines of comment"
"      *****
"      * CONTROLLED - ROOFTOP SWM STORAGE * "
"      *****
" 54 POND DESIGN"
"      0.021 Current peak flow      c.m/sec"
"      0.020 Target outflow      c.m/sec"
"      47.5 Hydrograph volume      c.m"
"      7. Number of stages"
"      0.000 Minimum water level      metre"
"      0.152 Maximum water level      metre"
"      0.000 Starting water level      metre"
"      0 Keep Design Data: 1 = True; 0 = False"
"          Level Discharge      Volume"
"          0.000      0.000      0.000"
"          0.02540      0.00418      0.3300"
"          0.05080      0.00836      2.630"
"          0.07620      0.01254      8.890"
"          0.1016      0.01672      21.070"
"          0.1270      0.02090      41.160"
"          0.1524      0.02508      74.120"
"      Peak outflow      0.012      c.m/sec"
"      Maximum level      0.076      metre"
"      Maximum storage      8.982      c.m"
"      Centroidal lag      3.318      hours"
"          0.021      0.021      0.012      0.040 c.m/sec"
" 40 HYDROGRAPH Combine 2"

```

```

"      6  Combine "
"      2  Node #"
"      Runoff to underground storage tank"
"      Maximum flow      0.012      c.m/sec"
"      Hydrograph volume  47.956      c.m"
"      0.021      0.021      0.012      0.012"
" 40      HYDROGRAPH Start - New Tributary"
"      2  Start - New Tributary"
"      0.021      0.000      0.012      0.012"
" 81      ADD COMMENT=====
"      3  Lines of comment"
"      ***** "
"      * AREA 201 - ROOFTOP AREA WITHOUT SWM STORAGE * "
"      *****"
" 33      CATCHMENT 201"
"      1  Triangular SCS"
"      1  Equal length"
"      1  SCS method"
"      201  201- Rooftop without storage"
" 100.000 % Impervious"
"      0.161 Total Area"
"      20.000 Flow length"
"      1.000 Overland Slope"
"      0.000 Pervious Area"
"      20.000 Pervious length"
"      1.000 Pervious slope"
"      0.161 Impervious Area"
"      20.000 Impervious length"
"      1.000 Impervious slope"
"      0.250 Pervious Manning 'n'"
"      75.000 Pervious SCS Curve No."
"      0.000 Pervious Runoff coefficient"
"      0.100 Pervious Ia/S coefficient"
"      8.467 Pervious Initial abstraction"
"      0.015 Impervious Manning 'n'"
"      98.000 Impervious SCS Curve No."
"      0.854 Impervious Runoff coefficient"
"      0.100 Impervious Ia/S coefficient"
"      0.518 Impervious Initial abstraction"
"      0.024      0.000      0.012      0.012 c.m/sec"
"      Catchment 201      Pervious      Impervious Total Area "
"      Surface Area      0.000      0.161      0.161      hectare"
"      Time of concentration 23.294      2.630      2.630      minutes"
"      Time to Centroid      248.413      192.972      192.972      minutes"
"      Rainfall depth      39.698      39.698      39.698      mm"
"      Rainfall volume      0.00      63.91      63.91      c.m"
"      Rainfall losses      31.291      5.795      5.795      mm"
"      Runoff depth      8.407      33.903      33.903      mm"
"      Runoff volume      0.00      54.58      54.58      c.m"
"      Runoff coefficient      0.000      0.854      0.854      "
"      Maximum flow      0.000      0.024      0.024      c.m/sec"
" 40      HYDROGRAPH Add Runoff "
"      4  Add Runoff "
"      0.024      0.024      0.012      0.012"
" 51      PIPE DESIGN"
"      0.024 Current peak flow      c.m/sec"
"      0.013 Manning 'n'"
"      0.375 Diameter      metre"
"      1.000 Gradient      %"
"      Depth of flow      0.095      metre"
"      Velocity      1.118      m/sec"
"      Pipe capacity      0.175      c.m/sec"
"      Critical depth      0.112      metre"
" 53      ROUTE Zero Route"
"      0.00 Zero Route Reach length      ( metre)"
"      0.024      0.024      0.024      0.012 c.m/sec"

```

```

" 40      HYDROGRAPH   Combine      2"
"          6   Combine "
"          2   Node #"
"          Runoff to underground storage tank"
"          Maximum flow           0.036   c.m/sec"
"          Hydrograph volume      102.540   c.m"
"          0.024      0.024      0.024      0.036"
" 40      HYDROGRAPH Start - New Tributary"
"          2   Start - New Tributary"
"          0.024      0.000      0.024      0.036"
" 81      ADD COMMENT=====
"          3   Lines of comment"
"          *****
"          * AREA 202 - COURTYARD AREA * "
"          *****
" 33      CATCHMENT 202"
"          1   Triangular SCS"
"          1   Equal length"
"          1   SCS method"
"          202  202- Courtyard"
"          65.000 % Impervious"
"          0.062 Total Area"
"          10.000 Flow length"
"          2.000 Overland Slope"
"          0.022 Pervious Area"
"          10.000 Pervious length"
"          2.000 Pervious slope"
"          0.040 Impervious Area"
"          10.000 Impervious length"
"          2.000 Impervious slope"
"          0.250 Pervious Manning 'n'"
"          74.000 Pervious SCS Curve No."
"          0.197 Pervious Runoff coefficient"
"          0.100 Pervious Ia/S coefficient"
"          8.924 Pervious Initial abstraction"
"          0.015 Impervious Manning 'n'"
"          98.000 Impervious SCS Curve No."
"          0.813 Impervious Runoff coefficient"
"          0.100 Impervious Ia/S coefficient"
"          0.518 Impervious Initial abstraction"
"          0.006      0.000      0.024      0.036 c.m/sec"
"          Catchment 202      Pervious      Impervious      Total Area "
"          Surface Area      0.022      0.040      0.062      hectare"
"          Time of concentration 12.812      1.409      2.722      minutes"
"          Time to Centroid      234.635      191.495      196.461      minutes"
"          Rainfall depth      39.698      39.698      39.698      mm"
"          Rainfall volume      8.61      16.00      24.61      c.m"
"          Rainfall losses      31.897      7.407      15.978      mm"
"          Runoff depth      7.802      32.291      23.720      mm"
"          Runoff volume      1.69      13.01      14.71      c.m"
"          Runoff coefficient      0.197      0.813      0.598      "
"          Maximum flow      0.001      0.006      0.006      c.m/sec"
" 40      HYDROGRAPH Add Runoff "
"          4   Add Runoff "
"          0.006      0.006      0.024      0.036"
" 51      PIPE DESIGN"
"          0.006 Current peak flow      c.m/sec"
"          0.013 Manning 'n'"
"          0.300 Diameter      metre"
"          0.400 Gradient      %"
"          Depth of flow      0.064      metre"
"          Velocity      0.555      m/sec"
"          Pipe capacity      0.061      c.m/sec"
"          Critical depth      0.059      metre"
" 53      ROUTE Zero Route"
"          0.00 Zero Route Reach length      ( metre)"

```



```

                                122727-6h2REV.OUT
"          0.006      0.006      0.006      0.036 c.m/sec"
" 40      HYDROGRAPH   Combine      2"
"          6   Combine  "
"          2   Node #"
"          Runoff to underground storage tank"
"          Maximum flow          0.042      c.m/sec"
"          Hydrograph volume      117.246      c.m"
"          0.006      0.006      0.006      0.042"
" 81      ADD COMMENT=====
"          3   Lines of comment"
"          *****
"          * CONTROLLED - UNDERGROUND SWM STORAGE TANK * "
"          *****
" 40      HYDROGRAPH   Confluence      2"
"          7   Confluence  "
"          2   Node #"
"          Runoff to underground storage tank"
"          Maximum flow          0.042      c.m/sec"
"          Hydrograph volume      117.246      c.m"
"          0.006      0.042      0.006      0.000"
" 54      POND DESIGN"
"          0.042   Current peak flow      c.m/sec"
"          0.001   Target outflow      c.m/sec"
"          117.2   Hydrograph volume      c.m"
"          18.     Number of stages"
"          0.000   Minimum water level      metre"
"          3.550   Maximum water level      metre"
"          0.000   Starting water level      metre"
"          0       Keep Design Data: 1 = True; 0 = False"
"          Level Discharge      Volume"
"          0.000      0.000      0.000"
"          0.05000  0.00140      17.000"
"          0.1000  0.00180      33.900"
"          0.1500  0.00220      50.900"
"          0.2500  0.00270      84.900"
"          0.3500  0.00320      118.800"
"          0.4500  0.00360      152.800"
"          0.5500  0.00400      186.700"
"          0.6500  0.00430      220.700"
"          0.7500  0.00460      254.600"
"          0.8000  0.00470      271.600"
"          3.050   0.00910      271.800"
"          3.100   0.00920      272.000"
"          3.150   0.00930      272.200"
"          3.200   0.00940      272.400"
"          3.250   0.00940      272.600"
"          3.300   0.00950      272.800"
"          3.350   0.00960      273.000"
"          Peak outflow          0.003      c.m/sec"
"          Maximum level          0.257      metre"
"          Maximum storage          87.150      c.m"
"          Centroidal lag          9.665      hours"
"          0.006      0.042      0.003      0.000 c.m/sec"
" 40      HYDROGRAPH Next link "
"          5   Next link "
"          0.006      0.003      0.003      0.000"
" 81      ADD COMMENT=====
"          3   Lines of comment"
"          *****
"          * AREA 203 - UNCONSTROLLED LAND AREA * "
"          *****
" 33      CATCHMENT 203"
"          1   Triangular SCS"
"          1   Equal length"
"          1   SCS method"
"          203  203- Uncontrolled land"

```

```

"      35.000  % Impervious"
"      0.153  Total Area"
"     10.000  Flow length"
"      2.000  Overland Slope"
"      0.099  Pervious Area"
"     10.000  Pervious length"
"      2.000  Pervious slope"
"      0.054  Impervious Area"
"     10.000  Impervious length"
"      2.000  Impervious slope"
"      0.250  Pervious Manning 'n'"
"     74.000  Pervious SCS Curve No."
"      0.197  Pervious Runoff coefficient"
"      0.100  Pervious Ia/S coefficient"
"      8.924  Pervious Initial abstraction"
"      0.015  Impervious Manning 'n'"
"     98.000  Impervious SCS Curve No."
"      0.813  Impervious Runoff coefficient"
"      0.100  Impervious Ia/S coefficient"
"      0.518  Impervious Initial abstraction"
"          0.009    0.003    0.003    0.000 c.m/sec"
"      Catchment 203      Pervious      Impervious      Total Area  "
"      Surface Area      0.099      0.054      0.153      hectare"
"      Time of concentration 12.812    1.409    4.941    minutes"
"      Time to Centroid    234.635   191.495   204.856   minutes"
"      Rainfall depth      39.698    39.698    39.698    mm"
"      Rainfall volume      39.48     21.26    60.74     c.m"
"      Rainfall losses      31.897    7.407    23.325    mm"
"      Runoff depth         7.802     32.291   16.373    mm"
"      Runoff volume         7.76      17.29    25.05     c.m"
"      Runoff coefficient    0.197     0.813    0.412     "
"      Maximum flow         0.003     0.008    0.009     c.m/sec"
" 81      ADD COMMENT=====
"      3      Lines of comment"
"      *****
"      * TOTAL FLOW FROM PROPOSED SITE AREA *
"      *****
" 40      HYDROGRAPH Add Runoff "
"      4      Add Runoff "
"          0.009    0.011    0.003    0.000"
" 38      START/RE-START TOTALS 203"
"      3      Runoff Totals on EXIT"
"      Total Catchment area          1.032    hectare"
"      Total Impervious area          0.653    hectare"
"      Total % impervious          63.261"
" 19      EXIT"

```

```

"          MIDUSS Output ----->"
"          MIDUSS version                      Version 2.25 rev. 473"
"          MIDUSS created                      Sunday, February 7, 2010"
"      10  Units used:                          ie METRIC"
"          Job folder:                        \\caneast.ibigroup.com\J\WT\"
"          122727_1107MainStW\7.0_Production\7.99_Submitted\FSR\Appendix B\SWMM\May 2021"
"          Output filename:                    122727-6h5REV.OUT"
"          Licensee name:                      install"
"          Company                            IBI Group"
"          Date & Time last used:              2021-05-26 at 1:34:19 PM"
" 81      ADD COMMENT=====
"      6  Lines of comment"
"          *****"
"          * 122727 - 1107 MAIN STREET WEST      *"
"          * CITY OF HAMILTON                    *"
"          * IBI GROUP                          *"
"          * JANUARY 2020 - REVISED MAY 2021     *"
"          *****"
" 31      TIME PARAMETERS"
"      10.000 Time Step"
"      360.000 Max. Storm length"
"      3600.000 Max. Hydrograph"
" 81      ADD COMMENT=====
"      4  Lines of comment"
"          *****"
"          * 5 YEAR 6 HOUR SCS STORM            *"
"          * MOUNT HOPE IDF PARAMETERS          *"
"          *****"
" 32      STORM Historic"
"      5  Historic"
"      360.000 Duration"
"      36.000 Rainfall intensity values"
"          2.260      2.260      2.260      3.390      3.390"
"          3.390      3.390      3.390      3.390      5.650"
"          5.650      5.650      6.780      6.780      6.780"
"          33.900     61.020     88.140     12.430     12.430"
"          12.430     5.650     5.650     5.650     4.520"
"          4.520     4.520     3.390     3.390     3.390"
"          2.260     2.260     2.260     2.260     2.260"
"          2.260"
"          Maximum intensity      88.140      mm/hr"
"          Total depth            56.500      mm"
"      6  005hyd Hydrograph extension used in this file"
" 81      ADD COMMENT=====
"      3  Lines of comment"
"          *****"
"          * EXISTING CONDITIONS                *"
"          *****"
" 81      ADD COMMENT=====
"      3  Lines of comment"
"          *****"
"          * AREA 101 - EXISTING SITE AREA      *"
"          *****"
" 33      CATCHMENT 101"
"      1  Triangular SCS"
"      1  Equal length"
"      1  SCS method"
"      101 101- Exisitng site"
"      50.000 % Impervious"
"      0.516 Total Area"
"      40.000 Flow length"
"      2.000 Overland Slope"
"      0.258 Pervious Area"
"      40.000 Pervious length"
"      2.000 Pervious slope"
"      0.258 Impervious Area"

```

```

"      40.000  Impervious length"
"      2.000  Impervious slope"
"      0.250  Pervious Manning 'n'"
"      74.000  Pervious SCS Curve No."
"      0.292  Pervious Runoff coefficient"
"      0.100  Pervious Ia/S coefficient"
"      8.924  Pervious Initial abstraction"
"      0.015  Impervious Manning 'n'"
"      98.000  Impervious SCS Curve No."
"      0.892  Impervious Runoff coefficient"
"      0.100  Impervious Ia/S coefficient"
"      0.518  Impervious Initial abstraction"
"          0.062    0.000    0.000    0.000 c.m/sec"
"      Catchment 101      Pervious  Impervious  Total Area  "
"      Surface Area      0.258    0.258    0.516    hectare"
"      Time of concentration  21.926    2.794    7.515    minutes"
"      Time to Centroid      242.383    191.167    203.805    minutes"
"      Rainfall depth      56.500    56.500    56.500    mm"
"      Rainfall volume      145.77    145.77    291.54    c.m"
"      Rainfall losses      39.995    6.116    23.056    mm"
"      Runoff depth      16.505    50.384    33.444    mm"
"      Runoff volume      42.58    129.99    172.57    c.m"
"      Runoff coefficient    0.292    0.892    0.592    "
"      Maximum flow      0.012    0.057    0.062    c.m/sec"
" 81      ADD COMMENT=====
"      3  Lines of comment"
"      *****
"      * TOTAL FLOW FROM EXISTING SITE AREA *
"      *****
" 40      HYDROGRAPH Add Runoff "
"      4  Add Runoff "
"          0.062    0.062    0.000    0.000"
" 51      PIPE DESIGN"
"      0.062  Current peak flow    c.m/sec"
"      0.013  Manning 'n'"
"      0.375  Diameter    metre"
"      1.000  Gradient    %"
"          Depth of flow      0.154    metre"
"          Velocity      1.449    m/sec"
"          Pipe capacity      0.175    c.m/sec"
"          Critical depth      0.180    metre"
" 53      ROUTE Zero Route"
"      0.00  Zero Route Reach length  ( metre)"
"          0.062    0.062    0.062    0.000 c.m/sec"
" 40      HYDROGRAPH Combine  1"
"      6  Combine "
"      1  Node #"
"          Runoff from existing site"
"          Maximum flow      0.062    c.m/sec"
"          Hydrograph volume      172.573    c.m"
"          0.062    0.062    0.062    0.062"
" 40      HYDROGRAPH Start - New Tributary"
"      2  Start - New Tributary"
"          0.062    0.000    0.062    0.062"
" 81      ADD COMMENT=====
"      3  Lines of comment"
"      *****
"      * PROPSOED CONDITIONS *
"      *****
" 81      ADD COMMENT=====
"      3  Lines of comment"
"      *****
"      * AREA 200 - ROOFTOP SWM STORAGE AREA *
"      *****
" 33      CATCHMENT 200"
"      1  Triangular SCS"

```

```

"      1 Equal length"
"      1 SCS method"
"     200 200- Rooftop stormwater storage"
" 100.000 % Impervious"
"     0.140 Total Area"
"    20.000 Flow length"
"     1.000 Overland Slope"
"     0.000 Pervious Area"
"    20.000 Pervious length"
"     1.000 Pervious slope"
"     0.140 Impervious Area"
"    20.000 Impervious length"
"     1.000 Impervious slope"
"     0.250 Pervious Manning 'n'"
"    75.000 Pervious SCS Curve No."
"     0.000 Pervious Runoff coefficient"
"     0.100 Pervious Ia/S coefficient"
"     8.467 Pervious Initial abstraction"
"     0.015 Impervious Manning 'n'"
"    98.000 Impervious SCS Curve No."
"     0.877 Impervious Runoff coefficient"
"     0.100 Impervious Ia/S coefficient"
"     0.518 Impervious Initial abstraction"
"           0.031      0.000      0.062      0.062 c.m/sec"
"      Catchment 200      Pervious      Impervious      Total Area "
"      Surface Area      0.000      0.140      0.140      hectare"
"      Time of concentration 17.471      2.269      2.269      minutes"
"      Time to Centroid 235.455      190.293      190.293      minutes"
"      Rainfall depth 56.500      56.500      56.500      mm"
"      Rainfall volume 0.00      79.10      79.10      c.m"
"      Rainfall losses 39.143      6.927      6.927      mm"
"      Runoff depth 17.357      49.573      49.573      mm"
"      Runoff volume 0.00      69.40      69.40      c.m"
"      Runoff coefficient 0.000      0.877      0.877      "
"      Maximum flow 0.000      0.031      0.031      c.m/sec"
" 40 HYDROGRAPH Add Runoff "
"      4 Add Runoff "
"           0.031      0.031      0.062      0.062"
" 81 ADD COMMENT=====
"      3 Lines of comment"
"      *****
"      * CONTROLLED - ROOFTOP SWM STORAGE * "
"      *****
" 54 POND DESIGN"
"      0.031 Current peak flow c.m/sec"
"      0.020 Target outflow c.m/sec"
"      69.4 Hydrograph volume c.m"
"      7. Number of stages"
"      0.000 Minimum water level metre"
"      0.152 Maximum water level metre"
"      0.000 Starting water level metre"
"      0 Keep Design Data: 1 = True; 0 = False"
"      Level Discharge Volume"
"      0.000 0.000 0.000"
"      0.02540 0.00418 0.3300"
"      0.05080 0.00836 2.630"
"      0.07620 0.01254 8.890"
"      0.1016 0.01672 21.070"
"      0.1270 0.02090 41.160"
"      0.1524 0.02508 74.120"
"      Peak outflow 0.015 c.m/sec"
"      Maximum level 0.092 metre"
"      Maximum storage 16.306 c.m"
"      Centroidal lag 3.323 hours"
"           0.031 0.031 0.015 0.062 c.m/sec"
" 40 HYDROGRAPH Combine 2"

```

```

"      6  Combine "
"      2  Node #"
"      Runoff to underground storage tank"
"      Maximum flow      0.015      c.m/sec"
"      Hydrograph volume      68.793      c.m"
"      0.031      0.031      0.015      0.015"
" 40      HYDROGRAPH Start - New Tributary"
"      2  Start - New Tributary"
"      0.031      0.000      0.015      0.015"
" 81      ADD COMMENT=====
"      3  Lines of comment"
"      ***** "
"      * AREA 201 - ROOFTOP AREA WITHOUT SWM STORAGE * "
"      *****"
" 33      CATCHMENT 201"
"      1  Triangular SCS"
"      1  Equal length"
"      1  SCS method"
"      201  201- Rooftop without storage"
" 100.000 % Impervious"
"      0.161 Total Area"
"      20.000 Flow length"
"      1.000 Overland Slope"
"      0.000 Pervious Area"
"      20.000 Pervious length"
"      1.000 Pervious slope"
"      0.161 Impervious Area"
"      20.000 Impervious length"
"      1.000 Impervious slope"
"      0.250 Pervious Manning 'n'"
"      75.000 Pervious SCS Curve No."
"      0.000 Pervious Runoff coefficient"
"      0.100 Pervious Ia/S coefficient"
"      8.467 Pervious Initial abstraction"
"      0.015 Impervious Manning 'n'"
"      98.000 Impervious SCS Curve No."
"      0.877 Impervious Runoff coefficient"
"      0.100 Impervious Ia/S coefficient"
"      0.518 Impervious Initial abstraction"
"      0.035      0.000      0.015      0.015 c.m/sec"
"      Catchment 201      Pervious      Impervious      Total Area "
"      Surface Area      0.000      0.161      0.161      hectare"
"      Time of concentration 17.471      2.269      2.269      minutes"
"      Time to Centroid      235.454      190.292      190.292      minutes"
"      Rainfall depth      56.500      56.500      56.500      mm"
"      Rainfall volume      0.00      90.96      90.97      c.m"
"      Rainfall losses      39.143      6.927      6.927      mm"
"      Runoff depth      17.357      49.573      49.573      mm"
"      Runoff volume      0.00      79.81      79.81      c.m"
"      Runoff coefficient      0.000      0.877      0.877      "
"      Maximum flow      0.000      0.035      0.035      c.m/sec"
" 40      HYDROGRAPH Add Runoff "
"      4  Add Runoff "
"      0.035      0.035      0.015      0.015"
" 51      PIPE DESIGN"
"      0.035 Current peak flow      c.m/sec"
"      0.013 Manning 'n'"
"      0.375 Diameter      metre"
"      1.000 Gradient      %"
"      Depth of flow      0.114      metre"
"      Velocity      1.241      m/sec"
"      Pipe capacity      0.175      c.m/sec"
"      Critical depth      0.135      metre"
" 53      ROUTE Zero Route"
"      0.00 Zero Route Reach length      ( metre)"
"      0.035      0.035      0.035      0.015 c.m/sec"

```

```

" 40      HYDROGRAPH   Combine      2"
"          6   Combine  "
"          2   Node #  "
"          Runoff to underground storage tank"
"          Maximum flow      0.049   c.m/sec"
"          Hydrograph volume  148.605 c.m"
"          0.035      0.035      0.035      0.049"
" 40      HYDROGRAPH Start - New Tributary"
"          2   Start - New Tributary"
"          0.035      0.000      0.035      0.049"
" 81      ADD COMMENT=====
"          3   Lines of comment"
"          *****
"          * AREA 202 - COURTYARD AREA * "
"          *****
" 33      CATCHMENT 202"
"          1   Triangular SCS"
"          1   Equal length"
"          1   SCS method"
"          202 202- Courtyard"
"          65.000 % Impervious"
"          0.062 Total Area"
"          10.000 Flow length"
"          2.000 Overland Slope"
"          0.022 Pervious Area"
"          10.000 Pervious length"
"          2.000 Pervious slope"
"          0.040 Impervious Area"
"          10.000 Impervious length"
"          2.000 Impervious slope"
"          0.250 Pervious Manning 'n'"
"          74.000 Pervious SCS Curve No."
"          0.290 Pervious Runoff coefficient"
"          0.100 Pervious Ia/S coefficient"
"          8.924 Pervious Initial abstraction"
"          0.015 Impervious Manning 'n'"
"          98.000 Impervious SCS Curve No."
"          0.834 Impervious Runoff coefficient"
"          0.100 Impervious Ia/S coefficient"
"          0.518 Impervious Initial abstraction"
"          0.010      0.000      0.035      0.049 c.m/sec"
"          Catchment 202      Pervious      Impervious      Total Area "
"          Surface Area      0.022      0.040      0.062      hectare"
"          Time of concentration 9.544      1.216      2.531      minutes"
"          Time to Centroid      225.005      189.208      194.858      minutes"
"          Rainfall depth      56.500      56.500      56.500      mm"
"          Rainfall volume      12.26      22.77      35.03      c.m"
"          Rainfall losses      40.108      9.407      20.152      mm"
"          Runoff depth      16.392      47.093      36.348      mm"
"          Runoff volume      3.56      18.98      22.54      c.m"
"          Runoff coefficient      0.290      0.834      0.643      "
"          Maximum flow      0.001      0.008      0.010      c.m/sec"
" 40      HYDROGRAPH Add Runoff "
"          4   Add Runoff "
"          0.010      0.010      0.035      0.049"
" 51      PIPE DESIGN"
"          0.010 Current peak flow      c.m/sec"
"          0.013 Manning 'n'"
"          0.300 Diameter      metre"
"          0.400 Gradient      %"
"          Depth of flow      0.080      metre"
"          Velocity      0.629      m/sec"
"          Pipe capacity      0.061      c.m/sec"
"          Critical depth      0.073      metre"
" 53      ROUTE Zero Route"
"          0.00 Zero Route Reach length ( metre)"

```

```

                                122727-6h5REV.OUT
"          0.010      0.010      0.010      0.049 c.m/sec"
" 40      HYDROGRAPH   Combine      2"
"          6   Combine "
"          2   Node #"
"          Runoff to underground storage tank"
"          Maximum flow          0.059      c.m/sec"
"          Hydrograph volume      171.141      c.m"
"          0.010      0.010      0.010      0.059"
" 81      ADD COMMENT=====
"          3   Lines of comment"
"          *****"
"          * CONTROLLED - UNDERGROUND SWM STORAGE TANK * "
"          *****"
" 40      HYDROGRAPH   Confluence      2"
"          7   Confluence "
"          2   Node #"
"          Runoff to underground storage tank"
"          Maximum flow          0.059      c.m/sec"
"          Hydrograph volume      171.141      c.m"
"          0.010      0.059      0.010      0.000"
" 54      POND DESIGN"
"          0.059   Current peak flow      c.m/sec"
"          0.001   Target outflow      c.m/sec"
"          171.1   Hydrograph volume      c.m"
"          18.     Number of stages"
"          0.000   Minimum water level      metre"
"          3.550   Maximum water level      metre"
"          0.000   Starting water level      metre"
"          0       Keep Design Data: 1 = True; 0 = False"
"          Level Discharge      Volume"
"          0.000      0.000      0.000"
"          0.05000  0.00140      17.000"
"          0.1000  0.00180      33.900"
"          0.1500  0.00220      50.900"
"          0.2500  0.00270      84.900"
"          0.3500  0.00320     118.800"
"          0.4500  0.00360     152.800"
"          0.5500  0.00400     186.700"
"          0.6500  0.00430     220.700"
"          0.7500  0.00460     254.600"
"          0.8000  0.00470     271.600"
"          3.050   0.00910     271.800"
"          3.100   0.00920     272.000"
"          3.150   0.00930     272.200"
"          3.200   0.00940     272.400"
"          3.250   0.00940     272.600"
"          3.300   0.00950     272.800"
"          3.350   0.00960     273.000"
"          Peak outflow          0.003      c.m/sec"
"          Maximum level          0.388      metre"
"          Maximum storage        131.558      c.m"
"          Centroidal lag          11.015      hours"
"          0.010      0.059      0.003      0.000 c.m/sec"
" 40      HYDROGRAPH Next link "
"          5   Next link "
"          0.010      0.003      0.003      0.000"
" 81      ADD COMMENT=====
"          3   Lines of comment"
"          *****"
"          * AREA 203 - UNCONSTROLLED LAND AREA * "
"          *****"
" 33      CATCHMENT 203"
"          1   Triangular SCS"
"          1   Equal length"
"          1   SCS method"
"          203  203- Uncontrolled land"

```



```

"      35.000  % Impervious"
"      0.153  Total Area"
"     10.000  Flow length"
"      2.000  Overland Slope"
"      0.099  Pervious Area"
"     10.000  Pervious length"
"      2.000  Pervious slope"
"      0.054  Impervious Area"
"     10.000  Impervious length"
"      2.000  Impervious slope"
"      0.250  Pervious Manning 'n'"
"     74.000  Pervious SCS Curve No."
"      0.290  Pervious Runoff coefficient"
"      0.100  Pervious Ia/S coefficient"
"      8.924  Pervious Initial abstraction"
"      0.015  Impervious Manning 'n'"
"     98.000  Impervious SCS Curve No."
"      0.834  Impervious Runoff coefficient"
"      0.100  Impervious Ia/S coefficient"
"      0.518  Impervious Initial abstraction"
"          0.016    0.003    0.003    0.000 c.m/sec"
"      Catchment 203      Pervious      Impervious      Total Area  "
"      Surface Area      0.099      0.054      0.153      hectare"
"      Time of concentration 9.544      1.216      4.486      minutes"
"      Time to Centroid    225.005    189.208    203.263    minutes"
"      Rainfall depth      56.500    56.500    56.500    mm"
"      Rainfall volume     56.19     30.26     86.45     c.m"
"      Rainfall losses     40.108    9.407     29.363    mm"
"      Runoff depth        16.392    47.093    27.137    mm"
"      Runoff volume       16.30     25.22     41.52     c.m"
"      Runoff coefficient   0.290     0.834     0.480     "
"      Maximum flow        0.006     0.011     0.016     c.m/sec"
" 81      ADD COMMENT=====
"      3      Lines of comment"
"      *****
"      * TOTAL FLOW FROM PROPOSED SITE AREA *
"      *****
" 40      HYDROGRAPH Add Runoff "
"      4      Add Runoff "
"          0.016    0.019    0.003    0.000"
" 38      START/RE-START TOTALS 203"
"      3      Runoff Totals on EXIT"
"      Total Catchment area          1.032      hectare"
"      Total Impervious area          0.653      hectare"
"      Total % impervious          63.261"
" 19      EXIT"

```

```

"          MIDUSS Output ----->"
"          MIDUSS version                      Version 2.25 rev. 473"
"          MIDUSS created                      Sunday, February 7, 2010"
"      10  Units used:                          ie METRIC"
"          Job folder:                        \\caneast.ibigroup.com\J\WT\"
"          122727_1107MainStW\7.0_Production\7.99_Submitted\FSR\Appendix B\SWM\May 2021"
"          Output filename:                    122727-6h10REV.OUT"
"          Licensee name:                      install"
"          Company                            IBI Group"
"          Date & Time last used:              2021-05-26 at 1:32:46 PM"
" 81      ADD COMMENT=====
"      6  Lines of comment"
"          *****"
"          * 122727 - 1107 MAIN STREET WEST      *"
"          * CITY OF HAMILTON                    *"
"          * IBI GROUP                          *"
"          * JANUARY 2020 - REVISED MAY 2021     *"
"          *****"
" 31      TIME PARAMETERS"
"      10.000 Time Step"
"      360.000 Max. Storm length"
"      3600.000 Max. Hydrograph"
" 81      ADD COMMENT=====
"      4  Lines of comment"
"          *****"
"          * 10 YEAR 6 HOUR SCS STORM          *"
"          * MOUNT HOPE IDF PARAMETERS          *"
"          *****"
" 32      STORM Historic"
"      5  Historic"
"      360.000 Duration"
"      36.000 Rainfall intensity values"
"          2.700      2.700      2.700      4.060      4.060"
"          4.060      4.060      4.060      4.060      6.760"
"          6.760      6.760      8.110      8.110      8.110"
"          40.560     73.010     105.460     14.870     14.870"
"          14.870      6.760      6.760      6.760      5.410"
"          5.410      5.410      4.060      4.060      4.060"
"          2.700      2.700      2.700      2.700      2.700"
"          2.700"
"          Maximum intensity          105.460      mm/hr"
"          Total depth                67.600      mm"
"      6  010hyd Hydrograph extension used in this file"
" 81      ADD COMMENT=====
"      3  Lines of comment"
"          *****"
"          * EXISTING CONDITIONS              *"
"          *****"
" 81      ADD COMMENT=====
"      3  Lines of comment"
"          *****"
"          * AREA 101 - EXISTING SITE AREA    *"
"          *****"
" 33      CATCHMENT 101"
"      1  Triangular SCS"
"      1  Equal length"
"      1  SCS method"
"      101 101- Exisitng site"
"      50.000 % Impervious"
"      0.516 Total Area"
"      40.000 Flow length"
"      2.000 Overland Slope"
"      0.258 Pervious Area"
"      40.000 Pervious length"
"      2.000 Pervious slope"
"      0.258 Impervious Area"

```

```

"      40.000 Impervious length"
"      2.000 Impervious slope"
"      0.250 Pervious Manning 'n'"
"      74.000 Pervious SCS Curve No."
"      0.342 Pervious Runoff coefficient"
"      0.100 Pervious Ia/S coefficient"
"      8.924 Pervious Initial abstraction"
"      0.015 Impervious Manning 'n'"
"      98.000 Impervious SCS Curve No."
"      0.901 Impervious Runoff coefficient"
"      0.100 Impervious Ia/S coefficient"
"      0.518 Impervious Initial abstraction"
"          0.078      0.000      0.000      0.000 c.m/sec"
"      Catchment 101      Pervious Impervious Total Area "
"      Surface Area      0.258      0.258      0.516      hectare"
"      Time of concentration 19.178      2.595      7.157      minutes"
"      Time to Centroid      236.512      189.963      202.768      minutes"
"      Rainfall depth      67.600      67.600      67.600      mm"
"      Rainfall volume      174.41      174.41      348.82      c.m"
"      Rainfall losses      44.497      6.716      25.606      mm"
"      Runoff depth      23.103      60.884      41.994      mm"
"      Runoff volume      59.61      157.08      216.69      c.m"
"      Runoff coefficient      0.342      0.901      0.621      "
"      Maximum flow      0.019      0.068      0.078      c.m/sec"
" 81      ADD COMMENT=====
"      3 Lines of comment"
"      *****
"      * TOTAL FLOW FROM EXISTING SITE AREA *
"      *****
" 40      HYDROGRAPH Add Runoff "
"      4 Add Runoff "
"          0.078      0.078      0.000      0.000"
" 51      PIPE DESIGN"
"      0.078 Current peak flow      c.m/sec"
"      0.013 Manning 'n'"
"      0.375 Diameter      metre"
"      1.000 Gradient      %"
"      Depth of flow      0.175      metre"
"      Velocity      1.539      m/sec"
"      Pipe capacity      0.175      c.m/sec"
"      Critical depth      0.204      metre"
" 53      ROUTE Zero Route"
"      0.00 Zero Route Reach length      ( metre)"
"          0.078      0.078      0.078      0.000 c.m/sec"
" 40      HYDROGRAPH Combine 1"
"      6 Combine "
"      1 Node #"
"      Runoff from existing site"
"      Maximum flow      0.078      c.m/sec"
"      Hydrograph volume      216.688      c.m"
"          0.078      0.078      0.078      0.078"
" 40      HYDROGRAPH Start - New Tributary"
"      2 Start - New Tributary"
"          0.078      0.000      0.078      0.078"
" 81      ADD COMMENT=====
"      3 Lines of comment"
"      *****
"      * PROPSOED CONDITIONS *
"      *****
" 81      ADD COMMENT=====
"      3 Lines of comment"
"      *****
"      * AREA 200 - ROOFTOP SWM STORAGE AREA *
"      *****
" 33      CATCHMENT 200"
"      1 Triangular SCS"

```

```

"      1 Equal length"
"      1 SCS method"
"     200 200- Rooftop stormwater storage"
" 100.000 % Impervious"
"     0.140 Total Area"
"    20.000 Flow length"
"     1.000 Overland Slope"
"     0.000 Pervious Area"
"    20.000 Pervious length"
"     1.000 Pervious slope"
"     0.140 Impervious Area"
"    20.000 Impervious length"
"     1.000 Impervious slope"
"     0.250 Pervious Manning 'n'"
"    75.000 Pervious SCS Curve No."
"     0.000 Pervious Runoff coefficient"
"     0.100 Pervious Ia/S coefficient"
"     8.467 Pervious Initial abstraction"
"     0.015 Impervious Manning 'n'"
"    98.000 Impervious SCS Curve No."
"     0.888 Impervious Runoff coefficient"
"     0.100 Impervious Ia/S coefficient"
"     0.518 Impervious Initial abstraction"
"           0.037      0.000      0.078      0.078 c.m/sec"
"      Catchment 200      Pervious      Impervious      Total Area "
"      Surface Area      0.000      0.140      0.140      hectare"
"      Time of concentration 15.321      2.108      2.108      minutes"
"      Time to Centroid      230.621      189.051      189.051      minutes"
"      Rainfall depth      67.600      67.600      67.600      mm"
"      Rainfall volume      0.00      94.64      94.64      c.m"
"      Rainfall losses      43.380      7.602      7.602      mm"
"      Runoff depth      24.220      59.998      59.998      mm"
"      Runoff volume      0.00      84.00      84.00      c.m"
"      Runoff coefficient      0.000      0.888      0.888      "
"      Maximum flow      0.000      0.037      0.037      c.m/sec"
" 40 HYDROGRAPH Add Runoff "
"      4 Add Runoff "
"           0.037      0.037      0.078      0.078"
" 81 ADD COMMENT=====
"      3 Lines of comment"
"      *****
"      * CONTROLLED - ROOFTOP SWM STORAGE * "
"      *****
" 54 POND DESIGN"
"      0.037 Current peak flow      c.m/sec"
"      0.020 Target outflow      c.m/sec"
"      84.0 Hydrograph volume      c.m"
"      7. Number of stages"
"      0.000 Minimum water level      metre"
"      0.152 Maximum water level      metre"
"      0.000 Starting water level      metre"
"      0 Keep Design Data: 1 = True; 0 = False"
"      Level Discharge      Volume"
"      0.000      0.000      0.000"
"      0.02540      0.00418      0.3300"
"      0.05080      0.00836      2.630"
"      0.07620      0.01254      8.890"
"      0.1016      0.01672      21.070"
"      0.1270      0.02090      41.160"
"      0.1524      0.02508      74.120"
"      Peak outflow      0.017      c.m/sec"
"      Maximum level      0.102      metre"
"      Maximum storage      21.768      c.m"
"      Centroidal lag      3.333      hours"
"           0.037      0.037      0.017      0.078 c.m/sec"
" 40 HYDROGRAPH Combine 2"

```

```

"      6  Combine "
"      2  Node #"
"      Runoff to underground storage tank"
"      Maximum flow      0.017      c.m/sec"
"      Hydrograph volume      83.866      c.m"
"      0.037      0.037      0.017      0.017"
" 40      HYDROGRAPH Start - New Tributary"
"      2  Start - New Tributary"
"      0.037      0.000      0.017      0.017"
" 81      ADD COMMENT=====
"      3  Lines of comment"
"      ***** "
"      * AREA 201 - ROOFTOP AREA WITHOUT SWM STORAGE * "
"      *****"
" 33      CATCHMENT 201"
"      1  Triangular SCS"
"      1  Equal length"
"      1  SCS method"
"      201  201- Rooftop without storage"
" 100.000 % Impervious"
"      0.161 Total Area"
"      20.000 Flow length"
"      1.000 Overland Slope"
"      0.000 Pervious Area"
"      20.000 Pervious length"
"      1.000 Pervious slope"
"      0.161 Impervious Area"
"      20.000 Impervious length"
"      1.000 Impervious slope"
"      0.250 Pervious Manning 'n'"
"      75.000 Pervious SCS Curve No."
"      0.000 Pervious Runoff coefficient"
"      0.100 Pervious Ia/S coefficient"
"      8.467 Pervious Initial abstraction"
"      0.015 Impervious Manning 'n'"
"      98.000 Impervious SCS Curve No."
"      0.888 Impervious Runoff coefficient"
"      0.100 Impervious Ia/S coefficient"
"      0.518 Impervious Initial abstraction"
"      0.042      0.000      0.017      0.017 c.m/sec"
"      Catchment 201      Pervious      Impervious Total Area "
"      Surface Area      0.000      0.161      0.161      hectare"
"      Time of concentration 15.321      2.108      2.108      minutes"
"      Time to Centroid      230.622      189.051      189.051      minutes"
"      Rainfall depth      67.600      67.600      67.600      mm"
"      Rainfall volume      0.00      108.84      108.84      c.m"
"      Rainfall losses      43.380      7.602      7.602      mm"
"      Runoff depth      24.220      59.998      59.998      mm"
"      Runoff volume      0.00      96.60      96.60      c.m"
"      Runoff coefficient      0.000      0.888      0.888      "
"      Maximum flow      0.000      0.042      0.042      c.m/sec"
" 40      HYDROGRAPH Add Runoff "
"      4  Add Runoff "
"      0.042      0.042      0.017      0.017"
" 51      PIPE DESIGN"
"      0.042 Current peak flow      c.m/sec"
"      0.013 Manning 'n'"
"      0.375 Diameter      metre"
"      1.000 Gradient      %"
"      Depth of flow      0.125      metre"
"      Velocity      1.306      m/sec"
"      Pipe capacity      0.175      c.m/sec"
"      Critical depth      0.148      metre"
" 53      ROUTE Zero Route"
"      0.00 Zero Route Reach length      ( metre)"
"      0.042      0.042      0.042      0.017 c.m/sec"

```

```

" 40      HYDROGRAPH   Combine      2"
"          6   Combine  "
"          2   Node #  "
"          Runoff to underground storage tank"
"          Maximum flow      0.058   c.m/sec"
"          Hydrograph volume    180.462   c.m"
"          0.042      0.042      0.042      0.058"
" 40      HYDROGRAPH Start - New Tributary"
"          2   Start - New Tributary"
"          0.042      0.000      0.042      0.058"
" 81      ADD COMMENT=====
"          3   Lines of comment"
"          *****
"          * AREA 202 - COURTYARD AREA * "
"          *****
" 33      CATCHMENT 202"
"          1   Triangular SCS"
"          1   Equal length"
"          1   SCS method"
"          202  202- Courtyard"
"          65.000 % Impervious"
"          0.062  Total Area"
"          10.000 Flow length"
"          2.000  Overland Slope"
"          0.022  Pervious Area"
"          10.000 Pervious length"
"          2.000  Pervious slope"
"          0.040  Impervious Area"
"          10.000 Impervious length"
"          2.000  Impervious slope"
"          0.250  Pervious Manning 'n'"
"          74.000 Pervious SCS Curve No."
"          0.341  Pervious Runoff coefficient"
"          0.100  Pervious Ia/S coefficient"
"          8.924  Pervious Initial abstraction"
"          0.015  Impervious Manning 'n'"
"          98.000 Impervious SCS Curve No."
"          0.839  Impervious Runoff coefficient"
"          0.100  Impervious Ia/S coefficient"
"          0.518  Impervious Initial abstraction"
"          0.012      0.000      0.042      0.058 c.m/sec"
"          Catchment 202      Pervious      Impervious      Total Area  "
"          Surface Area      0.022      0.040      0.062      hectare"
"          Time of concentration 8.348      1.130      2.424      minutes"
"          Time to Centroid      221.205      188.083      194.021      minutes"
"          Rainfall depth      67.600      67.600      67.600      mm"
"          Rainfall volume      14.67      27.24      41.91      c.m"
"          Rainfall losses      44.577      10.851      22.655      mm"
"          Runoff depth      23.023      56.749      44.945      mm"
"          Runoff volume      5.00      22.87      27.87      c.m"
"          Runoff coefficient      0.341      0.839      0.665      "
"          Maximum flow      0.002      0.010      0.012      c.m/sec"
" 40      HYDROGRAPH Add Runoff  "
"          4   Add Runoff  "
"          0.012      0.012      0.042      0.058"
" 51      PIPE DESIGN"
"          0.012  Current peak flow      c.m/sec"
"          0.013  Manning 'n'"
"          0.300  Diameter      metre"
"          0.400  Gradient      %"
"          Depth of flow      0.089      metre"
"          Velocity      0.669      m/sec"
"          Pipe capacity      0.061      c.m/sec"
"          Critical depth      0.082      metre"
" 53      ROUTE Zero Route"
"          0.00  Zero Route Reach length  ( metre)"

```

```

                                122727-6h10REV.OUT
"          0.012      0.012      0.012      0.058 c.m/sec"
" 40      HYDROGRAPH   Combine      2"
"          6   Combine  "
"          2   Node #"
"          Runoff to underground storage tank"
"          Maximum flow          0.069      c.m/sec"
"          Hydrograph volume      208.328      c.m"
"          0.012      0.012      0.012      0.069"
" 81      ADD COMMENT=====
"          3   Lines of comment"
"          *****"
"          * CONTROLLED - UNDERGROUND SWM STORAGE TANK * "
"          *****"
" 40      HYDROGRAPH   Confluence      2"
"          7   Confluence  "
"          2   Node #"
"          Runoff to underground storage tank"
"          Maximum flow          0.069      c.m/sec"
"          Hydrograph volume      208.328      c.m"
"          0.012      0.069      0.012      0.000"
" 54      POND DESIGN"
"          0.069   Current peak flow      c.m/sec"
"          0.001   Target outflow      c.m/sec"
"          208.3   Hydrograph volume      c.m"
"          18.     Number of stages"
"          0.000   Minimum water level      metre"
"          3.550   Maximum water level      metre"
"          0.000   Starting water level      metre"
"          0       Keep Design Data: 1 = True; 0 = False"
"          Level Discharge      Volume"
"          0.000      0.000      0.000"
"          0.05000  0.00140      17.000"
"          0.1000  0.00180      33.900"
"          0.1500  0.00220      50.900"
"          0.2500  0.00270      84.900"
"          0.3500  0.00320     118.800"
"          0.4500  0.00360     152.800"
"          0.5500  0.00400     186.700"
"          0.6500  0.00430     220.700"
"          0.7500  0.00460     254.600"
"          0.8000  0.00470     271.600"
"          3.050   0.00910     271.800"
"          3.100   0.00920     272.000"
"          3.150   0.00930     272.200"
"          3.200   0.00940     272.400"
"          3.250   0.00940     272.600"
"          3.300   0.00950     272.800"
"          3.350   0.00960     273.000"
"          Peak outflow          0.004      c.m/sec"
"          Maximum level          0.480      metre"
"          Maximum storage        163.066      c.m"
"          Centroidal lag          11.843      hours"
"          0.012      0.069      0.004      0.000 c.m/sec"
" 40      HYDROGRAPH Next link "
"          5   Next link  "
"          0.012      0.004      0.004      0.000"
" 81      ADD COMMENT=====
"          3   Lines of comment"
"          *****"
"          * AREA 203 - UNCONSTROLLED LAND AREA * "
"          *****"
" 33      CATCHMENT 203"
"          1   Triangular SCS"
"          1   Equal length"
"          1   SCS method"
"          203  203- Uncontrolled land"

```

```

"      35.000  % Impervious"
"      0.153  Total Area"
"     10.000  Flow length"
"      2.000  Overland Slope"
"      0.099  Pervious Area"
"     10.000  Pervious length"
"      2.000  Pervious slope"
"      0.054  Impervious Area"
"     10.000  Impervious length"
"      2.000  Impervious slope"
"      0.250  Pervious Manning 'n'"
"     74.000  Pervious SCS Curve No."
"      0.341  Pervious Runoff coefficient"
"      0.100  Pervious Ia/S coefficient"
"      8.924  Pervious Initial abstraction"
"      0.015  Impervious Manning 'n'"
"     98.000  Impervious SCS Curve No."
"      0.839  Impervious Runoff coefficient"
"      0.100  Impervious Ia/S coefficient"
"      0.518  Impervious Initial abstraction"
"          0.022    0.004    0.004    0.000 c.m/sec"
"      Catchment 203      Pervious      Impervious      Total Area  "
"      Surface Area      0.099      0.054      0.153      hectare"
"      Time of concentration 8.348      1.130      4.231      minutes"
"      Time to Centroid    221.205    188.083    202.315    minutes"
"      Rainfall depth      67.600      67.600      67.600      mm"
"      Rainfall volume     67.23      36.20      103.43      c.m"
"      Rainfall losses     44.577      10.851      32.773      mm"
"      Runoff depth        23.023      56.749      34.827      mm"
"      Runoff volume       22.90      30.39      53.28      c.m"
"      Runoff coefficient   0.341      0.839      0.515      "
"      Maximum flow        0.009      0.013      0.022      c.m/sec"
" 81      ADD COMMENT=====
"      3      Lines of comment"
"      *****
"      * TOTAL FLOW FROM PROPOSED SITE AREA *
"      *****
" 40      HYDROGRAPH Add Runoff "
"      4      Add Runoff "
"          0.022    0.024    0.004    0.000"
" 38      START/RE-START TOTALS 203"
"      3      Runoff Totals on EXIT"
"      Total Catchment area      1.032      hectare"
"      Total Impervious area      0.653      hectare"
"      Total % impervious      63.261"
" 19      EXIT"

```



```

"          MIDUSS Output ----->"
"          MIDUSS version                      Version 2.25 rev. 473"
"          MIDUSS created                      Sunday, February 7, 2010"
"      10  Units used:                          ie METRIC"
"          Job folder:                        \\caneast.ibigroup.com\J\WT\"
"          122727_1107MainStW\7.0_Production\7.99_Submitted\FSR\Appendix B\SWM\May 2021"
"          Output filename:                    122727-6h25REV.OUT"
"          Licensee name:                      install"
"          Company                            IBI Group"
"          Date & Time last used:              2021-05-26 at 1:31:14 PM"
" 81      ADD COMMENT=====
"      6  Lines of comment"
"          *****"
"          * 122727 - 1107 MAIN STREET WEST      *"
"          * CITY OF HAMILTON                    *"
"          * IBI GROUP                          *"
"          * JANUARY 2020 - REVISED MAY 2021      *"
"          *****"
" 31      TIME PARAMETERS"
"      10.000 Time Step"
"      360.000 Max. Storm length"
"      3600.000 Max. Hydrograph"
" 81      ADD COMMENT=====
"      4  Lines of comment"
"          *****"
"          * 25 YEAR 6 HOUR SCS STORM  *"
"          * MOUNT HOPE IDF PARAMETERS  *"
"          *****"
" 32      STORM Historic"
"      5  Historic"
"      360.000 Duration"
"      36.000 Rainfall intensity values"
"          3.260      3.260      3.260      4.900      4.900"
"          4.900      4.900      4.900      4.900      8.160"
"          8.160      8.160      9.790      9.790      9.790"
"          48.960     88.130     127.300     17.950     17.950"
"          17.950      8.160      8.160      8.160      6.530"
"          6.530      6.530      4.900      4.900      4.900"
"          3.260      3.260      3.260      3.260      3.260"
"          3.260"
"          Maximum intensity      127.300      mm/hr"
"          Total depth            81.600      mm"
"      6  025hyd Hydrograph extension used in this file"
" 81      ADD COMMENT=====
"      3  Lines of comment"
"          *****"
"          * EXISTING CONDITIONS  *"
"          *****"
" 81      ADD COMMENT=====
"      3  Lines of comment"
"          *****"
"          * AREA 101 - EXISTING SITE AREA  *"
"          *****"
" 33      CATCHMENT 101"
"      1  Triangular SCS"
"      1  Equal length"
"      1  SCS method"
"      101 101- Exisitng site"
"      50.000 % Impervious"
"      0.516 Total Area"
"      40.000 Flow length"
"      2.000 Overland Slope"
"      0.258 Pervious Area"
"      40.000 Pervious length"
"      2.000 Pervious slope"
"      0.258 Impervious Area"

```

```

"      40.000 Impervious length"
"      2.000 Impervious slope"
"      0.250 Pervious Manning 'n'"
"      74.000 Pervious SCS Curve No."
"      0.400 Pervious Runoff coefficient"
"      0.100 Pervious Ia/S coefficient"
"      8.924 Pervious Initial abstraction"
"      0.015 Impervious Manning 'n'"
"      98.000 Impervious SCS Curve No."
"      0.907 Impervious Runoff coefficient"
"      0.100 Impervious Ia/S coefficient"
"      0.518 Impervious Initial abstraction"
"          0.100 0.000 0.000 0.000 c.m/sec"
"      Catchment 101 Pervious Impervious Total Area "
"      Surface Area 0.258 0.258 0.516 hectare"
"      Time of concentration 16.815 2.403 6.810 minutes"
"      Time to Centroid 231.116 188.707 201.674 minutes"
"      Rainfall depth 81.600 81.600 81.600 mm"
"      Rainfall volume 210.53 210.53 421.06 c.m"
"      Rainfall losses 49.000 7.582 28.291 mm"
"      Runoff depth 32.600 74.018 53.309 mm"
"      Runoff volume 84.11 190.97 275.08 c.m"
"      Runoff coefficient 0.400 0.907 0.653 "
"      Maximum flow 0.030 0.083 0.100 c.m/sec"
" 81 ADD COMMENT=====
"      3 Lines of comment"
"      *****
"      * TOTAL FLOW FROM EXISTING SITE AREA *
"      *****
" 40 HYDROGRAPH Add Runoff "
"      4 Add Runoff "
"          0.100 0.100 0.000 0.000"
" 51 PIPE DESIGN"
"      0.100 Current peak flow c.m/sec"
"      0.013 Manning 'n'"
"      0.375 Diameter metre"
"      1.000 Gradient %"
"      Depth of flow 0.202 metre"
"      Velocity 1.638 m/sec"
"      Pipe capacity 0.175 c.m/sec"
"      Critical depth 0.232 metre"
" 53 ROUTE Zero Route"
"      0.00 Zero Route Reach length ( metre)"
"          0.100 0.100 0.100 0.000 c.m/sec"
" 40 HYDROGRAPH Combine 1"
"      6 Combine "
"      1 Node #"
"      Runoff from existing site"
"      Maximum flow 0.100 c.m/sec"
"      Hydrograph volume 275.077 c.m"
"          0.100 0.100 0.100 0.100"
" 40 HYDROGRAPH Start - New Tributary"
"      2 Start - New Tributary"
"          0.100 0.000 0.100 0.100"
" 81 ADD COMMENT=====
"      3 Lines of comment"
"      *****
"      * PROPSOED CONDITIONS *
"      *****
" 81 ADD COMMENT=====
"      3 Lines of comment"
"      *****
"      * AREA 200 - ROOFTOP SWM STORAGE AREA *
"      *****
" 33 CATCHMENT 200"
"      1 Triangular SCS"

```

```

"      1 Equal length"
"      1 SCS method"
"     200 200- Rooftop stormwater storage"
" 100.000 % Impervious"
"     0.140 Total Area"
"    20.000 Flow length"
"     1.000 Overland Slope"
"     0.000 Pervious Area"
"    20.000 Pervious length"
"     1.000 Pervious slope"
"     0.140 Impervious Area"
"    20.000 Impervious length"
"     1.000 Impervious slope"
"     0.250 Pervious Manning 'n'"
"    75.000 Pervious SCS Curve No."
"     0.000 Pervious Runoff coefficient"
"     0.100 Pervious Ia/S coefficient"
"     8.467 Pervious Initial abstraction"
"     0.015 Impervious Manning 'n'"
"    98.000 Impervious SCS Curve No."
"     0.895 Impervious Runoff coefficient"
"     0.100 Impervious Ia/S coefficient"
"     0.518 Impervious Initial abstraction"
"           0.044      0.000      0.100      0.100 c.m/sec"
"      Catchment 200      Pervious      Impervious      Total Area "
"      Surface Area      0.000      0.140      0.140      hectare"
"      Time of concentration 13.465      1.952      1.952      minutes"
"      Time to Centroid 226.055      187.855      187.854      minutes"
"      Rainfall depth 81.600      81.600      81.600      mm"
"      Rainfall volume 0.00      114.24      114.24      c.m"
"      Rainfall losses 48.129      8.528      8.528      mm"
"      Runoff depth 33.471      73.072      73.072      mm"
"      Runoff volume 0.00      102.30      102.30      c.m"
"      Runoff coefficient 0.000      0.895      0.895      "
"      Maximum flow 0.000      0.044      0.044      c.m/sec"
" 40 HYDROGRAPH Add Runoff "
"      4 Add Runoff "
"           0.044      0.044      0.100      0.100"
" 81 ADD COMMENT=====
"      3 Lines of comment"
"      *****
"      * CONTROLLED - ROOFTOP SWM STORAGE * "
"      *****
" 54 POND DESIGN"
"      0.044 Current peak flow c.m/sec"
"      0.020 Target outflow c.m/sec"
"      102.3 Hydrograph volume c.m"
"      7. Number of stages"
"      0.000 Minimum water level metre"
"      0.152 Maximum water level metre"
"      0.000 Starting water level metre"
"      0 Keep Design Data: 1 = True; 0 = False"
"      Level Discharge Volume"
"      0.000 0.000 0.000"
"      0.02540 0.00418 0.3300"
"      0.05080 0.00836 2.630"
"      0.07620 0.01254 8.890"
"      0.1016 0.01672 21.070"
"      0.1270 0.02090 41.160"
"      0.1524 0.02508 74.120"
"      Peak outflow 0.018 c.m/sec"
"      Maximum level 0.112 metre"
"      Maximum storage 29.023 c.m"
"      Centroidal lag 3.346 hours"
"           0.044 0.044 0.018 0.100 c.m/sec"
" 40 HYDROGRAPH Combine 2"

```

```

"      6 Combine "
"      2 Node #"
"      Runoff to underground storage tank"
"      Maximum flow      0.018      c.m/sec"
"      Hydrograph volume      102.257      c.m"
"      0.044      0.044      0.018      0.018"
" 40    HYDROGRAPH Start - New Tributary"
"      2 Start - New Tributary"
"      0.044      0.000      0.018      0.018"
" 81    ADD COMMENT=====
"      3 Lines of comment"
"      ***** "
"      * AREA 201 - ROOFTOP AREA WITHOUT SWM STORAGE * "
"      *****"
" 33    CATCHMENT 201"
"      1 Triangular SCS"
"      1 Equal length"
"      1 SCS method"
"      201 201- Rooftop without storage"
" 100.000 % Impervious"
"      0.161 Total Area"
"      20.000 Flow length"
"      1.000 Overland Slope"
"      0.000 Pervious Area"
"      20.000 Pervious length"
"      1.000 Pervious slope"
"      0.161 Impervious Area"
"      20.000 Impervious length"
"      1.000 Impervious slope"
"      0.250 Pervious Manning 'n'"
"      75.000 Pervious SCS Curve No."
"      0.000 Pervious Runoff coefficient"
"      0.100 Pervious Ia/S coefficient"
"      8.467 Pervious Initial abstraction"
"      0.015 Impervious Manning 'n'"
"      98.000 Impervious SCS Curve No."
"      0.895 Impervious Runoff coefficient"
"      0.100 Impervious Ia/S coefficient"
"      0.518 Impervious Initial abstraction"
"      0.051      0.000      0.018      0.018 c.m/sec"
"      Catchment 201      Pervious      Impervious      Total Area "
"      Surface Area      0.000      0.161      0.161      hectare"
"      Time of concentration      13.465      1.952      1.952      minutes"
"      Time to Centroid      226.055      187.855      187.855      minutes"
"      Rainfall depth      81.600      81.600      81.600      mm"
"      Rainfall volume      0.00      131.38      131.38      c.m"
"      Rainfall losses      48.129      8.528      8.528      mm"
"      Runoff depth      33.471      73.072      73.072      mm"
"      Runoff volume      0.00      117.65      117.65      c.m"
"      Runoff coefficient      0.000      0.895      0.895      "
"      Maximum flow      0.000      0.051      0.051      c.m/sec"
" 40    HYDROGRAPH Add Runoff "
"      4 Add Runoff "
"      0.051      0.051      0.018      0.018"
" 51    PIPE DESIGN"
"      0.051 Current peak flow      c.m/sec"
"      0.013 Manning 'n'"
"      0.375 Diameter      metre"
"      1.000 Gradient      %"
"      Depth of flow      0.138      metre"
"      Velocity      1.375      m/sec"
"      Pipe capacity      0.175      c.m/sec"
"      Critical depth      0.163      metre"
" 53    ROUTE Zero Route"
"      0.00 Zero Route Reach length      ( metre)"
"      0.051      0.051      0.051      0.018 c.m/sec"

```

```

" 40      HYDROGRAPH   Combine      2"
"          6   Combine  "
"          2   Node #  "
"          Runoff to underground storage tank"
"          Maximum flow      0.068   c.m/sec"
"          Hydrograph volume    219.903   c.m"
"          0.051      0.051      0.051      0.068"
" 40      HYDROGRAPH Start - New Tributary"
"          2   Start - New Tributary"
"          0.051      0.000      0.051      0.068"
" 81      ADD COMMENT=====
"          3   Lines of comment"
"          *****
"          * AREA 202 - COURTYARD AREA * "
"          *****
" 33      CATCHMENT 202"
"          1   Triangular SCS"
"          1   Equal length"
"          1   SCS method"
"          202  202- Courtyard"
"          65.000 % Impervious"
"          0.062 Total Area"
"          10.000 Flow length"
"          2.000 Overland Slope"
"          0.022 Pervious Area"
"          10.000 Pervious length"
"          2.000 Pervious slope"
"          0.040 Impervious Area"
"          10.000 Impervious length"
"          2.000 Impervious slope"
"          0.250 Pervious Manning 'n'"
"          74.000 Pervious SCS Curve No."
"          0.390 Pervious Runoff coefficient"
"          0.100 Pervious Ia/S coefficient"
"          8.924 Pervious Initial abstraction"
"          0.015 Impervious Manning 'n'"
"          98.000 Impervious SCS Curve No."
"          0.843 Impervious Runoff coefficient"
"          0.100 Impervious Ia/S coefficient"
"          0.518 Impervious Initial abstraction"
"          0.015      0.000      0.051      0.068 c.m/sec"
"          Catchment 202      Pervious      Impervious      Total Area "
"          Surface Area      0.022      0.040      0.062      hectare"
"          Time of concentration 7.319      1.046      2.297      minutes"
"          Time to Centroid      217.963      186.981      193.158      minutes"
"          Rainfall depth      81.600      81.600      81.600      mm"
"          Rainfall volume      17.71      32.88      50.59      c.m"
"          Rainfall losses      49.785      12.814      25.754      mm"
"          Runoff depth      31.815      68.786      55.846      mm"
"          Runoff volume      6.90      27.72      34.62      c.m"
"          Runoff coefficient      0.390      0.843      0.684      "
"          Maximum flow      0.003      0.012      0.015      c.m/sec"
" 40      HYDROGRAPH Add Runoff "
"          4   Add Runoff "
"          0.015      0.015      0.051      0.068"
" 51      PIPE DESIGN"
"          0.015 Current peak flow      c.m/sec"
"          0.013 Manning 'n'"
"          0.300 Diameter      metre"
"          0.400 Gradient      %"
"          Depth of flow      0.101      metre"
"          Velocity      0.714      m/sec"
"          Pipe capacity      0.061      c.m/sec"
"          Critical depth      0.092      metre"
" 53      ROUTE Zero Route"
"          0.00 Zero Route Reach length ( metre)"

```

```

122727-6h25REV.OUT
"      0.015      0.015      0.015      0.068 c.m/sec"
" 40  HYDROGRAPH  Combine      2"
"      6  Combine "
"      2  Node #"
"      Runoff to underground storage tank"
"      Maximum flow      0.083      c.m/sec"
"      Hydrograph volume      254.527      c.m"
"      0.015      0.015      0.015      0.083"
" 81  ADD COMMENT=====
"      3  Lines of comment"
"      *****"
"      * CONTROLLED - UNDERGROUND SWM STORAGE TANK * "
"      *****"
" 40  HYDROGRAPH  Confluence      2"
"      7  Confluence "
"      2  Node #"
"      Runoff to underground storage tank"
"      Maximum flow      0.083      c.m/sec"
"      Hydrograph volume      254.527      c.m"
"      0.015      0.083      0.015      0.000"
" 54  POND DESIGN"
"      0.083  Current peak flow      c.m/sec"
"      0.001  Target outflow      c.m/sec"
"      254.5  Hydrograph volume      c.m"
"      18.    Number of stages"
"      0.000  Minimum water level      metre"
"      3.550  Maximum water level      metre"
"      0.000  Starting water level      metre"
"      0      Keep Design Data: 1 = True; 0 = False"
"      Level Discharge      Volume"
"      0.000      0.000      0.000"
"      0.05000      0.00140      17.000"
"      0.1000      0.00180      33.900"
"      0.1500      0.00220      50.900"
"      0.2500      0.00270      84.900"
"      0.3500      0.00320      118.800"
"      0.4500      0.00360      152.800"
"      0.5500      0.00400      186.700"
"      0.6500      0.00430      220.700"
"      0.7500      0.00460      254.600"
"      0.8000      0.00470      271.600"
"      3.050      0.00910      271.800"
"      3.100      0.00920      272.000"
"      3.150      0.00930      272.200"
"      3.200      0.00940      272.400"
"      3.250      0.00940      272.600"
"      3.300      0.00950      272.800"
"      3.350      0.00960      273.000"
"      Peak outflow      0.004      c.m/sec"
"      Maximum level      0.598      metre"
"      Maximum storage      202.868      c.m"
"      Centroidal lag      12.777      hours"
"      0.015      0.083      0.004      0.000 c.m/sec"
" 40  HYDROGRAPH Next link "
"      5  Next link "
"      0.015      0.004      0.004      0.000"
" 81  ADD COMMENT=====
"      3  Lines of comment"
"      *****"
"      * AREA 203 - UNCONSTROLLED LAND AREA * "
"      *****"
" 33  CATCHMENT 203"
"      1  Triangular SCS"
"      1  Equal length"
"      1  SCS method"
"      203  203- Uncontrolled land"

```

```

"      35.000  % Impervious"
"      0.153  Total Area"
"     10.000  Flow length"
"      2.000  Overland Slope"
"      0.099  Pervious Area"
"     10.000  Pervious length"
"      2.000  Pervious slope"
"      0.054  Impervious Area"
"     10.000  Impervious length"
"      2.000  Impervious slope"
"      0.250  Pervious Manning 'n'"
"     74.000  Pervious SCS Curve No."
"      0.390  Pervious Runoff coefficient"
"      0.100  Pervious Ia/S coefficient"
"      8.924  Pervious Initial abstraction"
"      0.015  Impervious Manning 'n'"
"     98.000  Impervious SCS Curve No."
"      0.843  Impervious Runoff coefficient"
"      0.100  Impervious Ia/S coefficient"
"      0.518  Impervious Initial abstraction"
"          0.029      0.004      0.004      0.000 c.m/sec"
"      Catchment 203      Pervious      Impervious      Total Area  "
"      Surface Area      0.099      0.054      0.153      hectare"
"      Time of concentration  7.319      1.046      3.945      minutes"
"      Time to Centroid      217.963      186.981      201.297      minutes"
"      Rainfall depth      81.600      81.600      81.600      mm"
"      Rainfall volume      81.15      43.70      124.85      c.m"
"      Rainfall losses      49.785      12.814      36.845      mm"
"      Runoff depth      31.815      68.786      44.755      mm"
"      Runoff volume      31.64      36.83      68.47      c.m"
"      Runoff coefficient      0.390      0.843      0.548      "
"      Maximum flow      0.013      0.016      0.029      c.m/sec"
" 81      ADD COMMENT=====
"      3      Lines of comment"
"      *****
"      * TOTAL FLOW FROM PROPOSED SITE AREA *
"      *****
" 40      HYDROGRAPH Add Runoff "
"      4      Add Runoff "
"          0.029      0.032      0.004      0.000"
" 38      START/RE-START TOTALS 203"
"      3      Runoff Totals on EXIT"
"      Total Catchment area      1.032      hectare"
"      Total Impervious area      0.653      hectare"
"      Total % impervious      63.261"
" 19      EXIT"

```

```

"          MIDUSS Output ----->"
"          MIDUSS version                      Version 2.25 rev. 473"
"          MIDUSS created                      Sunday, February 7, 2010"
"      10  Units used:                          ie METRIC"
"          Job folder:                        \\caneast.ibigroup.com\J\WT\"
"          122727_1107MainStW\7.0_Production\7.99_Submitted\FSR\Appendix B\SWM\May 2021"
"          Output filename:                    122727-6h50REV.OUT"
"          Licensee name:                      install"
"          Company                            IBI Group"
"          Date & Time last used:              2021-05-26 at 1:29:15 PM"
" 81      ADD COMMENT=====
"      6  Lines of comment"
"          *****"
"          * 122727 - 1107 MAIN STREET WEST      *"
"          * CITY OF HAMILTON                    *"
"          * IBI GROUP                          *"
"          * JANUARY 2020 - REVISED MAY 2021     *"
"          *****"
" 31      TIME PARAMETERS"
"      10.000 Time Step"
"      360.000 Max. Storm length"
"      3600.000 Max. Hydrograph"
" 81      ADD COMMENT=====
"      4  Lines of comment"
"          *****"
"          * 50 YEAR 6 HOUR SCS STORM          *"
"          * MOUNT HOPE IDF PARAMETERS          *"
"          *****"
" 32      STORM Historic"
"      5  Historic"
"      360.000 Duration"
"      36.000 Rainfall intensity values"
"          3.680      3.680      3.680      5.510      5.510"
"          5.510      5.510      5.510      5.510      9.190"
"          9.190      9.190      11.030      11.030      11.030"
"          55.140      99.250      143.360      20.220      20.220"
"          20.220      9.190      9.190      9.190      7.350"
"          7.350      7.350      5.510      5.510      5.510"
"          3.680      3.680      3.680      3.680      3.680"
"          3.680"
"          Maximum intensity      143.360      mm/hr"
"          Total depth            91.900      mm"
"      6  050hyd Hydrograph extension used in this file"
" 81      ADD COMMENT=====
"      3  Lines of comment"
"          *****"
"          * EXISTING CONDITIONS          *"
"          *****"
" 81      ADD COMMENT=====
"      3  Lines of comment"
"          *****"
"          * AREA 101 - EXISTING SITE AREA          *"
"          *****"
" 33      CATCHMENT 101"
"      1  Triangular SCS"
"      1  Equal length"
"      1  SCS method"
"      101 101- Exisitng site"
"      50.000 % Impervious"
"      0.516 Total Area"
"      40.000 Flow length"
"      2.000 Overland Slope"
"      0.258 Pervious Area"
"      40.000 Pervious length"
"      2.000 Pervious slope"
"      0.258 Impervious Area"

```



```

"      40.000  Impervious length"
"      2.000  Impervious slope"
"      0.250  Pervious Manning 'n'"
"      74.000  Pervious SCS Curve No."
"      0.433  Pervious Runoff coefficient"
"      0.100  Pervious Ia/S coefficient"
"      8.924  Pervious Initial abstraction"
"      0.015  Impervious Manning 'n'"
"      98.000  Impervious SCS Curve No."
"      0.911  Impervious Runoff coefficient"
"      0.100  Impervious Ia/S coefficient"
"      0.518  Impervious Initial abstraction"
"          0.114    0.000    0.000    0.000 c.m/sec"
"      Catchment 101      Pervious  Impervious Total Area "
"      Surface Area      0.258    0.258    0.516    hectare"
"      Time of concentration 15.541    2.290    6.559    minutes"
"      Time to Centroid    228.373    187.989    200.999    minutes"
"      Rainfall depth      91.900    91.900    91.900    mm"
"      Rainfall volume     237.10    237.10    474.20    c.m"
"      Rainfall losses     52.112    8.184    30.148    mm"
"      Runoff depth        39.788    83.716    61.752    mm"
"      Runoff volume       102.65    215.99    318.64    c.m"
"      Runoff coefficient   0.433    0.911    0.672    "
"      Maximum flow        0.042    0.093    0.114    c.m/sec"
" 81      ADD COMMENT=====
"      3  Lines of comment"
"      *****
"      * TOTAL FLOW FROM EXISTING SITE AREA *
"      *****
" 40      HYDROGRAPH Add Runoff "
"      4  Add Runoff "
"          0.114    0.114    0.000    0.000"
" 51      PIPE DESIGN"
"      0.114  Current peak flow    c.m/sec"
"      0.013  Manning 'n'"
"      0.375  Diameter    metre"
"      1.000  Gradient    %"
"          Depth of flow          0.220    metre"
"          Velocity              1.689    m/sec"
"          Pipe capacity          0.175    c.m/sec"
"          Critical depth          0.248    metre"
" 53      ROUTE Zero Route"
"      0.00  Zero Route Reach length    ( metre)"
"          0.114    0.114    0.114    0.000 c.m/sec"
" 40      HYDROGRAPH Combine 1"
"      6  Combine "
"      1  Node #"
"          Runoff from existing site"
"          Maximum flow          0.114    c.m/sec"
"          Hydrograph volume      318.640    c.m"
"          0.114    0.114    0.114    0.114"
" 40      HYDROGRAPH Start - New Tributary"
"      2  Start - New Tributary"
"          0.114    0.000    0.114    0.114"
" 81      ADD COMMENT=====
"      3  Lines of comment"
"      *****
"      * PROPSOED CONDITIONS *
"      *****
" 81      ADD COMMENT=====
"      3  Lines of comment"
"      *****
"      * AREA 200 - ROOFTOP SWM STORAGE AREA *
"      *****
" 33      CATCHMENT 200"
"      1  Triangular SCS"

```

```

"      1 Equal length"
"      1 SCS method"
"     200 200- Rooftop stormwater storage"
" 100.000 % Impervious"
"     0.140 Total Area"
"    20.000 Flow length"
"     1.000 Overland Slope"
"     0.000 Pervious Area"
"    20.000 Pervious length"
"     1.000 Pervious slope"
"     0.140 Impervious Area"
"    20.000 Impervious length"
"     1.000 Impervious slope"
"     0.250 Pervious Manning 'n'"
"    75.000 Pervious SCS Curve No."
"     0.000 Pervious Runoff coefficient"
"     0.100 Pervious Ia/S coefficient"
"     8.467 Pervious Initial abstraction"
"     0.015 Impervious Manning 'n'"
"    98.000 Impervious SCS Curve No."
"     0.899 Impervious Runoff coefficient"
"     0.100 Impervious Ia/S coefficient"
"     0.518 Impervious Initial abstraction"
"           0.050      0.000      0.114      0.114 c.m/sec"
"      Catchment 200      Pervious      Impervious      Total Area "
"      Surface Area      0.000      0.140      0.140      hectare"
"      Time of concentration 12.461      1.860      1.860      minutes"
"      Time to Centroid 223.420      187.240      187.240      minutes"
"      Rainfall depth 91.900      91.900      91.900      mm"
"      Rainfall volume 0.00      128.66      128.66      c.m"
"      Rainfall losses 50.812      9.273      9.273      mm"
"      Runoff depth 41.088      82.627      82.627      mm"
"      Runoff volume 0.00      115.68      115.68      c.m"
"      Runoff coefficient 0.000      0.899      0.899      "
"      Maximum flow 0.000      0.050      0.050      c.m/sec"
" 40 HYDROGRAPH Add Runoff "
"      4 Add Runoff "
"           0.050      0.050      0.114      0.114"
" 81 ADD COMMENT=====
"      3 Lines of comment"
"      *****
"      * CONTROLLED - ROOFTOP SWM STORAGE * "
"      *****
" 54 POND DESIGN"
"      0.050 Current peak flow c.m/sec"
"      0.020 Target outflow c.m/sec"
"      115.7 Hydrograph volume c.m"
"      7. Number of stages"
"      0.000 Minimum water level metre"
"      0.152 Maximum water level metre"
"      0.000 Starting water level metre"
"      0 Keep Design Data: 1 = True; 0 = False"
"      Level Discharge Volume"
"      0.000 0.000 0.000"
"      0.02540 0.00418 0.3300"
"      0.05080 0.00836 2.630"
"      0.07620 0.01254 8.890"
"      0.1016 0.01672 21.070"
"      0.1270 0.02090 41.160"
"      0.1524 0.02508 74.120"
"      Peak outflow 0.020 c.m/sec"
"      Maximum level 0.119 metre"
"      Maximum storage 34.520 c.m"
"      Centroidal lag 3.366 hours"
"           0.050 0.050 0.020 0.114 c.m/sec"
" 40 HYDROGRAPH Combine 2"

```

```

"      6 Combine "
"      2 Node #"
"      Runoff to underground storage tank"
"      Maximum flow      0.020      c.m/sec"
"      Hydrograph volume      115.936      c.m"
"      0.050      0.050      0.020      0.020"
" 40 HYDROGRAPH Start - New Tributary"
"      2 Start - New Tributary"
"      0.050      0.000      0.020      0.020"
" 81 ADD COMMENT=====
"      3 Lines of comment"
"      ***** "
"      * AREA 201 - ROOFTOP AREA WITHOUT SWM STORAGE * "
"      *****"
" 33 CATCHMENT 201"
"      1 Triangular SCS"
"      1 Equal length"
"      1 SCS method"
"      201 201- Rooftop without storage"
" 100.000 % Impervious"
"      0.161 Total Area"
"      20.000 Flow length"
"      1.000 Overland Slope"
"      0.000 Pervious Area"
"      20.000 Pervious length"
"      1.000 Pervious slope"
"      0.161 Impervious Area"
"      20.000 Impervious length"
"      1.000 Impervious slope"
"      0.250 Pervious Manning 'n'"
"      75.000 Pervious SCS Curve No."
"      0.000 Pervious Runoff coefficient"
"      0.100 Pervious Ia/S coefficient"
"      8.467 Pervious Initial abstraction"
"      0.015 Impervious Manning 'n'"
"      98.000 Impervious SCS Curve No."
"      0.899 Impervious Runoff coefficient"
"      0.100 Impervious Ia/S coefficient"
"      0.518 Impervious Initial abstraction"
"      0.057      0.000      0.020      0.020 c.m/sec"
"      Catchment 201      Pervious      Impervious      Total Area "
"      Surface Area      0.000      0.161      0.161      hectare"
"      Time of concentration      12.461      1.860      1.860      minutes"
"      Time to Centroid      223.420      187.240      187.240      minutes"
"      Rainfall depth      91.900      91.900      91.900      mm"
"      Rainfall volume      0.00      147.96      147.96      c.m"
"      Rainfall losses      50.812      9.273      9.273      mm"
"      Runoff depth      41.088      82.627      82.627      mm"
"      Runoff volume      0.00      133.03      133.03      c.m"
"      Runoff coefficient      0.000      0.899      0.899      "
"      Maximum flow      0.000      0.057      0.057      c.m/sec"
" 40 HYDROGRAPH Add Runoff "
"      4 Add Runoff "
"      0.057      0.057      0.020      0.020"
" 51 PIPE DESIGN"
"      0.057 Current peak flow      c.m/sec"
"      0.013 Manning 'n'"
"      0.375 Diameter      metre"
"      1.000 Gradient      %"
"      Depth of flow      0.147      metre"
"      Velocity      1.420      m/sec"
"      Pipe capacity      0.175      c.m/sec"
"      Critical depth      0.174      metre"
" 53 ROUTE Zero Route"
"      0.00 Zero Route Reach length      ( metre)"
"      0.057      0.057      0.057      0.020 c.m/sec"

```

```

" 40      HYDROGRAPH   Combine      2"
"          6   Combine  "
"          2   Node #  "
"          Runoff to underground storage tank"
"          Maximum flow      0.075   c.m/sec"
"          Hydrograph volume    248.966   c.m"
"          0.057      0.057      0.057      0.075"
" 40      HYDROGRAPH Start - New Tributary"
"          2   Start - New Tributary"
"          0.057      0.000      0.057      0.075"
" 81      ADD COMMENT=====
"          3   Lines of comment"
"          *****
"          * AREA 202 - COURTYARD AREA * "
"          *****
" 33      CATCHMENT 202"
"          1   Triangular SCS"
"          1   Equal length"
"          1   SCS method"
"          202 202- Courtyard"
"          65.000 % Impervious"
"          0.062 Total Area"
"          10.000 Flow length"
"          2.000 Overland Slope"
"          0.022 Pervious Area"
"          10.000 Pervious length"
"          2.000 Pervious slope"
"          0.040 Impervious Area"
"          10.000 Impervious length"
"          2.000 Impervious slope"
"          0.250 Pervious Manning 'n'"
"          74.000 Pervious SCS Curve No."
"          0.424 Pervious Runoff coefficient"
"          0.100 Pervious Ia/S coefficient"
"          8.924 Pervious Initial abstraction"
"          0.015 Impervious Manning 'n'"
"          98.000 Impervious SCS Curve No."
"          0.847 Impervious Runoff coefficient"
"          0.100 Impervious Ia/S coefficient"
"          0.518 Impervious Initial abstraction"
"          0.017      0.000      0.057      0.075 c.m/sec"
"          Catchment 202      Pervious      Impervious      Total Area "
"          Surface Area      0.022      0.040      0.062      hectare"
"          Time of concentration 6.765      0.997      2.222      minutes"
"          Time to Centroid    215.675      186.343      192.573      minutes"
"          Rainfall depth      91.900      91.900      91.900      mm"
"          Rainfall volume      19.94      37.04      56.98      c.m"
"          Rainfall losses      52.935      14.101      27.693      mm"
"          Runoff depth         38.965      77.799      64.207      mm"
"          Runoff volume         8.46      31.35      39.81      c.m"
"          Runoff coefficient    0.424      0.847      0.699      "
"          Maximum flow         0.004      0.013      0.017      c.m/sec"
" 40      HYDROGRAPH Add Runoff "
"          4   Add Runoff "
"          0.017      0.017      0.057      0.075"
" 51      PIPE DESIGN"
"          0.017 Current peak flow c.m/sec"
"          0.013 Manning 'n'"
"          0.300 Diameter metre"
"          0.400 Gradient %"
"          Depth of flow      0.109      metre"
"          Velocity           0.742      m/sec"
"          Pipe capacity      0.061      c.m/sec"
"          Critical depth     0.099      metre"
" 53      ROUTE Zero Route"
"          0.00 Zero Route Reach length ( metre)"

```

```

                                122727-6h50REV.OUT
"          0.017      0.017      0.017      0.075 c.m/sec"
" 40      HYDROGRAPH Combine      2"
"          6 Combine "
"          2 Node #"
"          Runoff to underground storage tank"
"          Maximum flow          0.092      c.m/sec"
"          Hydrograph volume      288.775      c.m"
"          0.017      0.017      0.017      0.092"
" 81      ADD COMMENT=====
"          3 Lines of comment"
"          *****"
"          * CONTROLLED - UNDERGROUND SWM STORAGE TANK * "
"          *****"
" 40      HYDROGRAPH Confluence      2"
"          7 Confluence "
"          2 Node #"
"          Runoff to underground storage tank"
"          Maximum flow          0.092      c.m/sec"
"          Hydrograph volume      288.775      c.m"
"          0.017      0.092      0.017      0.000"
" 54      POND DESIGN"
"          0.092 Current peak flow      c.m/sec"
"          0.001 Target outflow      c.m/sec"
"          288.8 Hydrograph volume      c.m"
"          18. Number of stages"
"          0.000 Minimum water level      metre"
"          3.550 Maximum water level      metre"
"          0.000 Starting water level      metre"
"          0 Keep Design Data: 1 = True; 0 = False"
"          Level Discharge      Volume"
"          0.000      0.000      0.000"
"          0.05000      0.00140      17.000"
"          0.1000      0.00180      33.900"
"          0.1500      0.00220      50.900"
"          0.2500      0.00270      84.900"
"          0.3500      0.00320      118.800"
"          0.4500      0.00360      152.800"
"          0.5500      0.00400      186.700"
"          0.6500      0.00430      220.700"
"          0.7500      0.00460      254.600"
"          0.8000      0.00470      271.600"
"          3.050      0.00910      271.800"
"          3.100      0.00920      272.000"
"          3.150      0.00930      272.200"
"          3.200      0.00940      272.400"
"          3.250      0.00940      272.600"
"          3.300      0.00950      272.800"
"          3.350      0.00960      273.000"
"          Peak outflow          0.004      c.m/sec"
"          Maximum level          0.686      metre"
"          Maximum storage      232.846      c.m"
"          Centroidal lag          13.447      hours"
"          0.017      0.092      0.004      0.000 c.m/sec"
" 40      HYDROGRAPH Next link "
"          5 Next link "
"          0.017      0.004      0.004      0.000"
" 81      ADD COMMENT=====
"          3 Lines of comment"
"          *****"
"          * AREA 203 - UNCONSTROLLED LAND AREA * "
"          *****"
" 33      CATCHMENT 203"
"          1 Triangular SCS"
"          1 Equal length"
"          1 SCS method"
"          203 203- Uncontrolled land"

```

```

"      35.000  % Impervious"
"      0.153  Total Area"
"     10.000  Flow length"
"      2.000  Overland Slope"
"      0.099  Pervious Area"
"     10.000  Pervious length"
"      2.000  Pervious slope"
"      0.054  Impervious Area"
"     10.000  Impervious length"
"      2.000  Impervious slope"
"      0.250  Pervious Manning 'n'"
"     74.000  Pervious SCS Curve No."
"      0.424  Pervious Runoff coefficient"
"      0.100  Pervious Ia/S coefficient"
"      8.924  Pervious Initial abstraction"
"      0.015  Impervious Manning 'n'"
"     98.000  Impervious SCS Curve No."
"      0.847  Impervious Runoff coefficient"
"      0.100  Impervious Ia/S coefficient"
"      0.518  Impervious Initial abstraction"
"          0.035      0.004      0.004      0.000 c.m/sec"
"      Catchment 203      Pervious      Impervious      Total Area  "
"      Surface Area      0.099      0.054      0.153      hectare"
"      Time of concentration 6.765      0.997      3.776      minutes"
"      Time to Centroid      215.675      186.343      200.478      minutes"
"      Rainfall depth      91.900      91.900      91.900      mm"
"      Rainfall volume      91.39      49.21      140.61      c.m"
"      Rainfall losses      52.935      14.101      39.343      mm"
"      Runoff depth      38.965      77.799      52.557      mm"
"      Runoff volume      38.75      41.66      80.41      c.m"
"      Runoff coefficient      0.424      0.847      0.572      "
"      Maximum flow      0.017      0.018      0.035      c.m/sec"
" 81      ADD COMMENT=====
"      3      Lines of comment"
"      *****
"      * TOTAL FLOW FROM PROPOSED SITE AREA *
"      *****
" 40      HYDROGRAPH Add Runoff "
"      4      Add Runoff "
"          0.035      0.038      0.004      0.000"
" 38      START/RE-START TOTALS 203"
"      3      Runoff Totals on EXIT"
"      Total Catchment area      1.032      hectare"
"      Total Impervious area      0.653      hectare"
"      Total % impervious      63.261"
" 19      EXIT"

```

```

"          MIDUSS Output ----->"
"          MIDUSS version                      Version 2.25 rev. 473"
"          MIDUSS created                      Sunday, February 7, 2010"
"      10  Units used:                          ie METRIC"
"          Job folder:                        \\caneast.ibigroup.com\J\WT\"
"          122727_1107MainStW\7.0_Production\7.99_Submitted\FSR\Appendix B\SWM\May 2021"
"          Output filename:                    122727-6h100REV.OUT"
"          Licensee name:                      install"
"          Company                            IBI Group"
"          Date & Time last used:              2021-05-26 at 1:27:39 PM"
" 81      ADD COMMENT=====
"      6  Lines of comment"
"          *****"
"          * 122727 - 1107 MAIN STREET WEST      *"
"          * CITY OF HAMILTON                    *"
"          * IBI GROUP                          *"
"          * JANUARY 2020 - REVISED MAY 2021     *"
"          *****"
" 31      TIME PARAMETERS"
"      10.000 Time Step"
"      360.000 Max. Storm length"
"      3600.000 Max. Hydrograph"
" 81      ADD COMMENT=====
"      4  Lines of comment"
"          *****"
"          * 100 YEAR 6 HOUR SCS STORM *"
"          * MOUNT HOPE IDF PARAMETERS *"
"          *****"
" 32      STORM Historic"
"      5  Historic"
"      360.000 Duration"
"      36.000 Rainfall intensity values"
"          4.090      4.090      4.090      6.140      6.140"
"          6.140      6.140      6.140      6.140      10.230"
"          10.230     10.230     12.280     12.280     12.280"
"          61.380    110.480    159.590    22.510    22.510"
"          22.510     10.230     10.230     10.230     8.180"
"          8.180      8.180      6.140      6.140      6.140"
"          4.090      4.090      4.090      4.090      4.090"
"          4.090"
"          Maximum intensity          159.590 mm/hr"
"          Total depth                102.302 mm"
"      6  100hyd Hydrograph extension used in this file"
" 81      ADD COMMENT=====
"      3  Lines of comment"
"          *****"
"          * EXISTING CONDITIONS *"
"          *****"
" 81      ADD COMMENT=====
"      3  Lines of comment"
"          *****"
"          * AREA 101 - EXISTING SITE AREA *"
"          *****"
" 33      CATCHMENT 101"
"      1  Triangular SCS"
"      1  Equal length"
"      1  SCS method"
"      101 101- Exisitng site"
"      50.000 % Impervious"
"      0.516 Total Area"
"      40.000 Flow length"
"      2.000 Overland Slope"
"      0.258 Pervious Area"
"      40.000 Pervious length"
"      2.000 Pervious slope"
"      0.258 Impervious Area"

```

```

"      40.000 Impervious length"
"      2.000 Impervious slope"
"      0.250 Pervious Manning 'n'"
"      74.000 Pervious SCS Curve No."
"      0.463 Pervious Runoff coefficient"
"      0.100 Pervious Ia/S coefficient"
"      8.924 Pervious Initial abstraction"
"      0.015 Impervious Manning 'n'"
"      98.000 Impervious SCS Curve No."
"      0.914 Impervious Runoff coefficient"
"      0.100 Impervious Ia/S coefficient"
"      0.518 Impervious Initial abstraction"
"          0.132      0.000      0.000      0.000 c.m/sec"
"      Catchment 101      Pervious Impervious Total Area "
"      Surface Area      0.258      0.258      0.516      hectare"
"      Time of concentration 14.511      2.192      6.334      minutes"
"      Time to Centroid      225.826      187.314      200.263      minutes"
"      Rainfall depth      102.302      102.302      102.302      mm"
"      Rainfall volume      263.94      263.94      527.88      c.m"
"      Rainfall losses      54.916      8.763      31.839      mm"
"      Runoff depth      47.386      93.539      70.462      mm"
"      Runoff volume      122.26      241.33      363.59      c.m"
"      Runoff coefficient      0.463      0.914      0.689      "
"      Maximum flow      0.050      0.103      0.132      c.m/sec"
" 81      ADD COMMENT=====
"      3 Lines of comment"
"      *****
"      * TOTAL FLOW FROM EXISTING SITE AREA *
"      *****
" 40      HYDROGRAPH Add Runoff "
"      4 Add Runoff "
"          0.132      0.132      0.000      0.000"
" 51      PIPE DESIGN"
"      0.132 Current peak flow      c.m/sec"
"      0.013 Manning 'n'"
"      0.375 Diameter      metre"
"      1.000 Gradient      %"
"      Depth of flow      0.243      metre"
"      Velocity      1.743      m/sec"
"      Pipe capacity      0.175      c.m/sec"
"      Critical depth      0.268      metre"
" 53      ROUTE Zero Route"
"      0.00 Zero Route Reach length ( metre)"
"          0.132      0.132      0.132      0.000 c.m/sec"
" 40      HYDROGRAPH Combine 1"
"      6 Combine "
"      1 Node #"
"      Runoff from existing site"
"      Maximum flow      0.132      c.m/sec"
"      Hydrograph volume      363.585      c.m"
"          0.132      0.132      0.132      0.132"
" 40      HYDROGRAPH Start - New Tributary"
"      2 Start - New Tributary"
"          0.132      0.000      0.132      0.132"
" 81      ADD COMMENT=====
"      3 Lines of comment"
"      *****
"      * PROPSOED CONDITIONS *
"      *****
" 81      ADD COMMENT=====
"      3 Lines of comment"
"      *****
"      * AREA 200 - ROOFTOP SWM STORAGE AREA *
"      *****
" 33      CATCHMENT 200"
"      1 Triangular SCS"

```



```

"      1 Equal length"
"      1 SCS method"
"     200 200- Rooftop stormwater storage"
" 100.000 % Impervious"
"     0.140 Total Area"
"    20.000 Flow length"
"     1.000 Overland Slope"
"     0.000 Pervious Area"
"    20.000 Pervious length"
"     1.000 Pervious slope"
"     0.140 Impervious Area"
"    20.000 Impervious length"
"     1.000 Impervious slope"
"     0.250 Pervious Manning 'n'"
"    75.000 Pervious SCS Curve No."
"     0.000 Pervious Runoff coefficient"
"     0.100 Pervious Ia/S coefficient"
"     8.467 Pervious Initial abstraction"
"     0.015 Impervious Manning 'n'"
"    98.000 Impervious SCS Curve No."
"     0.901 Impervious Runoff coefficient"
"     0.100 Impervious Ia/S coefficient"
"     0.518 Impervious Initial abstraction"
"           0.055      0.000      0.132      0.132 c.m/sec"
"      Catchment 200      Pervious      Impervious      Total Area "
"      Surface Area      0.000      0.140      0.140      hectare"
"      Time of concentration 11.649      1.781      1.781      minutes"
"      Time to Centroid 221.109      186.675      186.675      minutes"
"      Rainfall depth 102.302      102.302      102.302      mm"
"      Rainfall volume 0.00      143.22      143.22      c.m"
"      Rainfall losses 53.186      10.092      10.092      mm"
"      Runoff depth 49.116      92.210      92.210      mm"
"      Runoff volume 0.00      129.09      129.09      c.m"
"      Runoff coefficient 0.000      0.901      0.901      "
"      Maximum flow 0.000      0.055      0.055      c.m/sec"
" 40 HYDROGRAPH Add Runoff "
"      4 Add Runoff "
"           0.055      0.055      0.132      0.132"
" 81 ADD COMMENT=====
"      3 Lines of comment"
"      *****
"      * CONTROLLED - ROOFTOP SWM STORAGE * "
"      *****
" 54 POND DESIGN"
"      0.055 Current peak flow c.m/sec"
"      0.020 Target outflow c.m/sec"
"      129.1 Hydrograph volume c.m"
"      7. Number of stages"
"      0.000 Minimum water level metre"
"      0.152 Maximum water level metre"
"      0.000 Starting water level metre"
"      0 Keep Design Data: 1 = True; 0 = False"
"      Level Discharge Volume"
"      0.000 0.000 0.000"
"      0.02540 0.00418 0.3300"
"      0.05080 0.00836 2.630"
"      0.07620 0.01254 8.890"
"      0.1016 0.01672 21.070"
"      0.1270 0.02090 41.160"
"      0.1524 0.02508 74.120"
"      Peak outflow 0.021 c.m/sec"
"      Maximum level 0.126 metre"
"      Maximum storage 40.112 c.m"
"      Centroidal lag 3.385 hours"
"           0.055 0.055 0.021 0.132 c.m/sec"
" 40 HYDROGRAPH Combine 2"

```

```

"      6 Combine "
"      2 Node #"
"      Runoff to underground storage tank"
"      Maximum flow      0.021      c.m/sec"
"      Hydrograph volume      129.197      c.m"
"      0.055      0.055      0.021      0.021"
" 40      HYDROGRAPH Start - New Tributary"
"      2 Start - New Tributary"
"      0.055      0.000      0.021      0.021"
" 81      ADD COMMENT=====
"      3 Lines of comment"
"      ***** "
"      * AREA 201 - ROOFTOP AREA WITHOUT SWM STORAGE * "
"      *****"
" 33      CATCHMENT 201"
"      1 Triangular SCS"
"      1 Equal length"
"      1 SCS method"
"      201 201- Rooftop without storage"
" 100.000 % Impervious"
"      0.161 Total Area"
"      20.000 Flow length"
"      1.000 Overland Slope"
"      0.000 Pervious Area"
"      20.000 Pervious length"
"      1.000 Pervious slope"
"      0.161 Impervious Area"
"      20.000 Impervious length"
"      1.000 Impervious slope"
"      0.250 Pervious Manning 'n'"
"      75.000 Pervious SCS Curve No."
"      0.000 Pervious Runoff coefficient"
"      0.100 Pervious Ia/S coefficient"
"      8.467 Pervious Initial abstraction"
"      0.015 Impervious Manning 'n'"
"      98.000 Impervious SCS Curve No."
"      0.901 Impervious Runoff coefficient"
"      0.100 Impervious Ia/S coefficient"
"      0.518 Impervious Initial abstraction"
"      0.064      0.000      0.021      0.021 c.m/sec"
"      Catchment 201      Pervious      Impervious      Total Area "
"      Surface Area      0.000      0.161      0.161      hectare"
"      Time of concentration      11.649      1.781      1.781      minutes"
"      Time to Centroid      221.109      186.675      186.675      minutes"
"      Rainfall depth      102.302      102.302      102.302      mm"
"      Rainfall volume      0.00      164.71      164.71      c.m"
"      Rainfall losses      53.186      10.092      10.092      mm"
"      Runoff depth      49.116      92.210      92.210      mm"
"      Runoff volume      0.00      148.46      148.46      c.m"
"      Runoff coefficient      0.000      0.901      0.901      "
"      Maximum flow      0.000      0.064      0.064      c.m/sec"
" 40      HYDROGRAPH Add Runoff "
"      4 Add Runoff "
"      0.064      0.064      0.021      0.021"
" 51      PIPE DESIGN"
"      0.064 Current peak flow      c.m/sec"
"      0.013 Manning 'n'"
"      0.375 Diameter      metre"
"      1.000 Gradient      %"
"      Depth of flow      0.156      metre"
"      Velocity      1.461      m/sec"
"      Pipe capacity      0.175      c.m/sec"
"      Critical depth      0.183      metre"
" 53      ROUTE Zero Route"
"      0.00 Zero Route Reach length      ( metre)"
"      0.064      0.064      0.064      0.021 c.m/sec"

```

```

" 40      HYDROGRAPH   Combine      2"
"          6   Combine  "
"          2   Node #  "
"          Runoff to underground storage tank"
"          Maximum flow      0.082   c.m/sec"
"          Hydrograph volume    277.655   c.m"
"          0.064      0.064      0.064      0.082"
" 40      HYDROGRAPH Start - New Tributary"
"          2   Start - New Tributary"
"          0.064      0.000      0.064      0.082"
" 81      ADD COMMENT=====
"          3   Lines of comment"
"          *****
"          * AREA 202 - COURTYARD AREA * "
"          *****
" 33      CATCHMENT 202"
"          1   Triangular SCS"
"          1   Equal length"
"          1   SCS method"
"          202 202- Courtyard"
"          65.000 % Impervious"
"          0.062 Total Area"
"          10.000 Flow length"
"          2.000 Overland Slope"
"          0.022 Pervious Area"
"          10.000 Pervious length"
"          2.000 Pervious slope"
"          0.040 Impervious Area"
"          10.000 Impervious length"
"          2.000 Impervious slope"
"          0.250 Pervious Manning 'n'"
"          74.000 Pervious SCS Curve No."
"          0.456 Pervious Runoff coefficient"
"          0.100 Pervious Ia/S coefficient"
"          8.924 Pervious Initial abstraction"
"          0.015 Impervious Manning 'n'"
"          98.000 Impervious SCS Curve No."
"          0.849 Impervious Runoff coefficient"
"          0.100 Impervious Ia/S coefficient"
"          0.518 Impervious Initial abstraction"
"          0.019      0.000      0.064      0.082 c.m/sec"
"          Catchment 202      Pervious      Impervious      Total Area "
"          Surface Area      0.022      0.040      0.062      hectare"
"          Time of concentration 6.316      0.954      2.157      minutes"
"          Time to Centroid      213.916      185.767      192.083      minutes"
"          Rainfall depth      102.302      102.302      102.302      mm"
"          Rainfall volume      22.20      41.23      63.43      c.m"
"          Rainfall losses      55.630      15.424      29.496      mm"
"          Runoff depth      46.672      86.878      72.806      mm"
"          Runoff volume      10.13      35.01      45.14      c.m"
"          Runoff coefficient      0.456      0.849      0.712      "
"          Maximum flow      0.005      0.015      0.019      c.m/sec"
" 40      HYDROGRAPH Add Runoff "
"          4   Add Runoff "
"          0.019      0.019      0.064      0.082"
" 51      PIPE DESIGN"
"          0.019 Current peak flow      c.m/sec"
"          0.013 Manning 'n'"
"          0.300 Diameter      metre"
"          0.400 Gradient      %"
"          Depth of flow      0.116      metre"
"          Velocity      0.769      m/sec"
"          Pipe capacity      0.061      c.m/sec"
"          Critical depth      0.106      metre"
" 53      ROUTE Zero Route"
"          0.00 Zero Route Reach length ( metre)"

```

```

122727-6h100REV.OUT
"      0.019      0.019      0.019      0.082 c.m/sec"
" 40  HYDROGRAPH Combine 2"
"      6 Combine "
"      2 Node #"
"      Runoff to underground storage tank"
"      Maximum flow      0.102 c.m/sec"
"      Hydrograph volume      322.794 c.m"
"      0.019      0.019      0.019      0.102"
" 81  ADD COMMENT=====
"      3 Lines of comment"
"      *****"
"      * CONTROLLED - UNDERGROUND SWM STORAGE TANK * "
"      *****"
" 40  HYDROGRAPH Confluence 2"
"      7 Confluence "
"      2 Node #"
"      Runoff to underground storage tank"
"      Maximum flow      0.102 c.m/sec"
"      Hydrograph volume      322.794 c.m"
"      0.019      0.102      0.019      0.000"
" 54  POND DESIGN"
"      0.102 Current peak flow c.m/sec"
"      0.001 Target outflow c.m/sec"
"      322.8 Hydrograph volume c.m"
"      18. Number of stages"
"      0.000 Minimum water level metre"
"      3.550 Maximum water level metre"
"      0.000 Starting water level metre"
"      0 Keep Design Data: 1 = True; 0 = False"
"      Level Discharge Volume"
"      0.000 0.000 0.000"
"      0.05000 0.00140 17.000"
"      0.1000 0.00180 33.900"
"      0.1500 0.00220 50.900"
"      0.2500 0.00270 84.900"
"      0.3500 0.00320 118.800"
"      0.4500 0.00360 152.800"
"      0.5500 0.00400 186.700"
"      0.6500 0.00430 220.700"
"      0.7500 0.00460 254.600"
"      0.8000 0.00470 271.600"
"      3.050 0.00910 271.800"
"      3.100 0.00920 272.000"
"      3.150 0.00930 272.200"
"      3.200 0.00940 272.400"
"      3.250 0.00940 272.600"
"      3.300 0.00950 272.800"
"      3.350 0.00960 273.000"
"      Peak outflow      0.005 c.m/sec"
"      Maximum level      0.774 metre"
"      Maximum storage      262.879 c.m"
"      Centroidal lag      14.081 hours"
"      0.019      0.102      0.005      0.000 c.m/sec"
" 40  HYDROGRAPH Next link "
"      5 Next link "
"      0.019      0.005      0.005      0.000"
" 81  ADD COMMENT=====
"      3 Lines of comment"
"      *****"
"      * AREA 203 - UNCONSTROLLED LAND AREA * "
"      *****"
" 33  CATCHMENT 203"
"      1 Triangular SCS"
"      1 Equal length"
"      1 SCS method"
"      203 203- Uncontrolled land"

```

```

"      35.000  % Impervious"
"      0.153  Total Area"
"     10.000  Flow length"
"      2.000  Overland Slope"
"      0.099  Pervious Area"
"     10.000  Pervious length"
"      2.000  Pervious slope"
"      0.054  Impervious Area"
"     10.000  Impervious length"
"      2.000  Impervious slope"
"      0.250  Pervious Manning 'n'"
"     74.000  Pervious SCS Curve No."
"      0.456  Pervious Runoff coefficient"
"      0.100  Pervious Ia/S coefficient"
"      8.924  Pervious Initial abstraction"
"      0.015  Impervious Manning 'n'"
"     98.000  Impervious SCS Curve No."
"      0.849  Impervious Runoff coefficient"
"      0.100  Impervious Ia/S coefficient"
"      0.518  Impervious Initial abstraction"
"          0.041    0.005    0.005    0.000 c.m/sec"
"      Catchment 203      Pervious      Impervious      Total Area  "
"      Surface Area      0.099      0.054      0.153      hectare"
"      Time of concentration 6.316      0.954      3.632      minutes"
"      Time to Centroid    213.916    185.767    199.825    minutes"
"      Rainfall depth      102.302    102.302    102.302    mm"
"      Rainfall volume     101.74     54.78     156.52     c.m"
"      Rainfall losses     55.630     15.424    41.558     mm"
"      Runoff depth        46.672     86.878    60.744     mm"
"      Runoff volume       46.42      46.52     92.94      c.m"
"      Runoff coefficient   0.456      0.849     0.594      "
"      Maximum flow        0.021      0.020     0.041      c.m/sec"
" 81      ADD COMMENT=====
"      3      Lines of comment"
"      *****
"      * TOTAL FLOW FROM PROPOSED SITE AREA *
"      *****
" 40      HYDROGRAPH Add Runoff "
"      4      Add Runoff "
"          0.041    0.044    0.005    0.000"
" 38      START/RE-START TOTALS 203"
"      3      Runoff Totals on EXIT"
"      Total Catchment area          1.032      hectare"
"      Total Impervious area         0.653      hectare"
"      Total % impervious            63.261"
" 19      EXIT"

```